


# Water Loss Control - Outliers

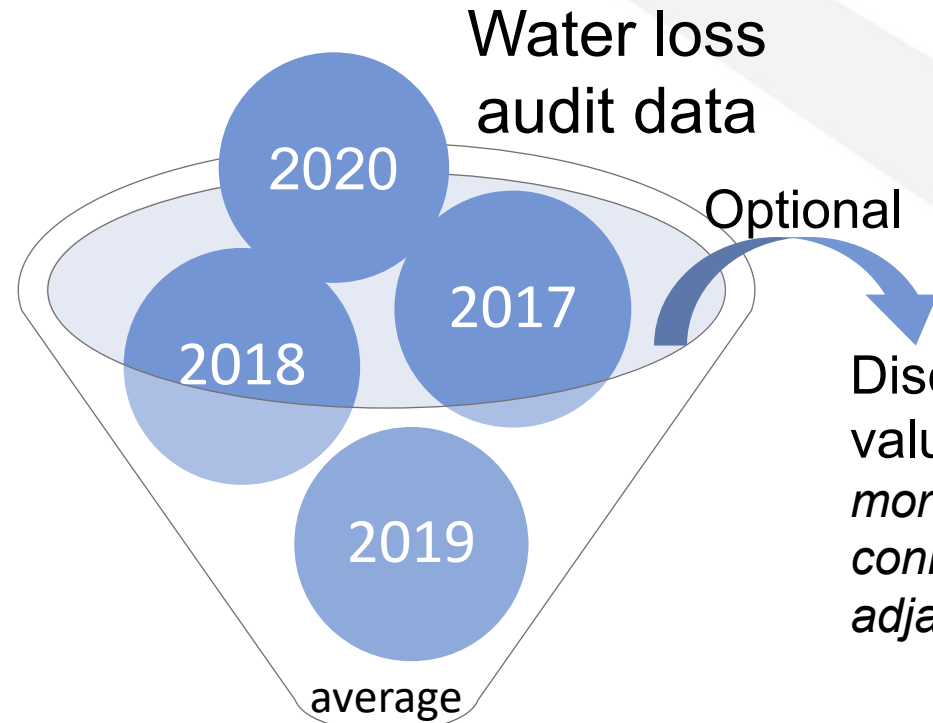

Optional  
 Discard one *outlier* real loss value: *Negative or varies by more than 10 gallons per connection day (gpcd) from the adjacent years' values.*

**Meet water loss standard by 2028**

- Can assess compliance through 2025, 2026, or 2027 audits
- Ongoing compliance on a three-year average basis

Outlier Example 1

Year	Real Loss (gpcd)	Outlier?
2017	21	Yes
2018	9	Yes
2019	20	No
2020	16	No

Outlier Example 2

Year	Real Loss (gpcd)	Outlier?
2017	21	No
2018	11	No
2019	20	No
2020	9	Yes