

**CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
CENTRAL VALLEY REGION**

364 Knollcrest Drive, Suite 205, Redding, California 96002
Phone (530) 224-4845 O Fax (530) 224-4857

[Central Valley Home Page](http://www.waterboards.ca.gov/centralvalley) (http://www.waterboards.ca.gov/centralvalley)

**NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) CA0077704
ORDER R5-2025-0011**

**WASTE DISCHARGE REQUIREMENTS FOR
THE CITY OF ANDERSON WATER POLLUTION CONTROL PLANT
SHASTA COUNTY**

The following Discharger is subject to waste discharge requirements (WDRs) set forth in this Order:

Table 1. Discharger Information

Discharger:	City of Anderson
Name of Facility:	Anderson Water Pollution Control Plant
Facility Street Address:	3701 Rupert Road
Facility City, State, Zip:	Anderson, CA 96007
Facility County:	Shasta County

Table 2. Discharge Location

Discharge Point	Effluent Description	Discharge Point Latitude (North)	Discharge Point Longitude (West)	Receiving Water
001	Advanced Secondary Treated Wastewater	40° 28' 8"	122° 16' 45"	Sacramento River

Table 3. Administrative Information

This Order was Adopted on:	21 February 2025
This Order shall become effective on:	1 April 2025
This Order shall expire on:	31 March 2030
The Discharger shall file a Report of Waste Discharge (ROWD) as an application for reissuance of WDRs in accordance with title 23, California Code of Regulations (CCR), and an application for reissuance of a NPDES permit no later than:	31 March 2029
The United States Environmental Protection Agency (U.S. EPA) and the California Regional Water Quality Control Board, Central Valley Region have classified this discharge as follows: Major Discharge	

I, Patrick Pulupa, Executive Officer, do hereby certify that this Order with all attachments is a full, true, and correct copy of the Order adopted by the California Regional Water Quality Control Board, Central Valley Region, on **21 February 2025**.

PATRICK PULUPA, Executive Officer

**WASTE DISCHARGE REQUIREMENTS
 TABLE OF CONTENTS**

I. Facility Information 3
 II. Findings 3
 III. Discharge Prohibitions 4
 IV. Effluent Limitations and Discharge Specifications 5
 A. Effluent Limitations – Discharge Point D-001 5
 1. Final Effluent Limitations – Discharge Point D-001 5
 2. Interim Effluent Limitations – NOT APPLICABLE 6
 B. Land Discharge Specifications – NOT APPLICABLE 6
 C. Recycling Specifications – NOT APPLICABLE 6
 V. Receiving Water Limitations 7
 A. Surface Water Limitations 7
 B. Groundwater Limitations 9
 VI. Provisions 10
 A. Standard Provisions 10
 B. Monitoring and Reporting Program (MRP) Requirements 15
 C. Special Provisions 15
 1. Reopener Provisions 15
 2. Special Studies, Technical Reports and Additional Monitoring Requirements 16
 3. Best Management Practices and Pollution Prevention 16
 4. Construction, Operation and Maintenance Specifications 17
 5. Special Provisions for Publicly-Owned Treatment Works (POTWs) 19
 6. Other Special Provisions 20
 7. Compliance Schedules – Not Applicable 20
 VII. Compliance Determination 20

TABLES

Table 1. Discharger Information 1
 Table 2. Discharge Location 1
 Table 3. Administrative Information 1
 Table 4. Effluent Limitations 5

ATTACHMENTS

Attachment A – Definitions A-1
 Attachment B – Maps B-1
 Attachment C – Flow Schematic C-1
 Attachment D – Standard Provisions D-1
 Attachment E – Monitoring and Reporting Program E-1
 Attachment F – Fact Sheet F-1
 Attachment G – Summary Of Reasonable Potential Analysis G-1
 Attachment H-1 – Calculation of WQBELS H-1
 Attachment H-2 – Calculation of WQBELS H-2

I. FACILITY INFORMATION

Information describing the City of Anderson Water Pollution Control Plant (Facility) is summarized in Table 1 and in sections I and II of the Fact Sheet (Attachment F). Section I of the Fact Sheet also includes information regarding the Facility's permit application.

II. FINDINGS

The California Regional Water Quality Control Board, Central Valley Region (hereinafter Central Valley Water Board), finds:

A. Legal Authorities.

This Order serves as waste discharge requirements (WDRs) pursuant to article 4, chapter 4, division 7 of the California Water Code (commencing with section 13260). This Order is also issued pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. EPA and chapter 5.5, division 7 of the Water Code (commencing with section 13370). It shall serve as a National Pollutant Discharge Elimination System (NPDES) permit authorizing the Discharger to discharge into waters of the United States at the discharge location described in Table 2 subject to the WDRs in this Order.

B. California Environmental Quality Act (CEQA).

Under Water Code section 13389, this action to adopt an NPDES permit is exempt from the provisions of Chapter 3 of CEQA, (commencing with section 21100) of Division 13 of Public Resources Code. Additionally, the adoption of land discharge requirements for the Facility constituents permitting of an existing facility that is categorically exempt from the provisions of CEQA pursuant to CCR, title 14, section 15301.

C. Background and Rationale for Requirements.

The Central Valley Water Board developed the requirements in this Order based on information submitted as part of the application, through monitoring and reporting programs, and other available information. The Fact Sheet (Attachment F), which contains background information and rationale for the requirements in this Order, is hereby incorporated into and constitutes Findings for this Order. Attachments A through E and G through H are also incorporated into this Order.

D. Provisions and Requirements Implementing State Law.

The provisions/requirements in subsections **IV.B**, **IV.C**, and **V.B** are included to implement state law only. These provisions/requirements are not required or authorized under the federal CWA; consequently, violations of these provisions/requirements are not subject to the enforcement remedies that are available for NPDES violations.

E. Monitoring and Reporting.

40 C.F.R. section 122.48 requires that all NPDES permits specify requirements for recording and reporting monitoring results. Water Code sections 13267 and 13383 authorize the Central Valley Water Board to establish monitoring, inspection, entry,

reporting, and recordkeeping requirements. This Order and the Monitoring and Reporting Program, provided in Attachment E, establish monitoring and reporting requirements to implement federal and State requirements. The burden, including costs, of these monitoring and reporting requirements bears a reasonable relationship to the need for these reports and the benefits to be obtained therefrom. The Discharger, as owner and operator of the Facility, is responsible for these requirements, which are necessary to determine compliance with this Order. The need for these requirements is further discussed in the Fact Sheet, Attachment F.

F. Notification of Interested Persons.

The Central Valley Water Board has notified the Discharger and interested agencies and persons of its intent to prescribe WDRs for the discharge and has provided them with an opportunity to submit their written comments and recommendations. Details of the notification are provided in the Fact Sheet.

G. Consideration of Public Comment.

The Central Valley Water Board, in a public meeting, heard and considered all comments pertaining to the discharge. Details of the Public Hearing are provided in the Fact Sheet.

THEREFORE, IT IS HEREBY ORDERED that Order R5-2019-0068 is rescinded upon the effective date of this Order except for enforcement purposes, and, in order to meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the CWA and regulations and guidelines adopted thereunder, the Discharger shall comply with the requirements in this Order. This action in no way prevents the Central Valley Water Board from taking enforcement action for violations of the previous Order.

III. DISCHARGE PROHIBITIONS

- A.** Discharge of wastewater from the Facility, as the Facility is specifically described in the Fact Sheet in section II.B, in a manner different from that described in this Order is prohibited.
- B.** The by-pass or overflow of wastes to surface waters is prohibited, except as allowed by Federal Standard Provisions I.G. and I.H. (Attachment D).
- C.** Neither the discharge nor its treatment shall create a nuisance as defined in section 13050 of the Water Code.
- D.** Discharge of waste classified as 'hazardous', as defined in the CCR, title 22, section 66261.1 et seq., is prohibited.
- E. Average Dry Weather Flow.** Discharges exceeding an average dry weather flow of 2.0 million gallons per day (MGD) are prohibited.

IV. EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

A. Effluent Limitations – Discharge Point D-001

1. Final Effluent Limitations – Discharge Point D-001

The Discharger shall maintain compliance with the following effluent limitations at Discharge Point D-001. Unless otherwise specified compliance shall be measured at Monitoring Location EFF-001, as described in the Monitoring and Reporting Program, Attachment E:

- a. The Discharger shall maintain compliance with the effluent limitations specified in Table 4:

Table 4. Effluent Limitations

Parameters	Units	Average Monthly	Average Weekly	Maximum Daily
4,4-DDE	micrograms per liter (µg/L)	0.00059	--	0.0012
Ammonia Nitrogen, Total (as N)	milligrams per liter (mg/L)	5.4	12	--
Biochemical Oxygen Demand, 5-day @ 20°Celcius (BOD ₅)	mg/L	10	15	--
BOD ₅	% Removal	85	--	--
Chlorodibromomethane	µg/L	8	--	17
Copper, Total Recoverable	µg/L	22	--	31
Cyanide	µg/L	40	--	77
Dichlorobromomethane	µg/L	22	--	42
Nitrate plus Nitrite (as N)	mg/L	40	65	--
Total Suspended Solids (TSS)	mg/L	10	15	--
TSS	% Removal	85	--	--
Zinc	µg/L	70	--	98

- b. **pH:**
 - i. 6.0 Standard Units (SU) as an instantaneous minimum.
 - ii. 8.5 SU as an instantaneous maximum.
- c. **Percent Removal.** The average monthly percent removal of BOD₅ and TSS shall not be less than 85 percent.
- d. **Chronic Whole Effluent Toxicity MDEL.** No *Ceriodaphnia dubia* (water flea) chronic aquatic toxicity test shall result in a “Fail” at the chronic Instream Waste Concentration (IWC) for the sub-lethal endpoint measured

in the test AND a percent effect for the survival endpoint greater than or equal to 50 percent.

- e. **Chronic Whole Effluent Toxicity MMEL.** No more than one *Ceriodaphnia dubia* (water flea) chronic aquatic toxicity test initiated in a toxicity calendar month shall result in a "Fail" at the chronic IWC for any endpoint.
- f. **Total Residual Chlorine.** Effluent total residual chlorine shall not exceed:
 - i. 0.011 mg/L, as a 4-day average; and
 - ii. 0.019 mg/L, as a 1-hour average.
- g. **Total Coliform Organisms.** Effluent total coliform organisms shall not exceed the following with compliance measured at Monitoring Location EFF-01 as described in the MRP, Attachment E:
 - i. 23 most probable number per 100 milliliters (MPN/100 mL, as a 7-day median; and
 - ii. 240 MPN/100mL, more than once in any 30-day period.
- h. **Diazinon and Chlorpyrifos.** Effluent diazinon and chlorpyrifos concentrations shall not exceed the sum of one (1.0) as identified below:
 - i. Average Monthly Effluent Limitation (AMEL)
$$\text{SAMEL} = \text{CD M-avg}/0.079 + \text{CC M-avg}/0.012 \leq 1.0$$

CD M-AVG = average monthly diazinon effluent concentration in $\mu\text{g/L}$.
CC M-AVG = average monthly chlorpyrifos effluent concentration in $\mu\text{g/L}$
 - ii. Average Weekly Effluent Limitation (AWEL)
$$\text{SAWEL} = \text{CD W-avg}/0.14 + \text{CC W-avg}/0.021 \leq 1.0$$

CD W-AVG = average weekly diazinon effluent concentration in $\mu\text{g/L}$.
CC W-AVG = average weekly chlorpyrifos effluent concentration in $\mu\text{g/L}$.

2. Interim Effluent Limitations – NOT APPLICABLE

B. Land Discharge Specifications – NOT APPLICABLE

C. Recycling Specifications – NOT APPLICABLE

V. RECEIVING WATER LIMITATIONS

A. Surface Water Limitations

The discharge shall not cause the following in Sacramento River:

1. **Bacteria.** The six-week rolling geometric mean of *Escherichia coli* (*E. coli*) to exceed 100 colony forming units (cfu) per 100 milliliters (mL), calculated weekly, and a statistical threshold value (STV) of 320 cfu/100 mL to be exceeded by more than 10 percent of the samples collected in a calendar month, calculated in a static manner.
2. **Biostimulatory Substances.** Water to contain biostimulatory substances which promote aquatic growths in concentrations that cause nuisance or adversely affect beneficial uses.
3. **Chemical Constituents.** Chemical constituents to be present in concentrations that adversely affect beneficial uses.
4. **Color.** Discoloration that causes nuisance or adversely affects beneficial uses.
5. **Dissolved Oxygen:**
 - a. The monthly median of the mean daily dissolved oxygen concentration to fall below 85 percent of saturation in the main water mass;
 - b. The 95-percentile dissolved oxygen concentration to fall below 75 percent of saturation; nor
 - c. The dissolved oxygen concentration to be reduced below 7.0 mg/L at any time.
 - d. From 1 June to 31 August: Concentrations of dissolved oxygen to fall below 9.0 mg/L. When natural conditions lower dissolved oxygen below this level, the concentration shall be maintained at or above the 95 percent saturation.
6. **Floating Material.** Floating material to be present in amounts that cause nuisance or adversely affect beneficial uses.
7. **Oil and Grease.** Oils, greases, waxes, or other materials to be present in concentrations that cause nuisance, result in a visible film or coating on the surface of the water or on objects in the water, or otherwise adversely affect beneficial uses.
8. **pH.** The pH to be depressed below 6.5 nor raised above 8.5.

9. **Pesticides:**

- a. Pesticides to be present, individually or in combination, in concentrations that adversely affect beneficial uses;
- b. Pesticides to be present in bottom sediments or aquatic life in concentrations that adversely affect beneficial uses;
- c. Total identifiable persistent chlorinated hydrocarbon pesticides to be present in the water column at concentrations detectable within the accuracy of analytical methods approved by U.S. EPA or the Executive Officer;
- d. Pesticide concentrations to exceed those allowable by applicable antidegradation policies (see State Water Board Resolution No. 68-16 and 40 CFR section 131.12.);
- e. Pesticide concentrations to exceed the lowest levels technically and economically achievable;
- f. Pesticides to be present in concentration in excess of the maximum contaminant levels (MCLs) set forth in CCR, Title 22, division 4, chapter 15; nor
- g. Thiobencarb to be present in excess of 1.0 µg/L. [

10. **Radioactivity:**

- a. Radionuclides to be present in concentrations that are harmful to human, plant, animal, or aquatic life nor that result in the accumulation of radionuclides in the food web to an extent that presents a hazard to human, plant, animal, or aquatic life; nor
- b. Radionuclides to be present in excess of the MCLs specified in Table 64442 of section 64442 and Table 64443 of section 64443 of Title 22 of the CCR.

11. **Salinity.** Electrical conductivity (at 25 °C) shall not exceed 230 micromhos/cm (50 percentile) or 235 micromhos/cm (90 percentile) in the Sacramento River at Knights Landing above Colusa Basin Drain or 240 micromhos/cm (50 percentile) or 340 micromhos/cm (90 percentile) at I Street Bridge, based upon previous 10 years of record.

12. **Suspended Sediments.** The suspended sediment load and suspended sediment discharge rate of surface waters to be altered in such a manner as to cause nuisance or adversely affect beneficial uses.

13. **Settleable Substances.** Substances to be present in concentrations that result in the deposition of material that causes nuisance or adversely affects beneficial uses.
14. **Suspended Material.** Suspended material to be present in concentrations that cause nuisance or adversely affect beneficial uses.
15. **Taste and Odors.** Taste- or odor-producing substances to be present in concentrations that impart undesirable tastes or odors to fish flesh or other edible products of aquatic origin, or that cause nuisance, or otherwise adversely affect beneficial uses.
16. **Temperature.** The natural temperature to be increased by more than 5° Fahrenheit. Compliance to be determined based on the difference in temperature at Monitoring Locations RSW-001 and RSW-002.
18. **Toxicity.** Toxic substances to be present, individually or in combination, in concentrations that produce detrimental physiological responses in human, plant, animal, or aquatic life.
19. **Turbidity.**
 - a. Shall not exceed 2 Nephelometric Turbidity Units (NTU) where natural turbidity is less than 1 NTU;
 - b. Shall not increase more than 1 NTU where natural turbidity is between 1 and 5 NTUs;
 - c. Shall not increase more than 20 percent where natural turbidity is between 5 and 50 NTUs;
 - d. Shall not increase more than 10 NTU where natural turbidity is between 50 and 100 NTUs; nor
 - e. Shall not increase more than 10 percent where natural turbidity is greater than 100 NTUs.

B. Groundwater Limitations

Release of waste constituents from any portion of the Facility shall not cause or contribute to groundwater containing constituent concentrations in excess of the concentrations specified below or in excess of background groundwater quality, whichever is greater:

1. The Primary or Secondary MCLs established in Title 22 of the California Code of Regulations, excluding salinity.

2. Taste or odor-producing constituents, toxic substances, or any other constituents in concentrations that cause nuisance or adversely affect any beneficial use.
3. A total coliform organism level of 2.2 MPN/100 mL over any seven-day period.

VI. PROVISIONS

A. Standard Provisions

1. The Discharger shall comply with all Standard Provisions included in Attachment D.
2. The Discharger shall comply with the following provisions. In the event that there is any conflict, duplication, or overlap between provisions specified by this Order, the more stringent provision shall apply:
 - a. If the Discharger's wastewater treatment plant is publicly owned or subject to regulation by California Public Utilities Commission, it shall be supervised and operated by persons possessing certificates of appropriate grade according to Title 23, CCR, division 3, chapter 26.
 - b. After notice and opportunity for a hearing, this Order may be terminated or modified for cause, including, but not limited to:
 - i. violation of any term or condition contained in this Order;
 - ii. obtaining this Order by misrepresentation or by failing to disclose fully all relevant facts;
 - iii. a change in any condition that requires either a temporary or permanent reduction or elimination of the authorized discharge; and
 - iv. a material change in the character, location, or volume of discharge.

The causes for modification include:

- (a). New regulations. New regulations have been promulgated under section 405(d) of the CWA, or the standards or regulations on which the permit was based have been changed by promulgation of amended standards or regulations or by judicial decision after the permit was issued.

- (b) Land application plans. When required by a permit condition to incorporate a land application plan for beneficial reuse of sewage sludge, to revise an existing land application plan, or to add a land application plan.
- (c) Change in sludge use or disposal practice. Under 40 CFR section 122.62(a)(1), a change in the Discharger's sludge use or disposal practice is a cause for modification of the permit. It is cause for revocation and reissuance if the Discharger requests or agrees.

The Central Valley Water Board may review and revise this Order at any time upon application of any affected person or the Central Valley Water Board's own motion.

- c. If a toxic effluent standard or prohibition (including any scheduled compliance specified in such effluent standard or prohibition) is established under section 307(a) of the CWA, or amendments thereto, for a toxic pollutant that is present in the discharge authorized herein, and such standard or prohibition is more stringent than any limitation upon such pollutant in this Order, the Central Valley Water Board will revise or modify this Order in accordance with such toxic effluent standard or prohibition.

The Discharger shall comply with effluent standards and prohibitions within the time provided in the regulations that establish those standards or prohibitions, even if this Order has not yet been modified.

- d. This Order shall be modified, or alternately revoked and reissued, to comply with any applicable effluent standard or limitation issued or approved under sections 301(b)(2)(C) and (D), 304(b)(2), and 307(a)(2) of the CWA, if the effluent standard or limitation so issued or approved:
 - i. Contains different conditions or is otherwise more stringent than any effluent limitation in the Order; or
 - ii. Controls any pollutant limited in the Order.

The Order, as modified or reissued under this paragraph, shall also contain any other requirements of the CWA then applicable.

- e. The provisions of this Order are severable. If any provision of this Order is found invalid, the remainder of this Order shall not be affected.
- f. The Discharger shall take all reasonable steps to minimize any adverse effects to waters of the State or users of those waters resulting from any discharge or sludge use or disposal in violation of this Order. Reasonable steps shall include such accelerated or additional monitoring as necessary

to determine the nature and impact of the non-complying discharge or sludge use or disposal.

- g. The Discharger shall ensure compliance with any existing or future pretreatment standard promulgated by U.S. EPA under section 307 of the CWA, or amendment thereto, for any discharge to the municipal system.
- h. A copy of this Order shall be maintained at the discharge facility and be available at all times to operating personnel. Key operating personnel shall be familiar with its content.
- i. Safeguard to electric power failure:
 - i. The Discharger shall provide safeguards to assure that, should there be reduction, loss, or failure of electric power, the discharge shall comply with the terms and conditions of this Order.
 - ii. Upon written request by the Central Valley Water Board, the Discharger shall submit a written description of safeguards. Such safeguards may include alternate power sources, standby generators, retention capacity, operating procedures, or other means. A description of the safeguards provided shall include an analysis of the frequency, duration, and impact of power failures experienced over the past 5 years on effluent quality and on the capability of the Discharger to comply with the terms and conditions of the Order. The adequacy of the safeguards is subject to the approval of the Central Valley Water Board.
 - iii. Should the treatment works not include safeguards against reduction, loss, or failure of electric power, or should the Central Valley Water Board not approve the existing safeguards, the Discharger shall, within 90 days of having been advised in writing by the Central Valley Water Board that the existing safeguards are inadequate, provide to the Central Valley Water Board and U.S. EPA a schedule of compliance for providing safeguards such that in the event of reduction, loss, or failure of electric power, the Discharger shall comply with the terms and conditions of this Order. The schedule of compliance shall, upon approval of the Central Valley Water Board, become a condition of this Order.
- j. The Discharger, upon written request of the Central Valley Water Board, shall file with the Board a technical report on its preventive (failsafe) and contingency (cleanup) plans for controlling accidental discharges, and for minimizing the effect of such events. This report may be combined with that required under the Central Valley Water Board Standard Provision contained in section VI.A.2.i of this Order.

The technical report shall:

- i. Identify the possible sources of spills, leaks, untreated waste by-pass, and contaminated drainage. Loading and storage areas, power outage, waste treatment unit outage, and failure of process equipment, tanks and pipes should be considered.
- ii. Evaluate the effectiveness of present facilities and procedures and state when they became operational.
- iii. Predict the effectiveness of the proposed facilities and procedures and provide an implementation schedule containing interim and final dates when they will be constructed, implemented, or operational.

The Central Valley Water Board, after review of the technical report, may establish conditions which it deems necessary to control accidental discharges and to minimize the effects of such events. Such conditions shall be incorporated as part of this Order, upon notice to the Discharger.

- k. A publicly owned treatment works whose waste flow has been increasing, or is projected to increase, shall estimate when flows will reach hydraulic and treatment capacities of its treatment and disposal facilities. The projections shall be made in January, based on the last 3 years' average dry weather flows, peak wet weather flows and total annual flows, as appropriate. When any projection shows that capacity of any part of the facilities may be exceeded in 4 years, the Discharger shall notify the Central Valley Water Board by 31 January. A copy of the notification shall be sent to appropriate local elected officials, local permitting agencies and the press. Within 120 days of the notification, the Discharger shall submit a technical report showing how it will prevent flow volumes from exceeding capacity or how it will increase capacity to handle the larger flows. The Central Valley Water Board may extend the time for submitting the report.
- l. The Discharger shall submit technical reports as directed by the Executive Officer. All technical reports required herein that involve planning, investigation, evaluation, or design, or other work requiring interpretation and proper application of engineering or geologic sciences, shall be prepared by or under the direction of persons registered to practice in California pursuant to California Business and Professions Code, sections 6735, 7835, and 7835.1. To demonstrate compliance with Title 16, CCR, sections 415 and 3065, all technical reports must contain a statement of the qualifications of the responsible registered professional(s). As required by these laws, completed technical reports must bear the signature(s) and seal(s) of the registered professional(s) in a manner such that all work can be clearly attributed to the professional responsible for the work.

- m. The Central Valley Water Board is authorized to enforce the terms of this permit under several provisions of the Water Code, including, but not limited to, sections 13385, 13386, and 13387.
- n. In the event of any change in control or ownership of land or waste discharge facilities presently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order by letter, a copy of which shall be immediately forwarded to the Central Valley Water Board.
- o. This Order may be reopened to transfer ownership of control of this Order. The succeeding owner or operator must apply in writing requesting transfer of the Order. The request must contain the requesting entity's full legal name, the state of incorporation if a corporation, address and telephone number of the persons responsible for contact with the Central Valley Water Board, and a statement. The statement shall comply with the signatory and certification requirements in the federal Standard Provisions (Attachment D, section V.B) and state that the new owner or operator assumes full responsibility for compliance with this Order.
- p. If the Discharger submits a timely and complete ROWD for permit reissuance, this permit shall continue in force and effect until the permit is reissued or the Regional Water Board rescinds the permit.
- q. Failure to comply with provisions or requirements of this Order, or violation of other applicable laws or regulations governing discharges from this facility, may subject the Discharger to administrative or civil liabilities, criminal penalties, and/or other enforcement remedies to ensure compliance. Additionally, certain violations may subject the Discharger to civil or criminal enforcement from appropriate local, state, or federal law enforcement entities.
- r. In the event the Discharger does not comply or will be unable to comply for any reason, with any prohibition, effluent limitation, or receiving water limitation, or receiving water limitation of this Order, the Discharger shall notify the Central Valley Water Board by telephone (530) 224-4845 within 24 hours of having knowledge of such noncompliance, and shall confirm this notification in writing within five days, unless the Central Valley Water Board waives confirmation. The written notification shall state the nature, time, duration, and cause of noncompliance, and shall describe the measures being taken to remedy the current noncompliance and prevent recurrence including, where applicable, a schedule of implementation. Other noncompliance requires written notification as above at the time of the normal monitoring report.

B. Monitoring and Reporting Program (MRP) Requirements

The Discharger shall comply with the MRP, and future revisions thereto, in Attachment E.

C. Special Provisions

1. Reopener Provisions

- a. Conditions that necessitate a major modification of a permit are described in 40 CFR section 122.62, including, but not limited to:
 - i. If new or amended applicable water quality standards are promulgated or approved pursuant to section 303 of the CWA, or amendments thereto, this permit may be reopened and modified in accordance with the new or amended standards.
 - ii. When new information, that was not available at the time of permit issuance, would have justified different permit conditions at the time of issuance.
- b. This Order may be reopened for modification, or revocation and reissuance, as a result of the detection of a reportable priority pollutant generated by special conditions included in this Order. These special conditions may be, but are not limited to, fish tissue sampling, whole effluent toxicity, monitoring requirements on internal waste stream(s), and monitoring for surrogate parameters. Additional requirements may be included in this Order as a result of the special condition monitoring data.
- c. **Mercury.** If mercury is found to be causing toxicity based on acute or chronic toxicity test results, or if a TMDL program is adopted, this Order shall be reopened, and the mass effluent limitation modified (higher or lower) or an effluent concentration limitation imposed. If the Central Valley Water Board determines that a mercury offset program is feasible for Dischargers subject to a NPDES permit, then this Order may be reopened to reevaluate the mercury mass loading limitation(s) and the need for a mercury offset program for the Discharger.
- d. **Water Effects Ratios (WER) and Metal Translators.** A default WER of 1.0 has been used in this Order for calculating criteria for applicable inorganic constituents. In addition, site-specific dissolved-to-total metal translators have been used to convert water quality objectives from dissolved to total when developing effluent limitations for copper and zinc. If the Discharger performs studies to determine site-specific WERs and/or update the site-specific dissolved-to-total metal translators, this Order may be reopened to modify the effluent limitations for the applicable inorganic constituents.

- e. **Central Valley Salinity Alternatives for Long-Term Sustainability (CV-SALTS).** On 17 January 2020, certain Basin Plan Amendments to incorporate new strategies for addressing ongoing salt and nitrate accumulation in the Central Valley became effective. Other provisions subject to U.S. EPA approval became effective on 2 November 2020, when approved by U.S. EPA. As the Central Valley Water Board moves forward to implement those provisions that are now in effect, this Order may be amended or modified to incorporate new or modified requirements necessary for implementation of the Basin Plan Amendments. More information regarding these Amendments can be found on the [Central Valley Salinity Alternatives for Long-Term Sustainability \(CV-SALTS\)](https://www.waterboards.ca.gov/centralvalley/water_issues/salinity/) web page:
(https://www.waterboards.ca.gov/centralvalley/water_issues/salinity/)

2. **Special Studies, Technical Reports and Additional Monitoring Requirements.**

- a. **Toxicity Reduction Evaluation (TRE) Requirements.**

TRE: The Discharger is required to initiate a TRE, as detailed in the Monitoring and Reporting Program (Attachment E, Section V.F), when any combination of two or more MDEL or MMEL exceedances occur within a single toxicity calendar month or within two successive toxicity calendar months. In addition, if other information indicates toxicity (e.g., results of additional monitoring, results of monitoring at a higher concentration than the IWC, fish kills, intermittent recurring toxicity) or if there is no effluent available to complete a routine monitoring test or MMEL compliance test, the Executive Officer may require a TRE

3. **Best Management Practices and Pollution Prevention**

- a. **Salinity Evaluation and Minimization Plan (SEMP).** The Discharger shall continue to implement a SEMP to identify and address sources of salinity discharged from the Facility. The plan shall be completed and submitted to the Central Valley Water Board by the due date in the Technical Reports Table E-11.

The Discharger submitted a Notice of Intent to comply with the Salt Control Program and selected the Alternative Permitting Approach. Accordingly, the Discharger shall participate in the CV-SALTS Prioritization and Optimization (P&O) Study. Furthermore, an evaluation of the effectiveness of the SEMP shall be submitted with the ROWD. The evaluation shall include, at minimum, the calendar annual average concentrations of effluent electrical conductivity during the term of the Order. If the average electrical conductivity concentration for any calendar year exceeds a performance-based **trigger of 520 µmhos/cm**, the Discharger shall evaluate possible sources of salinity contributing to the

exceedance of the trigger and update the SEMP to include a plan of action to control salinity.

- b. **Pyrethroid Management Plan.** If the Pyrethroid Pesticides Water Column Chemistry Monitoring results in an exceedance of any acute and/or chronic pyrethroid numeric trigger in Table 4-2 of the Basin Plan to water bodies with designated or existing WARM and/or COLD beneficial uses, the Discharger shall develop and submit a Pyrethroid Management Plan to the Central Valley Water Board, per the requirements described in section 4.2.2.4.12 of the Basin Plan, within one year from the date that an exceedance is identified by either the Discharger or Central Valley Water Board staff. The Discharger shall review monitoring results quarterly and the Discharger shall notify the Central Valley Water Board of any exceedances of the Pyrethroid numeric triggers as soon as possible. If an exceedance is identified, the Discharger shall notify the Central Valley Water Board in writing of the exceedance and the Discharger's intent to submit a Pyrethroid Management Plan.

The Pyrethroid Management Plan shall identify management practices to reduce discharges of pyrethroid pesticides, as outlined in section 4.5.5.2.2.3 of the Basin Plan, and to consider whether there are potential water quality concerns with replacement insecticide products. Dischargers shall begin implementing their pyrethroid management plans within 30 days after receipt of written approval of their management plan. The Pyrethroid Management Plan shall be deemed complete when it can be demonstrated that the acute and chronic pyrethroids triggers are not exceeded in the final effluent and the demonstration is approved by the Executive Officer.

If a Pyrethroid Management Plan is required, the Discharger shall provide mid-term and/or end-term progress reports, to document the management practices that have been implemented to track the effectiveness of the Pyrethroid Management Plan.

4. Construction, Operation and Maintenance Specifications

- a. Emergency Storage Pond, Sludge Stabilization Ponds, and Sludge Drying Beds Operating Requirements
 - i. The treatment facilities and emergency storage ponds shall be designed, constructed, operated, and maintained to prevent inundation or washout due to floods with a 100-year return frequency.
 - ii. Public contact with wastewater shall be precluded through such means as fences, signs, and other acceptable alternatives.
 - iii. Ponds shall be managed to prevent breeding of mosquitoes. In particular,

- (a) An erosion control program should assure that small coves and irregularities are not created around the perimeter of the water surface.
 - (b) Weeds shall be minimized.
 - (c) Dead algae, vegetation, and debris shall not accumulate on the water surface.
 - iv. Freeboard shall never be less than 2 feet (measured vertically to the lowest point of overflow).
 - v. Ponds shall have sufficient capacity to accommodate allowable wastewater flow and design seasonal precipitation and ancillary inflow and infiltration during the non-irrigation season. Design seasonal precipitation shall be based on total annual precipitation using a return period of 100 years, distributed monthly in accordance with historical rainfall patterns. Freeboard shall never be less than 2 feet (measured vertically to the lowest point of overflow).
 - vi. Prior to the onset of the rainy season of each year, available pond storage capacity shall at least equal the volume necessary to comply with the specification at subsection v., above.
 - vii. The discharge of waste classified as “hazardous” as defined in section 2521(a) of Title 23, California Code of Regulations (CCR), or “designated”, as defined in section 13173 of the Water Code, to the **Facility’s treatment and storage facilities, including the sludge drying beds**, is prohibited.
 - viii. Objectionable odors originating at this Facility shall not be perceivable beyond the limits of the wastewater treatment and disposal areas (or property by the Discharger).
 - ix. As means of discerning compliance with item viii. above, the dissolved oxygen content in the upper zone (1 foot) of wastewater in ponds shall not be less than 1.0 mg/L.
 - x. The emergency storage pond shall not have a pH less than 6.5 or greater than 8.5 for periods of greater than 72 hours.
- b. The Discharger shall regularly inspect the condition of the constructed pond surfaces (e.g., sludge stabilization ponds, ballast pond) and sludge drying beds to ensure the integrity of the concrete and asphalt lined structure and prevent infiltration of waste constituents into soils in a mass or concentration that will violate groundwater limitations in section V.B. of this Order. The Discharger shall maintain and repair the ponds and storage facilities as necessary to ensure the integrity of the ponds and

drying beds are maintained and leakage from the units is minimized. Necessary repairs shall be completed in reasonable timeframes that are consistent with the severity of the impairment and potential for impact to water quality.

5. Special Provisions for Publicly-Owned Treatment Works (POTWs)

a. Pretreatment Requirements – Not Applicable

b. Sludge/Biosolids Treatment or Discharge Specifications. Sludge in this document means the solid, semisolid, and liquid residues removed during primary, secondary, or advanced wastewater treatment processes. Solid waste refers to grit and screening material generated during preliminary treatment. Residual sludge means sludge that will not be subject to further treatment at the wastewater treatment plant. Biosolids refer to sludge that has been treated and tested and shown to be capable of being beneficially and legally used pursuant to federal and state regulations as a soil amendment for agricultural, silvicultural, horticultural, and land reclamation activities as specified under 40 C.F.R. Part 503.

i. Collected screenings, residual sludge, biosolids, and other solids removed from liquid wastes shall be disposed of in a manner consistent with Consolidated Regulations for Treatment, Storage, Processing, or Disposal of Solid Waste, as set forth in Title 27, CCR, division 2, subdivision 1, section 20005, et seq. Removal for further treatment, storage, disposal, or reuse at sites (e.g., landfill, composting sites, soil amendment sites) that are operated in accordance with valid waste discharge requirements issued by a Regional Water Board will satisfy these specifications.

Sludge and solid waste shall be removed from screens, sumps, ponds, clarifiers, etc. as needed to ensure optimal plant performance.

The treatment of sludge generated at the Facility shall be confined to the Facility property and conducted in a manner that precludes infiltration of waste constituents into soils in a mass or concentration that will violate groundwater limitations in section V.B. of this Order. In addition, the storage of residual sludge, solid waste, and biosolids on Facility property shall be temporary and controlled, and contained in a manner that minimizes leachate formation and precludes infiltration of waste constituents into soils in a mass or concentration that will violate groundwater limitations included in section V.B. of this Order.

ii. The use, disposal, storage, and transportation of biosolids shall comply with existing federal and state laws and regulations, including permitting requirements and technical standards included in 40 C.F.R. Part 503. If the State Water Board and the Central Valley

Water Board are given the authority to implement regulations contained in 40 C.F.R. Part 503, this Order may be reopened to incorporate appropriate time schedules and technical standards. The Discharger must comply with the standards and time schedules contained in 40 C.F.R. Part 503 whether or not they have been incorporated into this Order.

- iii. The Discharger shall implement onsite sludge/biosolids treatment, processing, and storage for the Facility as described in the Fact Sheet (Attachment F, section II.A). This Order may be reopened to address any proposed change in the onsite treatment, processing, or storage of sludge/biosolids.
- c. **Sludge/Biosolids Management Plan.** The Discharger shall submit a Sludge/Biosolids Management Plan according to the schedule in Technical Reports Table E-11, that shall describe at a minimum:
- i. Sources and amounts of sludge/biosolids generated annually.
 - ii. Location(s) of on-site storage and description of the containment area.
 - iii. Plans for ultimate disposal. For landfill disposal, include the present classification, name, and location of landfill.

6. Other Special Provisions

- a. All storm water shall be directed to the 3.8 million gallon emergency storage pond, where it may be routed to the headworks, or left to percolate or evaporate. Any change in storm water discharge location is subject to the requirements of the State Water Board General Industrial Storm Water Permit.

7. Compliance Schedules – Not Applicable

VII. COMPLIANCE DETERMINATION

- A. **BOD₅ and TSS Effluent Limitations (sections IV.A.1.a and IV.A.1.c).**
Compliance with the final effluent limitations for BOD₅ and TSS required in Waste Discharge Requirements section IV.A.1.a shall be ascertained by 24-hour composite samples. Compliance with effluent limitations required in Waste Discharge Requirements section IV.A.1.c for percent removal shall be calculated using the arithmetic mean of BOD₅ and TSS in effluent samples collected over a monthly period as a percentage of the arithmetic mean of the values for influent samples collected at approximately the same times during the same period.

B. Average Dry Weather Flow Prohibition (section III.E).

The average dry weather discharge flow represents the daily average flow when groundwater is at or near normal and runoff is not occurring. Compliance with the average dry weather flow discharge prohibition will be determined annually based on the average daily flow over three consecutive dry weather months (e.g., July, August, and September).

C. Total Coliform Organisms Effluent Limitations (section IV.A.1.g).

For each day that an effluent sample is collected and analyzed for total coliform organisms, the 7-day median shall be determined by calculating the median concentration of total coliform bacteria in the effluent utilizing the bacteriological results of the last 7 days. For example, if a sample is collected on a Wednesday, the result from that sampling event and all results from the previous 6 days (i.e., Tuesday, Monday, Sunday, Saturday, Friday, and Thursday) are used to calculate the 7-day median. If the 7-day median of total coliform organisms exceeds a most probable number (MPN) of 23 per 100 milliliters, the Discharger will be considered out of compliance.

D. Instantaneous Maximum Effluent Limitation for pH (section IV.A.1.b).

If the analytical result of a single grab sample is lower than the instantaneous minimum effluent limitation for a parameter, the Discharger will be considered out of compliance for that parameter for that single sample. Non-compliance for each sample will be considered separately (e.g., the results of two grab samples taken within a calendar day that both are lower than the instantaneous minimum effluent limitation would result in two instances of non-compliance with the instantaneous minimum effluent limitation). If pH is monitored continuously, the Discharger shall be in compliance with pH limitations provided that the total excursion time does not exceed 20 minutes within a calendar day. For the purpose of establishing a pH excursion, a 20-minute running average may be used (measured continuously at no greater than 5 second intervals).

E. Total Residual Chlorine Effluent Limitations (section IV.A.1.f).

Continuous monitoring analyzers for chlorine residual or for dechlorination agent residual in the effluent are appropriate methods for compliance determination. A positive residual dechlorination agent in the effluent indicates that chlorine is not present in the discharge, which demonstrates compliance with the effluent limitations. This type of monitoring can also be used to prove that some chlorine residual exceedances are false positives. Continuous monitoring data showing either a positive dechlorination agent residual or a chlorine residual at or below the prescribed limit are sufficient to show compliance with the total residual chlorine effluent limitations, as long as the instruments are maintained and calibrated in accordance with the manufacturer's recommendations.

Any excursion above the 1-hour average or 4-day average total residual chlorine effluent limitations is a violation. If the Discharger conducts continuous monitoring and the Discharger can demonstrate, through data collected from a back-up monitoring system, that a chlorine spike recorded by the continuous monitor was not

actually due to chlorine, then any excursion resulting from the recorded spike will not be considered an exceedance, but rather reported as a false positive. Records supporting validation of false positives shall be maintained in accordance with Section IV Standard Provisions (Attachment D).

F. Priority Pollutant Effluent Limitations.

Compliance with effluent limitations for priority pollutants shall be determined in accordance with section 2.4.5 of the SIP, as follows:

1. Dischargers shall be deemed out of compliance with an effluent limitation, if the concentration of the priority pollutant in the monitoring sample is greater than the effluent limitation and greater than or equal to the reporting level (RL).
2. Dischargers shall be required to conduct a Pollutant Minimization Program (PMP) in accordance with section 2.4.5.1 of the SIP when there is evidence that the priority pollutant is present in the effluent above an effluent limitation and either:
 - a. sample result is reported as detected, but not quantified (DNQ) and the effluent limitation is less than the RL; or
 - b. sample result is reported as non-detect (ND) and the effluent limitation is less than the method detection limit (MDL).
3. When determining compliance with an average monthly effluent limitation (AMEL) and more than one sample result is available in a month, the discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of DNQ or ND. In those cases, the discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
 - a. The data set shall be ranked from low to high, reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
 - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.
4. If a sample result, or the arithmetic mean or median of multiple sample results, is below the RL, and there is evidence that the priority pollutant is present in the effluent above an effluent limitation and the discharger conducts a PMP (as described in section 2.4.5.1), the discharger shall **not** be deemed out of compliance.

G. Dissolved Oxygen Receiving Water Limitation (section V.A.5.a-d).

Weekly receiving water monitoring is required in the Monitoring and Reporting Program (Attachment E) and is sufficient to evaluate the impacts of the discharge and compliance with this Order. Weekly receiving water monitoring data, measured at monitoring locations RSW-001 and RSW-002, will be used to determine compliance with part “c” of the dissolved oxygen receiving water limitation to ensure the discharge does not cause the dissolved oxygen concentrations in the Sacramento River to be reduced below 7.0 mg/L at any time. However, should more frequent dissolved oxygen and temperature receiving water monitoring be conducted, Central Valley Water Board staff may evaluate compliance with parts “a” and “b”.

H. Whole Effluent Toxicity Effluent Limitations.

The discharge is subject to determination of “Pass” or “Fail” from chronic whole effluent toxicity tests using the Test of Significant Toxicity (TST) statistical t-test approach described in *National Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document* (EPA 833-R-10-003, 2010), Appendix A, Figure A-1 and Table A-1 (Chronic Freshwater and East Coast Methods) and Appendix B, Table B-1.

The null hypothesis (Ho) for the TST statistical approach is:

Mean discharge Instream Waste Concentration (IWC) response \leq Regulatory Management Decision (RMD) x Mean control response, where the chronic RMD = 0.75 and the acute RMD = 0.80.

A test result that rejects this null hypothesis is reported as “Pass.” A test result that does not reject this null hypothesis is reported as “Fail.”

The relative “Percent Effect” at the discharge IWC is defined and reported as:

Percent Effect = ((Mean control response – Mean discharge IWC response) / Mean control response) x 100.

This is a t-test (formally Student’s t-Test), a statistical analysis comparing two sets of replicate observations, i.e., a control and IWC. The purpose of this statistical test is to determine if the means of the two sets of observations are different (i.e., if the IWC differs from the control, the test result is “Pass” or “Fail”). The Welch’s t-test employed by the TST statistical approach is an adaptation of Student’s t-test and is used with two samples having unequal variances.

1. **Chronic Whole Effluent Toxicity MDEL (section IV.A.1.d).** If the result of a routine chronic whole effluent toxicity test, using the TST statistical approach, is a “Fail” at the IWC for the sublethal endpoint measured in the test and the percent effect for the sublethal endpoint is greater than or equal to 50 percent, the Discharger will be deemed out of compliance with the MDEL.

2. **Chronic Whole Effluent Toxicity MMEL (section IV.A.1.e).** If the result of a routine chronic whole effluent toxicity test, using the TST statistical approach, is a “Fail” at the IWC, the Discharger shall conduct a maximum of two additional MMEL compliance tests during the calendar month. If one of the additional MMEL compliance test results in a “Fail” at the IWC, the Discharger will be deemed out of compliance with the MMEL.

ATTACHMENT A – DEFINITIONS

1Q10

The lowest one-day flow with an average reoccurrence frequency of once in ten years.

7Q10

The lowest average seven consecutive day flow with an average reoccurrence frequency of once in ten years.

Acute Aquatic Toxicity Test

A test to determine an adverse effect (usually lethality) on a group of aquatic test organisms during a short-term exposure (e.g., 24, 48, or 96 hours).

Alternative Hypothesis

A statement used to propose a statistically significant relationship in a set of given observations. Under the TST approach, when the Null Hypothesis is rejected, the Alternative Hypothesis is accepted in its place, indicating a relationship between variables and an acceptable level of toxicity.

Arithmetic Mean (μ)

Also called the average, is the sum of measured values divided by the number of samples. For ambient water concentrations, the arithmetic mean is calculated as follows:

$$\text{Arithmetic mean} = \mu = \Sigma x / n$$

where: Σx is the sum of the measured ambient water concentrations, and n is the number of samples.

Average Monthly Effluent Limitation (AMEL)

The highest allowable average of daily discharges over a calendar month, calculated as the sum of all daily discharges measured during a calendar month divided by the number of daily discharges measured during that month.

Average Weekly Effluent Limitation (AWEL)

The highest allowable average of daily discharges over a calendar week (Sunday through Saturday), calculated as the sum of all daily discharges measured during a calendar week divided by the number of daily discharges measured during that week.

Bioaccumulative

Those substances taken up by an organism from its surrounding medium through gill membranes, epithelial tissue, or from food and subsequently concentrated and retained in the body of the organism.

Calendar Month

A period of time from of the first of a month to the last day of the month (e.g., from January 1 to January 31, from April 1 to April 30, or from December 1 to December 31)..

Calendar Quarter

A period of time defined as three consecutive calendar months (e.g., from January 1 to March 31, from April 1 to June 30, or from October 1 to December 31).

Calendar Year

A period of time defined as twelve consecutive calendar months (i.e., January 1 to December 31).

Chronic Aquatic Toxicity Test

A test to determine an adverse effect (sub-lethal or lethal) on a group of aquatic test organisms during an exposure of duration long enough to assess sub-lethal effects.

Carcinogenic

Pollutants are substances that are known to cause cancer in living organisms.

Coefficient of Variation (CV)

CV is a measure of the data variability and is calculated as the estimated standard deviation divided by the arithmetic mean of the observed values.

Daily Discharge

Daily Discharge is defined as either: (1) the total mass of the constituent discharged over the calendar day (12:00 am through 11:59 pm) or any 24-hour period that reasonably represents a calendar day for purposes of sampling (as specified in the permit), for a constituent with limitations expressed in units of mass or; (2) the unweighted arithmetic mean measurement of the constituent over the day for a constituent with limitations expressed in other units of measurement (e.g., concentration).

The daily discharge may be determined by the analytical results of a composite sample taken over the course of one day (a calendar day or other 24-hour period defined as a day) or by the arithmetic mean of analytical results from one or more grab samples taken over the course of the day.

For composite sampling, if 1 day is defined as a 24-hour period other than a calendar day, the analytical result for the 24-hour period will be considered as the result for the calendar day in which the 24-hour period ends.

Detected, but Not Quantified (DNQ)

DNQ are those sample results less than the RL, but greater than or equal to the laboratory's MDL. Sample results reported as DNQ are estimated concentrations.

Dilution Credit

Dilution Credit is the amount of dilution granted to a discharge in the calculation of a water quality-based effluent limitation, based on the allowance of a specified mixing zone. It is calculated from the dilution ratio or determined through conducting a mixing zone study or modeling of the discharge and receiving water.

Effluent Concentration Allowance (ECA)

ECA is a value derived from the water quality criterion/objective, dilution credit, and ambient background concentration that is used, in conjunction with the coefficient of variation for the effluent monitoring data, to calculate a long-term average (LTA) discharge concentration. The ECA has the same meaning as waste load allocation (WLA) as used in U.S. EPA guidance (Technical Support Document For Water Quality-based Toxics Control, March 1991, second printing, EPA/505/2-90-001).

Enclosed Bays

Enclosed Bays means indentations along the coast that enclose an area of oceanic water within distinct headlands or harbor works. Enclosed bays include all bays where the narrowest distance between the headlands or outermost harbor works is less than 75 percent of the greatest dimension of the enclosed portion of the bay. Enclosed bays include, but are not limited to, Humboldt Bay, Bodega Harbor, Tomales Bay, Drake's Estero, San Francisco Bay, Morro Bay, Los Angeles-Long Beach Harbor, Upper and Lower Newport Bay, Mission Bay, and San Diego Bay. Enclosed bays do not include inland surface waters or ocean waters.

Endpoint

An effect that is measured in a toxicity study. Endpoints in toxicity tests may include, but are not limited to survival, reproduction, and growth. A measured response of a receptor to a stressor. An endpoint can be measured in a toxicity test or field survey.

Estimated Chemical Concentration

The estimated chemical concentration that results from the confirmed detection of the substance by the analytical method below the ML value.

Estuaries

Estuaries means waters, including coastal lagoons, located at the mouths of streams that serve as areas of mixing for fresh and ocean waters. Coastal lagoons and mouths of streams that are temporarily separated from the ocean by sandbars shall be considered estuaries. Estuarine waters shall be considered to extend from a bay or the open ocean to a point upstream where there is no significant mixing of fresh water and seawater. Estuarine waters included, but are not limited to, the Sacramento-San Joaquin Delta, as defined in Water Code section 12220, Suisun Bay, Carquinez Strait downstream to the Carquinez Bridge, and appropriate areas of the Smith, Mad, Eel, Noyo, Russian, Klamath, San Diego, and Otay rivers. Estuaries do not include inland surface waters or ocean waters.

Inland Surface Waters

All surface waters of the state that do not include the ocean, enclosed bays, or estuaries.

Instantaneous Maximum Effluent Limitation

The highest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous maximum limitation).

Instantaneous Minimum Effluent Limitation

The lowest allowable value for any single grab sample or aliquot (i.e., each grab sample or aliquot is independently compared to the instantaneous minimum limitation).

Instream Waste Concentration (IWC)

The concentration of effluent in the receiving water after mixing.

Maximum Daily Effluent Limitation (MDEL)

The highest allowable daily discharge of a pollutant, over a calendar day (or 24-hour period). For pollutants with limitations expressed in units of mass, the daily discharge is calculated as the total mass of the pollutant discharged over the day. For pollutants with limitations expressed in other units of measurement, the daily discharge is calculated as the arithmetic mean measurement of the pollutant over the day.

Median

The middle measurement in a set of data. The median of a set of data is found by first arranging the measurements in order of magnitude (either increasing or decreasing order). If the number of measurements (n) is odd, then the median = $X_{(n+1)/2}$. If n is even, then the median = $(X_{n/2} + X_{(n/2)+1})/2$ (i.e., the midpoint between the n/2 and n/2+1).

Method Detection Limit (MDL)

MDL is the minimum measured concentration of a substance that can be reported with 99 percent confidence that the measured concentration is distinguishable from method blank results, as defined in in 40 C.F.R. Part 136, Attachment B.

Minimum Level (ML)

ML is the concentration at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method specified sample weights, volumes, and processing steps have been followed.

Mixing Zone

Mixing Zone is a limited volume of receiving water that is allocated for mixing with a wastewater discharge where water quality criteria can be exceeded without causing adverse effects to the overall water body.

Not Detected (ND)

Sample results which are less than the laboratory's MDL.

Null Hypothesis

A statement used in statistical testing that has been put forward either because it is believed to be true or because it is to be used as a basis for argument, but has not been proved.

Ocean Waters

The territorial marine waters of the State as defined by California law to the extent these waters are outside of enclosed bays, estuaries, and coastal lagoons. Discharges to ocean waters are regulated in accordance with the State Water Board's California Ocean Plan.

Percent Effect

The percent effect at the instream waste concentration (IWC) shall be calculated using untransformed data and the following equation:

$$\text{Percent Effect of the Sample} = \frac{\text{Mean Control Response} - \text{Mean Sample Response}}{\text{Mean Control Response}} \cdot 100$$

Persistent Pollutants

Persistent pollutants are substances for which degradation or decomposition in the environment is nonexistent or very slow.

Pollutant Minimization Program (PMP)

PMP means waste minimization and pollution prevention actions that include, but are not limited to, product substitution, waste stream recycling, alternative waste management methods, and education of the public and businesses. The goal of the PMP shall be to reduce all potential sources of a priority pollutant(s) through pollutant minimization (control) strategies, including pollution prevention measures as appropriate, to maintain the effluent concentration at or below the water quality-based effluent limitation. Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The Central Valley Water Board may consider cost effectiveness when establishing the requirements of a PMP. The completion and implementation of a Pollution Prevention Plan, if required pursuant to Water Code section 13263.3(d), shall be considered to fulfill the PMP requirements.

Pollution Prevention

Pollution Prevention means any action that causes a net reduction in the use or generation of a hazardous substance or other pollutant that is discharged into water and includes, but is not limited to, input change, operational improvement, production process change, and product reformulation (as defined in Water Code section 13263.3). Pollution prevention does not include actions that merely shift a pollutant in wastewater from one environmental medium to another environmental medium, unless clear environmental benefits of such an approach are identified to the satisfaction of the State Water Resources Control Board (State Water Board) or Central Valley Water Board.

Regulatory Management Decision (RMD)

The decision that represents the maximum allowable error rates and thresholds for toxicity and non-toxicity that would result in an acceptable risk to aquatic life.

Response

A measured biological effect (e.g., survival, reproduction, growth) as a result of exposure to a stimulus.

Satellite Collection System

The portion, if any, of a sanitary sewer system owned or operated by a different public agency than the agency that owns and operates the wastewater treatment facility that a sanitary sewer system is tributary to.

Source of Drinking Water

Any water designated as municipal or domestic supply (MUN) in a Central Valley Water Board Basin Plan.

Species Sensitivity Screening

An analysis to determine the single most sensitive species from an array of test species to be used in a single species laboratory test series.

Standard Deviation (σ)

Standard Deviation is a measure of variability that is calculated as follows:

$$\sigma = (\sum [(x - \mu)^2] / (n - 1))^{0.5}$$

where:

x is the observed value;

μ is the arithmetic mean of the observed values; and

n is the number of samples.

Statewide Toxicity Provisions

Refers to section III.B and section IV.B of the Water Quality Control Plan for Inland Surface Waters, Enclosed Bays, and Estuaries of California.

Statistical Threshold Value (STV)

The STV for the bacteria receiving water limitation is a set value that approximates the 90th percentile of the water quality distribution of a bacterial population.

Test of Significant Toxicity (TST)

A statistical approach used to analyze aquatic toxicity test data, as described in *National Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document* (EPA 833-R-10-003, 2010), Appendix A, Figure A-1 and Table A-1 (Chronic Freshwater and East Coast Methods) and Appendix B, Table B-1.

Toxicity Reduction Evaluation (TRE)

TRE is a study conducted in a stepwise process designed to identify the causative agents of effluent or ambient toxicity, isolate the sources of toxicity, evaluate the effectiveness of toxicity control options, and then confirm the reduction in toxicity. The first steps of the TRE consist of the collection of data relevant to the toxicity, including additional toxicity testing, and an evaluation of facility operations and maintenance practices, and best management practices. A Toxicity Identification Evaluation (TIE) may be required as part of the TRE, if appropriate. (A TIE is a set of procedures to identify the specific chemical(s) responsible for toxicity. These procedures are performed in three phases (characterization, identification, and confirmation) using aquatic organism toxicity tests.).

WET Maximum Daily Effluent Limitation (MDEL)

For the purposes of chronic aquatic toxicity, an MDEL is an effluent limitation based on the outcome of the TST approach and the resulting percent effect at the IWC.

WET Median Monthly Effluent Limit (MMEL)

For the purposes of chronic aquatic toxicity, an MMEL is an effluent limitation based on a maximum of three independent toxicity tests analyzed using the TST approach during a toxicity calendar month.

WET Maximum Daily Effluent Target (MDET)

For the purposes of chronic aquatic toxicity, an MDET is a target used to determine whether a Toxicity Reduction Evaluation (TRE) should be conducted. Not meeting the MDET is not a violation of an effluent limitation.

WET Median Monthly Effluent Target (MMET)

For the purposes of chronic aquatic toxicity, an MMET is a target based on a maximum of three independent toxicity tests used to determine whether a TRE should be conducted. Not meeting the MMET is not a violation of an effluent limitation.

WET MMEL Compliance Tests

For the purposes of chronic aquatic toxicity, a maximum of two tests that are used in addition to the routine monitoring test to determine compliance with the chronic aquatic toxicity MMEL.

WET MMET Tests

For the purposes of chronic aquatic toxicity, for dischargers not required to comply with numeric chronic toxicity effluent limitations, MMET Tests are a maximum of two tests that are used in addition to the routine monitoring test to determine whether a TRE should be conducted.

ATTACHMENT B – MAPS

FIGURE B-1: SITE LOCATION MAP


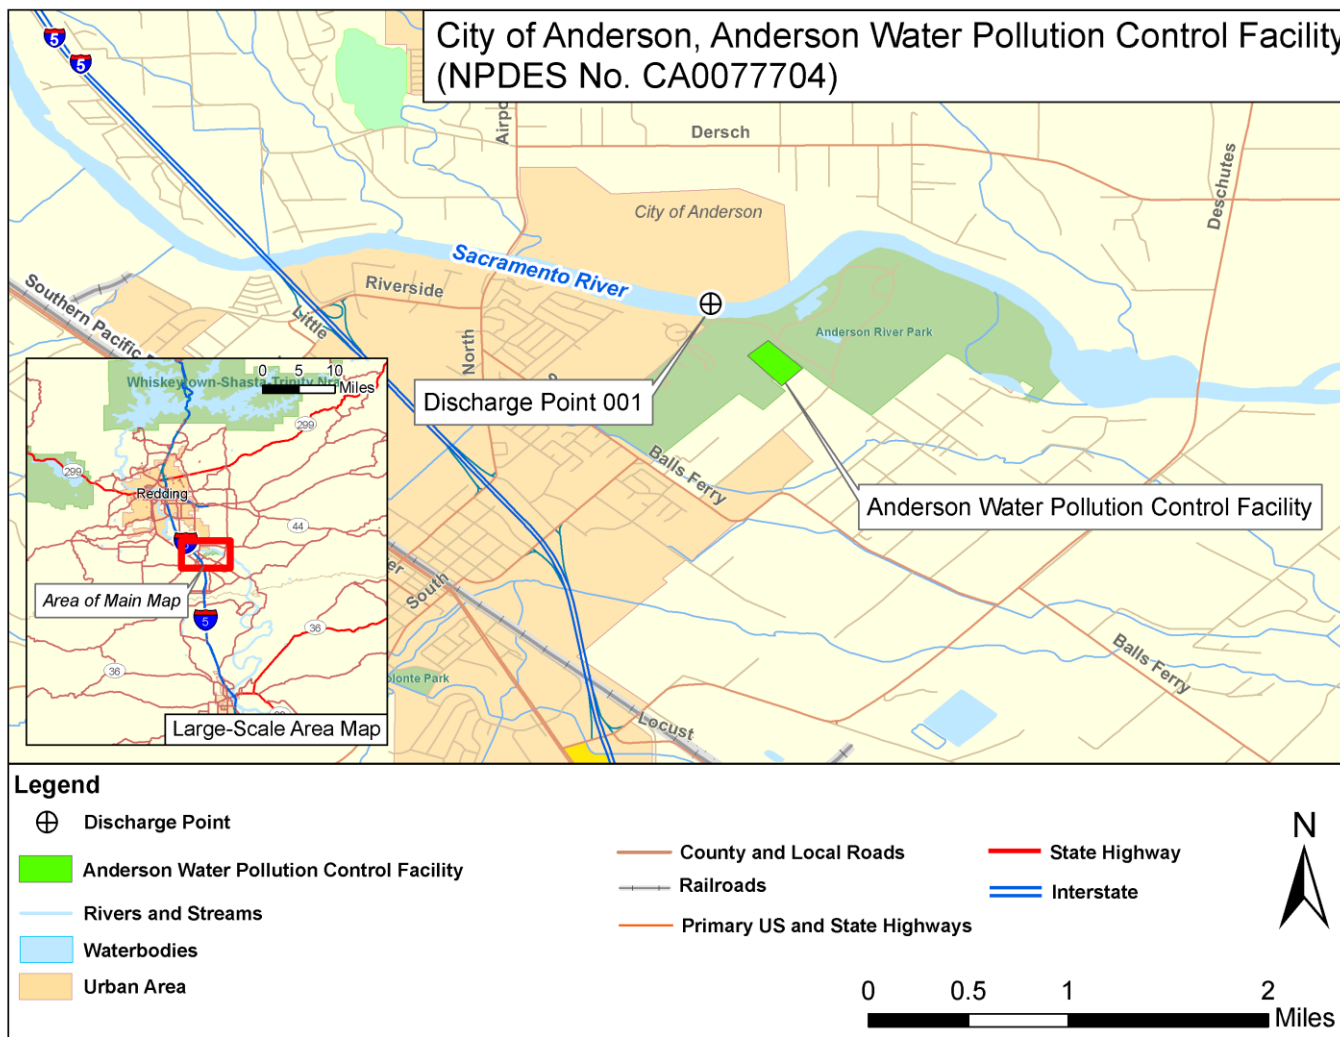


FIGURE B-2: FACILITY SITE MAP

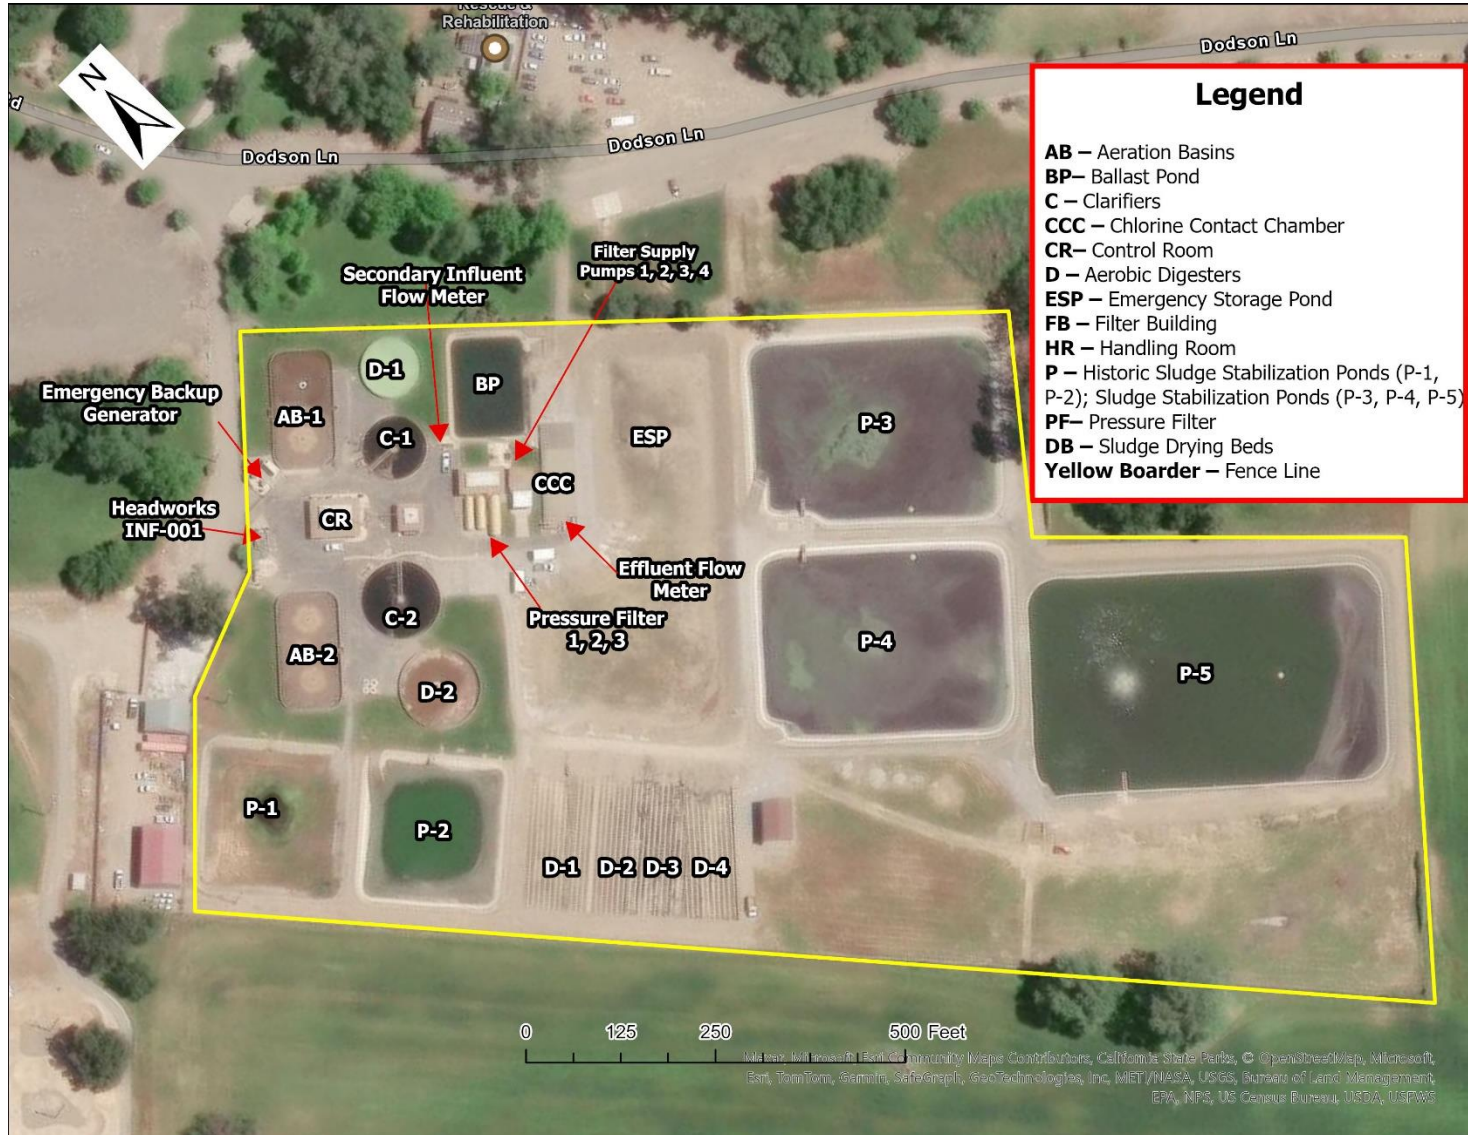

ATTACHMENT D – STANDARD PROVISIONS

I. STANDARD PROVISIONS – PERMIT COMPLIANCE

A. Duty to Comply:

1. The Discharger must comply with all of the terms, requirements, and conditions of this Order. Any noncompliance constitutes a violation of the Clean Water Act (CWA) and the California Water Code and is grounds for enforcement action; permit termination, revocation and reissuance, or modification; denial of a permit renewal application; or a combination thereof. (40 C.F.R. section 122.41(a); Wat. Code, sections 13261, 13263, 13265, 13268, 13000, 13001, 13304, 13350, 13385.)
2. The Discharger shall comply with effluent standards or prohibitions established under Section 307(a) of the CWA for toxic pollutants within the time provided in the regulations that establish these standards or prohibitions, even if this Order has not yet been modified to incorporate the requirement. (40 C.F.R. section 122.41(a)(1).)

B. Need to Halt or Reduce Activity Not a Defense

It shall not be a defense for a Discharger in an enforcement action that it would have been necessary to halt or reduce the permitted activity in order to maintain compliance with the conditions of this Order. (40 C.F.R. section 122.41(c).)

C. Duty to Mitigate

The Discharger shall take all reasonable steps to minimize or prevent any discharge in violation of this Order that has a reasonable likelihood of adversely affecting human health or the environment. (40 C.F.R. section 122.41(d).)

D. Proper Operation and Maintenance

The Discharger shall at all times properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the Discharger to achieve compliance with the conditions of this Order. Proper operation and maintenance also includes having adequate laboratory controls and appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems that are installed by a Discharger only when necessary to achieve compliance with the conditions of this Order. (40 C.F.R. section 122.41(e).)

E. Property Rights

1. This Order does not convey any property rights of any sort or any exclusive privileges. (40 C.F.R. section 122.41(g).)

2. The issuance of this Order does not authorize any injury to persons or property or invasion of other private rights, or any infringement of state or local law or regulations. (40 C.F.R. section 122.5(c).)

F. Inspection and Entry

The Discharger shall allow the Central Valley Water Board, State Water Board, U.S. EPA, and/or their authorized representatives (including an authorized contractor acting as their representative), upon the presentation of credentials and other documents, as may be required by law, to (33 U.S.C. section 1318(a)(4)(B); 40 C.F.R. section 122.41(i); Wat. Code, section 13267, 13383):

1. Enter upon the Discharger's premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order (33 U.S.C section 1318(a)(4)(B)(ii); 40 C.F.R. section 122.41(i)(1); Wat. Code, sections 13267, 13383);
2. Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order (33 U.S.C. section 1318(a)(4)(B)(ii); 40 C.F.R. section 122.41(i)(2); Wat. Code, sections 13267, 13383);
3. Inspect and photograph, at reasonable times, any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order (33 U.S.C section 1318(a)(4)(B)(ii); 40 C.F.R. section 122.41(i)(3); Wat. Code, section 13267, 13383); and
4. Sample or monitor, at reasonable times, for the purposes of assuring Order compliance or as otherwise authorized by the CWA or the Water Code, any substances or parameters at any location. (33 U.S.C section 1318(a)(4)(B); 40 C.F.R. section 122.41(i)(4); Wat. Code, sections 13267, 13383.)

G. Bypass

1. Definitions
 - a. "Bypass" means the intentional diversion of waste streams from any portion of a treatment facility. (40 C.F.R. section 122.41(m)(1)(i).)
 - b. "Severe property damage" means substantial physical damage to property, damage to the treatment facilities, which causes them to become inoperable, or substantial and permanent loss of natural resources that can reasonably be expected to occur in the absence of a bypass. Severe property damage does not mean economic loss caused by delays in production. (40 C.F.R. section 122.41(m)(1)(ii).)
2. Bypass not exceeding limitations. The Discharger may allow any bypass to occur which does not cause exceedances of effluent limitations, but only if it is for essential maintenance to assure efficient operation. These bypasses are not

subject to the provisions listed in Standard Provisions – Permit Compliance I.G.3, I.G.4, and I.G.5 below. (40 C.F.R. section 122.41(m)(2).)

3. Prohibition of bypass. Bypass is prohibited, and the Central Valley Water Board may take enforcement action against a Discharger for bypass, unless (40 C.F.R. section 122.41(m)(4)(i)):
 - a. Bypass was unavoidable to prevent loss of life, personal injury, or severe property damage (40 C.F.R. section 122.41(m)(4)(i)(A));
 - b. There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities, retention of untreated wastes, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass that occurred during normal periods of equipment downtime or preventive maintenance (40 C.F.R. section 122.41(m)(4)(i)(B)); and
 - c. The Discharger submitted notice to the Central Valley Water Board as required under Standard Provisions – Permit Compliance I.G.5 below. (40 C.F.R. section 122.41(m)(4)(i)(C).)
4. The Central Valley Water Board may approve an anticipated bypass, after considering its adverse effects, if the Central Valley Water Board determines that it will meet the three conditions listed in Standard Provisions – Permit Compliance I.G.3 above. (40 C.F.R. section 122.41(m)(4)(ii).)
5. **Notice**
 - a. **Anticipated bypass.** If the Discharger knows in advance of the need for a bypass, it shall submit prior notice if possible, at least 10 days before the date of the bypass. The notice shall be sent to the Central Valley Water Board. As of 21 December 2023, all notices shall be submitted electronically to the initial recipient (State Water Board’s [California Integrated Water Quality System \(CIWQS\) Program website](http://www.waterboards.ca.gov/water_issues/programs/ciwqs/) (http://www.waterboards.ca.gov/water_issues/programs/ciwqs/), defined in Standard Provisions – Reporting V.J below. Notices shall comply with 40 C.F.R. Part 3, section 122.22, and 40 C.F.R. Part 127. (40 C.F.R. section 122.41(m)(3)(i).)
 - b. **Unanticipated bypass.** The Discharger shall submit a notice of an unanticipated bypass as required in Standard Provisions - Reporting V.E below (24-hour notice). The notice shall be sent to the Central Valley Water Board. As of 21 December 2023, all notices shall be submitted electronically to the initial recipient (State Water Board’s [California Integrated Water Quality System \(CIWQS\) Program website](http://www.waterboards.ca.gov/water_issues/programs/ciwqs/). (http://www.waterboards.ca.gov/water_issues/programs/ciwqs/), defined in Standard Provisions – Reporting V.J below. Notices shall comply with

40 C.F.R. Part 3, section 122.22, and 40 C.F.R. Part 127. (40 C.F.R. section 122.41(m)(3)(ii).)

H. Upset

Upset means an exceptional incident in which there is unintentional and temporary noncompliance with technology-based permit effluent limitations because of factors beyond the reasonable control of the Discharger. An upset does not include noncompliance to the extent caused by operational error, improperly designed treatment facilities, inadequate treatment facilities, lack of preventive maintenance, or careless or improper operation. (40 C.F.R. section 122.41(n)(1).)

1. Effect of an upset. An upset constitutes an affirmative defense to an action brought for noncompliance with such technology-based permit effluent limitations if the requirements of Standard Provisions – Permit Compliance I.H.2 below are met. No determination made during administrative review of claims that noncompliance was caused by upset, and before an action for noncompliance, is final administrative action subject to judicial review. (40 C.F.R. section 122.41(n)(2).)
2. Conditions necessary for a demonstration of upset. A Discharger who wishes to establish the affirmative defense of upset shall demonstrate, through properly signed, contemporaneous operating logs or other relevant evidence that (40 C.F.R. section 122.41(n)(3)):
 - a. An upset occurred and that the Discharger can identify the cause(s) of the upset (40 C.F.R. section 122.41(n)(3)(i));
 - b. The permitted facility was, at the time, being properly operated (40 C.F.R. section 122.41(n)(3)(ii));
 - c. The Discharger submitted notice of the upset as required in Standard Provisions – Reporting V.E.2.b below (24-hour notice) (40 C.F.R. section 122.41(n)(3)(iii)); and
 - d. The Discharger complied with any remedial measures required under Standard Provisions – Permit Compliance I.C above. (40 C.F.R. section 122.41(n)(3)(iv).)
3. Burden of proof. In any enforcement proceeding, the Discharger seeking to establish the occurrence of an upset has the burden of proof. (40 C.F.R. section 122.41(n)(4).)

II. STANDARD PROVISIONS – PERMIT ACTION

A. General

This Order may be modified, revoked and reissued, or terminated for cause. The filing of a request by the Discharger for modification, revocation and reissuance, or termination, or a notification of planned changes or anticipated noncompliance does not stay any Order condition. (40 C.F.R. section 122.41(f).)

B. Duty to Reapply

If the Discharger wishes to continue an activity regulated by this Order after the expiration date of this Order, the Discharger must apply for and obtain a new permit. (40 C.F.R. section 122.41(b).)

C. Transfers

This Order is not transferable to any person except after notice to the Central Valley Water Board. The Central Valley Water Board may require modification or revocation and reissuance of the Order to change the name of the Discharger and incorporate such other requirements as may be necessary under the CWA and the Water Code. (40 C.F.R. section 122.41(l)(3); 122.61.)

III. STANDARD PROVISIONS – MONITORING

A. Samples and measurements taken for the purpose of monitoring shall be representative of the monitored activity. (40 C.F.R. section 122.41(j)(1).)

B. Monitoring must be conducted according to test procedures approved under 40 C.F.R. Part 136 for the analyses of pollutants unless another method is required under 40 C.F.R. subchapters N or O. Monitoring must be conducted according to sufficiently sensitive test methods approved under 40 C.F.R. Part 136 for the analysis of pollutants or pollutant parameters or as required under 40 C.F.R. chapter 1, subchapter N or O. For the purposes of this paragraph, a method is sufficiently sensitive when the method has the lowest ML of the analytical methods approved under 40 C.F.R. Part 136 or required under 40 C.F.R. chapter 1, subchapter N or O for the measured pollutant or pollutant parameter, or when:

1. The method minimum level (ML) is at or below the level of the most stringent effluent limitation established in the permit for the measured pollutant or pollutant parameter, and;
 - a. The method ML is at or below the level of the most stringent applicable water quality criterion for the measured pollutant or pollutant parameter, or;
 - b. The method ML is above the applicable water quality criterion but the amount of the pollutant or pollutant parameter in the facility's discharge is

high enough that the method detects and quantifies the level of the pollutant or pollutant parameter in the discharge.

In the case of pollutants or pollutant parameters for which there are no approved methods under 40 C.F.R. Part 136 or otherwise required under 40 C.F.R. chapter 1, subchapters N or O, monitoring must be conducted according to a test procedure specified in this Order for such pollutants or pollutant parameters. (40 C.F.R. sections 122.21(e)(3), 122.41(j)(4); 122.44(i)(1)(iv).)

IV. STANDARD PROVISIONS – RECORDS

- A.** Except for records of monitoring information required by this Order related to the Discharger's sewage sludge use and disposal activities, which shall be retained for a period of at least five years (or longer as required by 40 C.F.R. part 503), the Discharger shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and records of all data used to complete the application for this Order, for a period of at least three (3) years from the date of the sample, measurement, report or application. This period may be extended by request of the Central Valley Water Board Executive Officer at any time. (40 C.F.R. section 122.41(j)(2).)
- B.** Records of monitoring information shall include:
1. The date, exact place, and time of sampling or measurements (40 C.F.R. section 122.41(j)(3)(i));
 2. The individual(s) who performed the sampling or measurements (40 C.F.R. section 122.41(j)(3)(ii));
 3. The date(s) analyses were performed (40 C.F.R. section 122.41(j)(3)(iii));
 4. The individual(s) who performed the analyses (40 C.F.R. section 122.41(j)(3)(iv));
 5. The analytical techniques or methods used (40 C.F.R. section 122.41(j)(3)(v)); and
 6. The results of such analyses. (40 C.F.R. section 122.41(j)(3)(vi).)
- C.** Claims of confidentiality for the following information will be denied (40 C.F.R. section 122.7(b)):
1. The name and address of any permit applicant or Discharger (40 C.F.R. section 122.7(b)(1)); and

2. Permit applications and attachments, permits and effluent data.
(40 C.F.R. section 122.7(b)(2).)

V. STANDARD PROVISIONS – REPORTING

A. Duty to Provide Information

The Discharger shall furnish to the Central Valley Water Board, State Water Board, or U.S. EPA within a reasonable time, any information which the Central Valley Water Board, State Water Board, or U.S. EPA may request to determine whether cause exists for modifying, revoking and reissuing, or terminating this Order or to determine compliance with this Order. Upon request, the Discharger shall also furnish to the Central Valley Water Board, State Water Board, or U.S. EPA copies of records required to be kept by this Order. (40 C.F.R. section 122.41(h); Wat. Code, sections 13267, 13383.)

B. Signatory and Certification Requirements

1. All applications, reports, or information submitted to the Central Valley Water Board, State Water Board, and/or U.S. EPA shall be signed and certified in accordance with Standard Provisions – Reporting V.B.2, V.B.3, V.B.4, V.B.5, and V.B.6 below. (40 C.F.R. section 122.41(k).)
2. All permit applications shall be signed by either a principal executive officer or ranking elected official. For purposes of this provision, a principal executive officer of a federal agency includes: (i) the chief executive officer of the agency, or (ii) a senior executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., Regional Administrators of U.S. EPA). (40 C.F.R. section 122.22(a)(3).)
3. All reports required by this Order and other information requested by the Central Valley Water Board, State Water Board, or U.S. EPA shall be signed by a person described in Standard Provisions – Reporting V.B.2 above, or by a duly authorized representative of that person. A person is a duly authorized representative only if:
 - a. The authorization is made in writing by a person described in Standard Provisions – Reporting V.B.2 above (40 C.F.R. section 122.22(b)(1));
 - b. The authorization specifies either an individual or a position having responsibility for the overall operation of the regulated facility or activity such as the position of plant manager, operator of a well or a well field, superintendent, position of equivalent responsibility, or an individual or position having overall responsibility for environmental matters for the company. (A duly authorized representative may thus be either a named individual or any individual occupying a named position.) (40 C.F.R. section 122.22(b)(2)); and

- c. The written authorization is submitted to the Central Valley Water Board and State Water Board. (40 C.F.R. section 122.22(b)(3).)
4. If an authorization under Standard Provisions – Reporting V.B.3 above is no longer accurate because a different individual or position has responsibility for the overall operation of the facility, a new authorization satisfying the requirements of Standard Provisions – Reporting V.B.3 above must be submitted to the Central Valley Water Board and State Water Board prior to or together with any reports, information, or applications, to be signed by an authorized representative. (40 C.F.R. section 122.22(c).)
5. Any person signing a document under Standard Provisions – Reporting V.B.2 or V.B.3 above shall make the following certification:

“I certify under penalty of law that this document and all attachments were prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my inquiry of the person or persons who manage the system or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.” (40 C.F.R. section 122.22(d).)
6. Any person providing the electronic signature for such documents described in Standard Provision – V.B.1, V.B.2, or V.B.3 that are submitted electronically shall meet all relevant requirements of Standard Provisions – Reporting V.B, and shall ensure that all of the relevant requirements of 40 C.F.R. part 3 (Cross-Media Electronic Reporting) and 40 C.F.R. part 127 (NPDES Electronic Reporting Requirements) are met for that submission. (40 C.F.R. section 122.22(e).)

C. Monitoring Reports

1. Monitoring results shall be reported at the intervals specified in the Monitoring and Reporting Program (Attachment E) in this Order. (40 C.F.R. section 122.41(l)(4).)
2. Monitoring results must be reported on a Discharge Monitoring Report (DMR) form or forms provided or specified by the Central Valley Water Board or State Water Board for reporting the results of monitoring, sludge use, or disposal practices. As of 21 December 2016, all reports and forms must be submitted electronically to the initial recipient, defined in Standard Provisions – Reporting V.J, and comply with 40 C.F.R. part 3, section 122.22, and 40 C.F.R. part 127. (40 C.F.R. section 122.41(l)(4)(i).)
3. If the Discharger monitors any pollutant more frequently than required by this Order using test procedures approved under 40 C.F.R. part 136, or another

method required for an industry-specific waste stream under 40 C.F.R. subchapters N or O, the results of such monitoring shall be included in the calculation and reporting of the data submitted in the DMR or sludge reporting form specified by the Central Valley Water Board. (40 C.F.R. section 122.41(l)(4)(ii).)

4. Calculations for all limitations, which require averaging of measurements, shall utilize an arithmetic mean unless otherwise specified in this Order. (40 C.F.R. section 122.41(l)(4)(iii).)

D. Compliance Schedules

Reports of compliance or noncompliance with, or any progress reports on, interim and final requirements contained in any compliance schedule of this Order, shall be submitted no later than 14 days following each schedule date. (40 C.F.R. section 122.41(l)(5).)

E. Twenty-Four Hour Reporting

1. The Discharger shall report any noncompliance which may endanger health or the environment. Any information shall be provided orally within 24 hours from the time the Discharger becomes aware of the circumstances. A report shall also be provided within five (5) days of the time the Discharger becomes aware of the circumstances. The report shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected, the anticipated time it is expected to continue; and steps taken or planned to reduce, eliminate, and prevent reoccurrence of the noncompliance.

For noncompliance events related to combined sewer overflows, sanitary sewer overflows, or bypass events, these reports must include the data described above (with the exception of time of discovery) as well as the type of event (combined sewer overflows, sanitary sewer overflows, or bypass events), type of sewer overflow structure (e.g., manhole, combined sewer overflow outfall), discharge volumes untreated by the treatment works treating domestic sewage, types of human health and environmental impacts of the sewer overflow event, and whether the noncompliance was related to wet weather.

As of 21 December 2020 all reports related to combined sewer overflows, sanitary sewer overflows, or bypass events must be submitted electronically to the initial recipient (State Water Board) defined in Standard Provisions – Reporting V.J. The reports shall comply with 40 C.F.R. part 3. They may also require the Discharger to electronically submit reports not related to combined sewer overflows, sanitary sewer overflows, or bypass events under this section. (40 C.F.R. section 122.41(l)(6)(i).)

F. Planned Changes

The Discharger shall give notice to the Central Valley Water Board as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is required under this provision only when (40 C.F.R. section 122.41(l)(1)):

1. The alteration or addition to a permitted facility may meet one of the criteria for determining whether a facility is a new source in section 122.29(b) (40 C.F.R. section 122.41(l)(1)(i)); or
2. The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification applies to pollutants that are not subject to effluent limitations in this Order. (40 C.F.R. section 122.41(l)(1)(ii).)
3. The alteration or addition results in a significant change in the Discharger's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use or disposal sites not reported during the permit application process or not reported pursuant to an approved land application plan. (40 C.F.R. section 122.41(l)(1)(iii).)

G. Anticipated Noncompliance

The Discharger shall give advance notice to the Central Valley Water Board of any planned changes in the permitted facility or activity that may result in noncompliance with this Order's requirements. (40 C.F.R. section 122.41(l)(2).)

H. Other Noncompliance

The Discharger shall report all instances of noncompliance not reported under Standard Provisions – Reporting V.C, V.D, and V.E above at the time monitoring reports are submitted. The reports shall contain the information listed in Standard Provision – Reporting V.E above. For noncompliance events related to combined sewer overflows, sanitary sewer overflows, or bypass events, these reports shall contain the information described in Standard Provision – Reporting V.E and the applicable required data in appendix A to 40 C.F.R. part 127. The Central Valley Water Board may also require the Discharger to electronically submit reports not related to combined sewer overflows, sanitary sewer overflows, or bypass events under this section. (40 C.F.R. section 122.41(l)(7).)

I. Other Information

When the Discharger becomes aware that it failed to submit any relevant facts in a permit application, or submitted incorrect information in a permit application or in any report to the Central Valley Water Board, State Water Board, or U.S. EPA, the Discharger shall promptly submit such facts or information. (40 C.F.R. section 122.41(l)(8).)

J. Initial Recipient for Electronic Reporting Data

The owner, operator, or the duly authorized representative is required to electronically submit NPDES information specified in appendix A to 40 C.F.R. part 127 to the appropriate initial recipient, as determined by U.S. EPA, and as defined in 40 C.F.R. section 127.2(b). U.S. EPA will identify and publish the list of initial recipients on its website and in the Federal Register, by state and by NPDES data group [see 40 C.F.R. section 127.2(c)]. U.S. EPA will update and maintain this listing. (40 C.F.R. section 122.41(l)(9).)

VI. STANDARD PROVISIONS – ENFORCEMENT

- A.** The Central Valley Water Board is authorized to enforce the terms of this permit under several provisions of the Water Code, including, but not limited to, sections 13350, 13385, 13386, and 13387.

VII. ADDITIONAL PROVISIONS – NOTIFICATION LEVELS

A. Publicly-Owned Treatment Works (POTWs)

All POTWs shall provide adequate notice to the Central Valley Water Board of the following (40 C.F.R. section 122.42(b)):

1. Any new introduction of pollutants into the POTW from an indirect discharger that would be subject to sections 301 or 306 of the CWA if it were directly discharging those pollutants (40 C.F.R. section 122.42(b)(1)); and
2. Any substantial change in the volume or character of pollutants being introduced into that POTW by a source introducing pollutants into the POTW at the time of adoption of the Order. (40 C.F.R. section 122.42(b)(2).)
3. Adequate notice shall include information on the quality and quantity of effluent introduced into the POTW as well as any anticipated impact of the change on the quantity or quality of effluent to be discharged from the POTW. (40 C.F.R. section 122.42(b)(3).)

ATTACHMENT E – MONITORING AND REPORTING PROGRAM

Table of Contents

I.	General Monitoring Provisions.....	E-2
II.	Monitoring Locations	E-3
III.	Influent Monitoring Requirements.....	E-4
	A. Monitoring Location INF-001.....	E-4
	B. Monitoring Location SEC-001	E-5
IV.	Effluent Monitoring Requirements	E-5
	A. Monitoring Location EFF-001.....	E-5
V.	Whole Effluent Toxicity Testing Requirements	E-8
VI.	Land Discharge Monitoring Requirements – NOT APPLICABLE	E-15
VII.	Recycling Monitoring Requirements – NOT APPLICABLE.....	E-15
VIII.	Receiving Water Monitoring Requirements	E-15
	A. Monitoring Location RSW-001	E-15
	B. Monitoring Location RSW-002.....	E-16
IX.	Other Monitoring Requirements.....	E-17
	A. Biosolids – NOT APPLICABLE	E-17
	B. Pyrethroid Pesticides Monitoring	E-17
	C. Effluent and Receiving Water Characterization	E-21
	D. Pond Monitoring.....	E-27
X.	Reporting Requirements.....	E-28
	A. General Monitoring and Reporting Requirements.....	E-28
	B. Self-Monitoring Reports (SMRs)	E-29
	C. Discharge Monitoring Reports (DMRs)	E-32
	D. Other Reports	E-33

Tables

Table E-1.	Monitoring Station Locations.....	E-4
Table E-2.	Influent Monitoring.....	E-5
Table E-3.	Influent Monitoring – Monitoring Location SEC-001	E-5
Table E-4.	Effluent Monitoring	E-6
Table E-5.	Receiving Water Monitoring Requirements RSW-001	E-15
Table E-6.	Receiving Water Monitoring Requirements RSW-002	E-17
Table E-7.	Pyrethroid Pesticides Monitoring.....	E-18
Table E-8.	Pyrethroid Pesticide Partition Coefficients	E-20
Table E-9.	Effluent and Receiving Water Characterization Monitoring	E-22
Table E-10.	Monitoring Periods and Reporting Schedule	E-29
Table E-11.	Technical Reports	E-35

ATTACHMENT E – MONITORING AND REPORTING PROGRAM (MRP)

The Code of Federal Regulations (40 C.F.R. section 122.48) requires that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 authorize the Central Valley Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. This MRP establishes monitoring and reporting requirements that implement federal and California requirements.

I. GENERAL MONITORING PROVISIONS

- A.** Samples and measurements taken as required herein shall be representative of the volume and nature of the monitored discharge. All samples shall be taken at the monitoring locations specified below and, unless otherwise specified, before the monitored flow joins or is diluted by any other waste stream, body of water, or substance. Monitoring locations shall not be changed without notification to and the approval of the Central Valley Water Board.
- B.** Final effluent samples shall be taken downstream of the last addition of wastes to the treatment or discharge works where a representative sample may be obtained prior to mixing with the receiving waters. Samples shall be collected at such a point and in such a manner to ensure a representative sample of the discharge.
- C.** Chemical, bacteriological, and bioassay analyses of any material required by this Order shall be conducted by a laboratory accredited for such analyses by the State Water Resources Control Board (State Water Board), Division of Drinking Water (DDW; formerly the Department of Public Health), in accordance with the provision of Water Code section 13176. Laboratories that perform sample analyses must be identified in all monitoring reports submitted to the Central Valley Water Board. In the event an accredited laboratory is not available to the Discharger for any onsite field measurements such as pH, dissolved oxygen (DO), turbidity, temperature, and residual chlorine, such analyses performed by a non-accredited laboratory will be accepted provided a Quality Assurance-Quality Control Program is instituted by the laboratory. A manual containing the steps followed in this program for any onsite field measurements such as pH, DO, turbidity, temperature, and residual chlorine must be kept onsite in the treatment facility laboratory and shall be available for inspection by Central Valley Water Board staff. The Discharger must demonstrate sufficient capability (qualified and trained employees, properly calibrated and maintained field instruments, etc.) to adequately perform these field measurements. The Quality Assurance-Quality Control Program must conform to U.S. EPA guidelines or to procedures approved by the Central Valley Water Board.
- D.** Appropriate flow measurement devices and methods consistent with accepted scientific practices shall be selected and used to ensure the accuracy and reliability of measurements of the volume of monitored discharges. All monitoring instruments and devices used by the Discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary, at least yearly, to ensure their

continued accuracy. All flow measurement devices shall be calibrated at least once per year to ensure continued accuracy of the devices.

- E.** Monitoring results, including noncompliance, shall be reported at intervals and in a manner specified in this Monitoring and Reporting Program.
- F.** Laboratory analytical methods shall be sufficiently sensitive in accordance with the Sufficiently Sensitive Methods Rule (SSM Rule) specified under 40 C.F.R. 122.21(e)(3) and 122.44(i)(1)(iv). A U.S. EPA-approved analytical method is sufficiently sensitive for a pollutant/parameter where:
 - 1. The method minimum level (ML) is at or below the applicable water quality objective for the receiving water, or;
 - 2. The method ML is above the applicable water quality objective for the receiving water but the amount of the pollutant/parameter in the discharge is high enough that the method detects and quantifies the level of the pollutant/parameter, or;
 - 3. the method ML is above the applicable water quality objective for the receiving water, but the ML is the lowest of the 40 C.F.R. 136 U.S. EPA-approved analytical methods for the pollutant/parameter.
- G.** The Discharger shall ensure that the results of the Discharge Monitoring Report-Quality Assurance (DMR-QA) Study or the most recent Water Pollution Performance Evaluation Study are submitted annually to the State Water Resources Control Board at the following address or electronically via email to the DMR-QA Coordinator:

State Water Resources Control Board
Quality Assurance Program Officer
Office of Information Management and Analysis
1001 I Street, Sacramento, CA 95814
- H.** The Discharger shall file with the Central Valley Water Board technical reports on self-monitoring performed according to the detailed specifications contained in this Monitoring and Reporting Program.

II. MONITORING LOCATIONS

The Discharger shall establish the following monitoring locations to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this Order:

Table E-1. Monitoring Station Locations

Discharge Point Name	Monitoring Location Name	Monitoring Location Description
--	INF-001	A location where a representative sample of the influent into the Facility can be collected prior to entering the treatment process. Latitude: 40° 27' 55" N, Longitude: 122° 16' 30" W
--	SEC-001	Located at the weir box downstream of the secondary clarifiers and prior to the ballast pond and Filter Pumps Manhole 1 and 2.
001	EFF-001	Downstream from last connection through which wastes can be admitted into the outfall. Latitude: 40° 27' 53" N, Longitude: 122° 16' 27" W
--	RSW-001	In the Sacramento River, 100 feet upstream of Discharge Point 001 Latitude: 40° 28' 4.6" N, Longitude: 122° 16' 43" W
--	RSW-002	In the Sacramento River, 1/4 mile downstream of Discharge Point 001 Latitude: 40° 28' 9", Longitude: 122° 16' 24"
--	PND-003	Sludge Stabilization Pond 3 Latitude: 40°27'51.39"N, Longitude: 122°16'23.68"W
--	PND-004	Sludge Stabilization Pond 4 Latitude: 40°27'50.15"N, Longitude: 122°16'25.60"W
--	PND-005	Sludge Stabilization Pond 5 Latitude: 40°27'47.61"N, Longitude: 122°16'23.08"W
--	PND-006	Emergency Storage Pond Latitude: 40°27'52.11"N, Longitude: 122°16'26.95"W

Table E-1 Note:

1. The North latitude and West longitude information in Table E-1 are approximate for administrative purposes.

III. INFLUENT MONITORING REQUIREMENTS

A. Monitoring Location INF-001

1. The Discharger shall monitor influent to the Facility at Monitoring Location INF-001 in accordance with Table E-2 and the testing requirements described in section III.A. below:

Table E-2. Influent Monitoring

Parameter	Units	Sample Type	Minimum Sampling Frequency
pH	Standard Units	Grab	2/Week
Biochemical Oxygen Demand, 5-day @ 20°Celcius (BOD ₅)	mg/L	24-hour Composite	2/Month
Total Suspended Solids (TSS)	mg/L	24-hour Composite	2/Month

2. **Table E-2 Testing Requirements.** The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table E-2:
 - a. **Applicable to all parameters.** Parameters shall be analyzed using the analytical methods described in 40 CFR part 136; or by methods approved by the Central Valley Water Board or the State Water Board. In addition, if requested by the Discharger, the sample type may be modified by the Executive Officer to another 40 CFR part 136 allowed sample type.
 - b. **Grab Samples.** All grab samples shall not be collected at the same time each day to get a complete representation of variations in the influent.
 - c. **24-Hour Composite Samples.** All composite samples shall be collected from a 24-hour flow proportional composite.

B. Monitoring Location SEC-001

1. The Discharger shall monitor influent to the Facility at Monitoring Location SEC-001 as follows in Table E-3 below:

Table E-3. Influent Monitoring – Monitoring Location SEC-001

Parameter	Units	Sample Type	Minimum Sampling Frequency
Flow	MGD	Meter	Continuous

IV. EFFLUENT MONITORING REQUIREMENTS

A. Monitoring Location EFF-001

1. The Discharger shall monitor effluent at monitoring Location EFF-001 in accordance with Table E-4 and the testing requirements described in section IV.A.2 below:

Table E-4. Effluent Monitoring

Parameter	Units	Sample Type	Minimum Sampling Frequency
Chlorine, Total Residual	mg/L	Meter	Continuous
Flow	MGD	Meter	Continuous
pH	Standard Units	Grab	1/Day
Total Coliform Organisms	MPN/100 mL	Grab	2/Week
Ammonia Nitrogen, Total (as N)	mg/L	Grab	1/Week
Dissolved Oxygen	mg/L	Grab	1/Week
Temperature	°F(°C)	Grab	1/Week
BOD ₅	mg/L	24-hour Composite	1/Week
TSS	mg/L	24-hour Composite	1/Week
BOD ₅	% removal	Calculate	2/Month
TSS	% removal	Calculate	2/Month
Chlorodibromomethane	µg/L	Grab	1/Month
Copper, Total Recoverable	µg/L	Grab	1/Month
Cyanide	µg/L	Grab	1/Month
Dichlorobromomethane	µg/L	Grab	1/Month
Dissolved Organic Carbon	mg/L	Grab	1/Month
Electrical Conductivity @ 25°Celcius	µmhos/cm	Grab	1/Month
Hardness, Total (as CaCO ₃)	mg/L	Grab	1/Month
Nitrate Nitrogen, Total (as N)	mg/L	Grab	1/Month
Nitrite Nitrogen, Total (as N)	mg/L	Grab	1/Month
Nitrate plus Nitrite (as N)	mg/L	Calculate	1/Month
Zinc, Total Recoverable	µg/L	Grab	1/Month
4,4-DDE	µg/L	Grab	1/Year
Chlorpyrifos	µg/L	Grab	1/Year
Diazinon	µg/L	Grab	1/Year
Whole Effluent Toxicity	(see section V)	(see section V)	(see section V)
Priority Pollutants and Other Constituents of Concern	(see section IX.C)	(see section IX.C)	(see section IX.C)

2. **Table E-4 Testing Requirements.** The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table E-4:
 - a. **Applicable to all parameters.** Parameters shall be analyzed using the analytical methods described in 40 CFR part 136 or by methods approved by the Central Valley Water Board or the State Water Board. In addition, if

requested by the Discharger, the sample type may be modified by the Executive Officer to another 40 CFR part 136 allowed sample type.

- b. **24-hour composite samples** shall be collected from a 24-hour flow proportional composite.
- c. **Handheld Field Meter.** A handheld field meter may be used for **temperature** and **pH**, provided the meter utilizes a U.S. EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.
- d. **Temperature** and **pH** shall be recorded at the time of **ammonia** sample collection.
- e. **Whole Effluent Toxicity (WET).** Ammonia samples shall be collected concurrently with whole effluent toxicity monitoring. WET Monitoring shall be in accordance with section V of this MRP
- f. **Total Residual Chlorine** must be monitored using an analytical method that is sufficiently sensitive to measure at the permitted level of 0.01 mg/L.
- g. **Standard Minerals** shall include: boron, calcium, iron, magnesium, potassium, sodium, chloride, manganese, phosphorus, total alkalinity (including alkalinity series: bicarbonate, carbonate and hydroxide), and hardness, and include verification that the analysis is complete (i.e., cation/anion balance).
- h. **Hardness** samples shall be collected concurrently with metals samples.
- i. **Total Coliform Organisms.** Samples for total coliform organisms may be collected at any point following disinfection.
- j. **Priority Pollutants.** For all priority pollutant constituents listed in Table E-4, the RL shall be consistent with sections 2.4.2 and 2.4.3 of the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (State Implementation Policy or SIP) and the SSM Rule specified under 40 C.F.R. sections 122.21(e)(3) and 122.44(i)(1)(iv).
- k. **Chlorpyrifos and Diazinon** shall be sampled using U.S. EPA Method 625M, Method 8141, or equivalent GC/MS method with a lower Reporting Limit than the Basin Plan Water Quality Objectives of 0.015 µg/L and 0.1 µg/L for chlorpyrifos and diazinon, respectively.
- l. **Dissolved Organic Carbon monitoring** shall be conducted concurrently with pH and hardness sampling.

V. WHOLE EFFLUENT TOXICITY TESTING REQUIREMENTS

A. Toxicity Calendar Month, Quarter, and Year.

1. **Toxicity Calendar Month.** The toxicity calendar month is defined as the period of time beginning on the day of the initiation of the routine toxicity monitoring to the day before the corresponding day of the next month if the corresponding day exists, or if not to the last day of the next month.
2. **Toxicity Calendar Quarter.** A toxicity calendar quarter is defined as **three consecutive toxicity calendar months**. For purposes of this Order, the toxicity calendar quarters **begin on 1 January, 1 April, 1 July, and 1 October**
3. **Toxicity Calendar Year.** A toxicity calendar year is defined as **twelve consecutive toxicity calendar months**. For purposes of this Order, the toxicity calendar year **begins on 1 January** (i.e., 1 January 2026 to 1 January 2027), in years in which there are at least 15 days of discharge in at least one toxicity calendar quarter.

B. Acute Toxicity Testing.

The Discharger shall meet the following acute toxicity testing requirements:

1. **Instream Waste Concentration (IWC) for Acute Toxicity.** The acute toxicity IWC is 100 percent effluent.
2. **Routine Monitoring Frequency.** The Discharger shall perform routine acute toxicity testing once per toxicity calendar year in years in which there are at least 15 days of discharge in at least one toxicity calendar quarter, concurrent with effluent ammonia sampling.
3. **Sample Types.** The Discharger may use flow-through or static renewal testing. For static renewal testing, the samples shall be grab samples and shall be representative of the volume and quality of the discharge. The effluent samples shall be taken at Monitoring Location EFF-001.
4. **Test Species.** Test species shall be rainbow trout (*Oncorhynchus mykiss*).
5. **Test Methods.** The acute toxicity testing samples shall be analyzed using EPA-821-R-02-012, Fifth Edition or methods identified in the Code of Federal Regulations, title 40, part 136, or other U.S. EPA-approved methods. Temperature, total residual chlorine, and pH shall be recorded at the time of sample collection. No pH adjustment may be made unless approved by the Executive Officer.
6. **Test Failure.** If an acute toxicity test does not meet all test acceptability criteria, as specified in the test method, the Discharger must conduct a replacement test as soon as possible, as specified in the subsection below.

7. **Replacement Test.** When a required toxicity test for routine monitoring is not completed, a new toxicity test to replace the toxicity test that was not completed shall be initiated as soon as possible. The new toxicity test shall replace the routine monitoring, as applicable, for the toxicity calendar month in which the toxicity test that was not completed was required to be initiated, even if the new toxicity test is initiated in a subsequent month. The new toxicity test for routine monitoring, as applicable, for the toxicity calendar month in which the toxicity test that was not completed was required to be initiated. The new toxicity test required to be conducted due to the results of the new toxicity test shall not be used to substitute for any other required toxicity tests.

Any specific monitoring event is not required to be initiated in the required time period when the Central Valley Water Board staff determines that the test was not initiated in the required time period due to circumstances outside of the Discharger's control that were not preventable with the reasonable exercise of care, and the Discharger promptly initiates, and ultimately completes, a replacement test.

- C. **Chronic Toxicity Testing.** The Discharger shall meet the following chronic toxicity testing requirements:
 1. **Instream Waste Concentration (IWC) for Chronic Toxicity.** The chronic toxicity IWC is 11.1 percent effluent.
 2. **Routine Monitoring Frequency.** The Discharger shall perform routine chronic toxicity testing once per calendar quarter in quarters in which there are at least 15 days of discharge, concurrent with effluent ammonia sampling. While the Discharger is conducting a toxicity reduction evaluation the routine monitoring may be reduced to two (2) tests per calendar year.
 3. **Chronic Toxicity MMEL Compliance Testing.** If a routine chronic toxicity monitoring test results in a "fail" at the IWC, then a maximum of two chronic toxicity MMEL compliance tests shall be completed. The chronic toxicity MMEL compliance tests shall be initiated within the same calendar month that the routine monitoring chronic toxicity test was initiated that resulted in the "fail" at the IWC. If the first chronic toxicity MMEL compliance test results in a "fail" at the IWC, then the second chronic toxicity MMEL compliance test is unnecessary and is waived.
 4. **Additional Routine Monitoring Tests for TRE Determination.** In order to determine if a TRE is necessary an additional routine monitoring test is required when there is one violation of the chronic toxicity MDEL or MMEL, but not two violations in a single calendar month. This additional routine monitoring test is not required if the Discharger is already conducting a TRE. This additional routine monitoring test shall be initiated within two weeks after the calendar month in which the MMEL or MDEL violation occurred. The calendar month of the violation and the calendar month of the additional routine

monitoring shall be considered “successive calendar months” for purposes of determining whether a TRE is required. This additional routine monitoring test is also used for compliance purposes and could result in the need to conduct MMEL compliance testing per section V.B.4 above.

5. **Sample Volumes.** Adequate sample volumes shall be collected to provide renewal water to complete the test in the event that the discharge is intermittent.
6. **Test Species.** The testing shall be conducted using the most sensitive species, which is water flea (*Ceriodaphnia dubia*). The Discharger shall conduct chronic toxicity tests with water flea (*Ceriodaphnia dubia*), unless otherwise specified in writing by the Executive Officer. The Executive Officer has the authority to allow the temporary use of the next appropriate species as the most sensitive species when the discharger submits documentation, and the Executive Officer determines that the discharger has encountered unresolvable test interference or cannot secure a reliable supply of test organisms. The “next appropriate species” is a species in Table 1 of the Statewide Toxicity Provisions in the same test method classification (e.g., chronic aquatic toxicity test methods, acute aquatic toxicity test method), in the same salinity classification (e.g., freshwater or marine), and in the same taxon as the most sensitive species. When there are no other species in Table 1 in the same taxon as the most sensitive species (e.g., freshwater chronic toxicity tests), the “next appropriate species” is the species exhibiting the highest percent effect at the IWC tested in the species sensitivity screening other than the most sensitive species.
7. **Test Methods.** Discharger shall conduct the chronic toxicity tests on effluent samples at the instream waste concentration for the discharge in accordance with species and test methods in Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms (EPA/821/R02/013, 2002; Table IA, 40 C.F.R. part 136).
8. **Dilution and Control Water.** Dilution water and control water shall be prepared and used as specified in the test methods manual. If dilution water and control water is different from test organism culture water, then a second control using culture water shall also be used.
9. **Test Failure.** If the effluent chronic toxicity test does not meet all test acceptability criteria (TAC) specified in the referenced test method in EPA/821-R-02-013, the Discharger must conduct a Replacement Test as soon as possible, as specified in subsection B.10, below.
10. **Replacement Test.** When a required toxicity test for routine monitoring or MMEL compliance test is not completed, a new toxicity test to replace the toxicity test that was not completed shall be initiated as soon as possible. The new toxicity test shall replace the routine monitoring or MMEL compliance tests, as applicable, for the toxicity calendar month in which the toxicity test that

was not completed was required to be initiated, even if the new toxicity test is initiated in a subsequent month. The new toxicity test for routine monitoring or MMEL compliance tests, as applicable, and any MMEL compliance tests required to be conducted due to the results of the new toxicity test shall be used to determine compliance with the effluent limitations for the toxicity calendar month in which the toxicity test that was not completed was required to be initiated. The new toxicity test and any MMEL compliance tests required to be conducted due to the results of the new toxicity test shall not be used to substitute for any other required toxicity tests.

Any specific monitoring event is not required to be initiated in the required time period when the Central Valley Water Board staff determines that the test was not initiated in the required time period due to circumstances outside of the Discharger's control that were not preventable with the reasonable exercise of care, and the Discharger promptly initiates, and ultimately completes, a replacement test.

D. Quality Assurance and Additional Requirements. Quality assurance measures, instructions, and other recommendations and requirements are found in the test methods manual previously referenced. Additional requirements are below.

1. The discharge is subject to determination of "Pass" or "Fail" from an acute toxicity test and chronic toxicity test a chronic toxicity test using the Test of Significant Toxicity (TST) statistical t-test approach described in *National Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document* (EPA 833-R-10-003, 2010), Appendix A, Figure A-1 and Table A-1 (Chronic Freshwater and East Coast Methods) and Appendix B, Table B-1.

2. The null hypothesis (Ho) for the TST statistical approach is:

Mean discharge IWC response \leq RMD x Mean control response, where the chronic RMD = 0.75 and the acute RMD = 0.80.

A test result that rejects this null hypothesis is reported as "Pass." A test result that does not reject this null hypothesis is reported as "Fail."

3. The relative "Percent Effect" at the discharge IWC is defined and reported as:

Percent Effect = ((Mean control response – Mean discharge IWC response) / Mean control response) x 100.

This is a t-test (formally Student's t-Test), a statistical analysis comparing two sets of replicate observations, i.e., a control and IWC. The purpose of this statistical test is to determine if the means of the two sets of observations are different (i.e., if the IWC or receiving water concentration differs from the control, the test result is "Pass" or "Fail"). The Welch's t-test employed by the

TST statistical approach is an adaptation of Student's t-test and is used with two samples having unequal variances.

- E. WET Testing Notification Requirements.** The Discharger shall notify the Central Valley Water Board of test results that exceed the chronic toxicity effluent limitation or fail an acute toxicity test as soon as the Discharger learns of the exceedance, but no later than 24-hours after receipt of the monitoring results.
- F. WET Testing Reporting Requirements.** The Discharger shall submit the full laboratory report for all toxicity testing as an attachment to CIWQS for the reporting period (e.g., monthly, quarterly, semi-annually or annually) and provide the data (i.e., Pass/Fail) in the PET tool for uploading into CIWQS. The laboratory report shall include:
1. The valid toxicity test results for the TST statistical approach, reported as "Pass" or "Fail" and "Percent Effect" at the IWC for the discharge, the dates of sample collection and initiation of each toxicity test, all results for effluent parameters monitored concurrently with the toxicity test(s); and progress reports on TRE investigations.
 2. The statistical analysis used in *National Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document* (EPA 833-R-10-003, 2010) Appendix A, Figure A-1 and Table A-1, and Appendix B, Table B-1.
 3. Statistical program (e.g., TST calculator, CETIS, etc.) output results, including graphical plots, for each toxicity test.
- G. Most Sensitive Species Screening.** The Discharger shall perform rescreening to re-evaluate the most sensitive species. **The species sensitivity screening shall be conducted as follows and the results submitted with the Report of Waste Discharge.**
1. **Frequency of Testing for Species Sensitivity Screening.** Species sensitivity screening for chronic toxicity shall include, at a minimum, chronic WET testing four consecutive calendar quarters using the water flea (*Ceriodaphnia dubia*), fathead minnow (*Pimephales promelas*), and green alga (*Pseudokirchneriella subcapitata*). The tests shall be performed at an IWC of no less than 11.1 percent effluent. An effluent concentration greater than the IWC may be used for the species sensitivity screening.
 2. **Determination of Most Sensitive Species.** If a single test in the species sensitivity screening testing results in a "Fail" using the TST statistical approach, then the species used in that test shall be established as the most sensitive species. If there is more than a single test that results in a "Fail", then of the species with results of a "Fail", the species that exhibits the highest percent effect shall be established as the most sensitive species. If none of the tests in the species sensitivity screening results in a "Fail", but at least one of the species exhibits a percent effect greater than **10** percent, then the single

species that exhibits the highest percent effect shall be established as the most sensitive species. In all other circumstances, the Executive Officer shall have discretion to determine which single species is the most sensitive considering the test results from the species sensitivity screening. For subsequent species sensitivity screening, if the first two subsequent screening events result in no change in the most sensitive species, the Discharger may cease the subsequent species sensitive screening testing and the most sensitive species will remain unchanged.

The “next appropriate species” is a species in Table 1 of the Statewide Toxicity Provisions in the same test method classification (e.g., chronic aquatic toxicity test methods, acute aquatic toxicity test method), in the same salinity classification (e.g., freshwater or marine), and in the same taxon as the most sensitive species. When there are no other species in Table 1 in the same taxon as the most sensitive species (e.g., freshwater chronic toxicity tests), the “next appropriate species” is the species exhibiting the highest percent effect at the IWC tested in the species sensitivity screening other than the most sensitive species. The Executive Officer shall have discretion to allow the temporary use of the next appropriate species as the most sensitive species when the Discharger submits documentation and the Executive Officer determines that the Discharger has encountered unresolvable test interference or cannot secure a reliable supply of test organisms.

H. Toxicity Reduction Evaluations (TRE)

1. **TRE Implementation.** The Discharger is required to initiate a TRE when there is any combination of two or more MMEL violations within a single toxicity calendar month or within two successive toxicity calendar months. In addition, if other information indicates toxicity (e.g., results of additional monitoring, results of monitoring at a higher concentration than the IWC, fish kills, intermittent recurring toxicity), the Central Valley Water Board may require a TRE. A TRE may also be required when there is no effluent available to complete a routine monitoring test or MMEL compliance test.
 - a. **Preparation and Implementation of Detailed TRE Action Plan.** The Discharger shall conduct TREs in accordance with an approved TRE Work Plan. Within 30 days of the test result that triggered the TRE, the Discharger shall submit to the Executive Officer a TRE Action Plan. The TRE Action Plan shall include the following information, and comply with additional conditions set by the Executive Officer:
 - i. Specific actions the Discharger will take to investigate and identify the cause(s) of toxicity, including a TRE WET monitoring schedule;
 - ii. Specific actions the Discharger will take to mitigate the impact of the discharge and prevent the recurrence of toxicity; and
 - iii. A schedule for these actions, progress reports, and the final report.

- b. The Central Valley Water Board recognizes that toxicity may be episodic and identification of causes and reduction of sources of toxicity may not be successful in all cases. The TRE may be ended at any stage if monitoring finds there is no longer toxicity.
2. **TRE Work Plan.** The Discharger shall submit to the Central Valley Water Board a TRE Work Plan for approval by the Executive Officer by the due date in the Technical Reports Table E-11. If the Executive Officer does not disapprove the work plan within 60 days, the work plan shall become effective. The TRE Work Plan shall outline the procedures for identifying the source(s) of and reducing or eliminating effluent toxicity. The TRE Work Plan must be of adequate detail to allow the Discharger to immediately initiate a TRE and shall be developed in accordance with U.S. EPA guidance as discussed below.
 - a. Toxicity Reduction Evaluation Guidance for Municipal Wastewater Treatment Plants, EPA/833-B-99/002, August 1999.
 - b. Generalized Methodology for Conducting Industrial Toxicity Reduction Evaluations (TREs), EPA/600/2-88/070, April 1989.
 - c. Methods for Aquatic Toxicity Identification Evaluations: Phase I Toxicity Characterization Procedures, Second Edition, EPA 600/6-91/003, February 1991.
 - d. Toxicity Identification Evaluation: Characterization of Chronically Toxic Effluents, Phase I, EPA/600/6-91/005F, May 1992.
 - e. Methods for Aquatic Toxicity Identification Evaluations: Phase II Toxicity Identification Procedures for Samples Exhibiting Acute and Chronic Toxicity, Second Edition, EPA/600/R-92/080, September 1993.
 - f. Methods for Aquatic Toxicity Identification Evaluations: Phase III Toxicity Confirmation Procedures for Samples Exhibiting Acute and Chronic Toxicity, Second Edition, EPA 600/R-92/081, September 1993.
 - g. Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms, Fifth Edition, EPA-821-R-02-012, October 2002.
 - h. Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition, EPA-821-R-02-013, October 2002.
 - i. Technical Support Document for Water Quality-based Toxics Control, EPA/505/2-90-001, March 1991.

VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE

VII. RECYCLING MONITORING REQUIREMENTS – NOT APPLICABLE

VIII. RECEIVING WATER MONITORING REQUIREMENTS

A. Monitoring Location RSW-001

1. The Discharger shall monitor Sacramento River at RSW-001 in accordance with Table E-5 and the testing requirements described in section VIII.A.2 below:

Table E-5. Receiving Water Monitoring Requirements RSW-001

Parameter	Units	Sample Type	Minimum Sampling Frequency
pH	Standard Units	Grab	1/Week
Dissolved Oxygen	mg/L	Grab	1/Week
Temperature	°F (°C)	Grab	1/Week
Turbidity	NTU	Grab	1/Week
Dissolved Organic Carbon	mg/L	Grab	1/Month
Copper, Total Recoverable	µg/L	Grab	1/Month
Copper, Dissolved	µg/L	Grab	1/Month
Electrical Conductivity	µmhos/cm	Grab	1/Month
Hardness, Total (as CaCO ₃)	mg/L	Grab	1/Month
Zinc, Total Recoverable	µg/L	Grab	1/Month
Zinc, Dissolved	µg/L	Grab	1/Month
Standard Minerals	mg/L	Grab	1/Year
Priority Pollutants and Other Constituents of Concern	(see section IX.C)	(see section IX.C)	(see section IX.C)

2. **Table E-5 Testing Requirements.** The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table E-5:
 - a. **Applicable to all parameters.** Parameters shall be analyzed using the analytical methods described in 40 CFR part 136 or by methods approved by the Central Valley Water Board or the State Water Board. In addition, if requested by the Discharger, the sample type may be modified by the Executive Officer to another 40 CFR part 136 allowed sample type.
 - b. **Handheld Field Meter.** A handheld field meter may be used for **temperature** and **pH**, provided the meter utilizes a U.S. EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

- c. **Standard Minerals** shall include: boron, calcium, iron, magnesium, potassium, sodium, chloride, manganese, phosphorus, total alkalinity (including alkalinity series: bicarbonate, carbonate and hydroxide), and hardness, and include verification that the analysis is complete (i.e., cation/anion balance).
 - d. **Hardness** samples shall be collected concurrently with metals samples.
 - e. **Priority Pollutants.** For all priority pollutant constituents listed in Table E-5, the RL shall be consistent with sections 2.4.2 and 2.4.3 of the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (State Implementation Policy or SIP) and the SSM Rule specified under 40 C.F.R. sections 122.21(e)(3) and 122.44(i)(1)(iv).
 - f. **Dissolved Organic Carbon monitoring** shall be conducted concurrently with pH and hardness sampling.
3. In conducting the receiving water sampling, a log shall be kept of the receiving water conditions throughout the reach bounded by RSW-001 and RSW-002 when discharging to the Sacramento River. Attention shall be given to the presence of:
- a. Floating or suspended matter;
 - b. Discoloration;
 - c. Bottom deposits;
 - d. Aquatic life;
 - e. Visible films, sheens, or coatings;
 - f. Fungi, slimes, or objectionable growths; and
 - g. Potential nuisance conditions.

Notes on receiving water conditions shall be summarized in the monitoring report.

B. Monitoring Location RSW-002

- 1. The Discharger shall monitor Sacramento River at RSW-002 in accordance with Table E-6 and the testing requirements described in section VIII.B.2 below as follows:

Table E-6. Receiving Water Monitoring Requirements RSW-002

Parameter	Units	Sample Type	Minimum Sampling Frequency
pH	Standard Units	Grab	1/Week
Dissolved Oxygen	mg/L	Grab	1/Week
Temperature	°F (°C)	Grab	1/Week
Turbidity	NTU	Grab	1/Week
Electrical Conductivity @ 25°C	µmhos/cm	Grab	1/Month

2. **Table E-6 Testing Requirements.** The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table E-6:
 - a. **Applicable to all parameters.** Parameters shall be analyzed using the analytical methods described in 40 CFR part 136 or by methods approved by the Central Valley Water Board or the State Water Board. In addition, if requested by the Discharger, the sample type may be modified by the Executive Officer to another 40 CFR part 136 allowed sample type.
 - b. **Handheld Field Meter.** A handheld field meter may be used for **temperature** and **pH**, provided the meter utilizes a U.S. EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.

IX. OTHER MONITORING REQUIREMENTS

A. Biosolids – NOT APPLICABLE

B. Pyrethroid Pesticides Monitoring

1. **Water Column Chemistry Monitoring Requirements.** The Discharger shall conduct effluent and receiving water Sacramento River baseline monitoring in accordance with Table E-7. Quarterly monitoring shall be conducted for **one year beginning with the first quarter of 2027** concurrent with the Effluent and Receiving Water Characterization Monitoring. The Discharger shall also submit a minimum of one quality assurance/quality control (QA/QC) sample during the year to be analyzed for the constituents listed in Table E-7.

The monitoring shall be conducted in the effluent at Monitoring Location EFF-001 and downstream receiving water at Monitoring Location RSW-002 and the results of such monitoring be submitted to the Central Valley Water Board with the quarterly self-monitoring reports. The Discharger shall use one of the Environmental Laboratory Accreditation Program (ELAP)-accredited laboratories with analytical methods that have been approved by the Central

Valley Water Board’s Executive Officer for use in assessing compliance with the Basin Plan. A current list of ELAP-approved laboratories and points of contact can be found on the Central Valley Water Board’s [Pyrethroid Pesticides TMDL and Basin Plan Amendment](https://www.waterboards.ca.gov/centralvalley/water_issues/tmdl/central_valley_projects/central_valley_pesticides/pyrethroid_tmdl_bpa/index.html) Webpage, (https://www.waterboards.ca.gov/centralvalley/water_issues/tmdl/central_valley_projects/central_valley_pesticides/pyrethroid_tmdl_bpa/index.html).

Monitoring can either be conducted by the Discharger or can be done as part of a group monitoring effort. If the Discharger chooses to participate in a group monitoring effort, the timing and the other study requirements of the monitoring can be modified by the Executive Officer.

Table E-7. Pyrethroid Pesticides Monitoring

Parameter	CAS Number	Sample Units	Sample Type	Analytical Method	Reporting Level
Total Bifenthrin	82657-04-3	ng/L	Grab	See Table Note 1	1.3
Total Cyfluthrin	68359-37-5	ng/L	Grab	See Table Note 1	1.3
Total Cypermethrin	52315-07-8	ng/L	Grab	See Table Note 1	1.7
Total Esfenvalerate	51630-58-1	ng/L	Grab	See Table Note 1	3.3
Total Lambda-cyhalothrin	91465-08-6	ng/L	Grab	See Table Note 1	1.2
Total Permethrin	52645-53-1	ng/L	Grab	See Table Note 1	10
Freely Dissolved Bifenthrin	82657-04-3	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Cyfluthrin	68359-37-5	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Cypermethrin	52315-07-8	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Esfenvalerate	51630-58-1	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Lambda-cyhalothrin	91465-08-6	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Permethrin	52645-53-1	ng/L	Calculated	Calculated from total concentration	--

Parameter	CAS Number	Sample Units	Sample Type	Analytical Method	Reporting Level
Dissolved Organic Carbon (DOC)	--	mg/L	Grab	--	--
Total Organic Carbon (TOC)	--	mg/L	Grab	--	--

Table Notes:

- The Discharger shall use ELAP-accredited laboratories and methods validated by Central Valley Water Board staff for pyrethroid pesticides water column chemistry monitoring. A current list of ELAP-approved laboratories and points of contact can be found on the [Central Valley Water Board’s Pyrethroid Pesticides TMDL and Basin Plan Amendment](https://www.waterboards.ca.gov/centralvalley/water_issues/tmdl/central_valley_projects/central_valley_pesticides/pyrethroid_tmdl_bpa/index.html) Webpage:
 (https://www.waterboards.ca.gov/centralvalley/water_issues/tmdl/central_valley_projects/central_valley_pesticides/pyrethroid_tmdl_bpa/index.html).

The freely dissolved concentration of each quantified pyrethroid pesticide in a sample may be directly measured or estimated using partition coefficients. Methods for direct measurement must be approved by the Executive Officer before they are used to determine the freely dissolved pyrethroid concentrations that are used for determining exceedances of the pyrethroid pesticides numeric triggers in Table 4-2 of the Basin Plan.

To estimate the freely dissolved concentration of a pyrethroid pesticide with partition coefficients, the following equation shall be used:

$$C_{dissolved} = \frac{C_{total}}{1 + (K_{OC} \times [POC]) + (K_{DOC} \times [DOC])}$$

Where:

C dissolved = concentration of a an individual pyrethroid pesticide that is in the freely dissolved phase (ng/L),

C total = total concentration of an individual pyrethroid pesticide in water (ng/L),

KOC = organic carbon-water partition coefficient for the individual pyrethroid pesticide (L/kg),

[POC] = concentration of particulate organic carbon in the water sample (kg/L), which can be calculated as [POC]=[TOC]-[DOC],

[TOC] = total organic carbon in the sample (kg/L)

KDOC = dissolved organic carbon-water partition coefficient (L/kg),

[DOC] = concentration of dissolved organic carbon in the sample (kg/L).

Site-specific or alternative study-based partition coefficients approved by the Executive Officer may be used for KOC and KDOC in the above equation. If site-specific or alternative study-based partition coefficients are not available or have not been approved, the following partition coefficients shall be used for KOC and KDOC in the above equation:

Table E-8. Pyrethroid Pesticide Partition Coefficients

Pyrethroid Pesticide	Receiving water KOC (L/kg)	Receiving water KDOC (L/kg)	Effluent KOC (L/kg)	Effluent KDOC (L/kg)
Bifenthrin	4,228,000	1,737,127	15,848,932	800,000
Cyfluthrin	3,870,000	2,432,071	3,870,000	2,432,071
Cypermethrin	3,105,000	762,765	6,309,573	200,000
Esfenvalerate	7,220,000	1,733,158	7,220,000	1,733,158
Lambda-cyhalothrin	2,056,000	952,809	7,126,428	200,000
Permethrin	6,075,000	957,703	10,000,000	200,000

2. **Water Column Toxicity Monitoring Requirements.** When discharging to the Sacramento River, the Discharger shall monitor the toxicity of the downstream receiving water using U.S. EPA method EPA-821-R-02-012 (Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms, Fifth Edition, USEPA, October 2002, or most recent edition). Except as specified in this order, water column toxicity testing shall follow the measurement quality objectives provided in the Surface Water Ambient Monitoring Program (SWAMP) Quality Assurance Program Plan (SWRCB, 2018). When feasible, the Discharger shall use the Southern California Coastal Water Research Project (SCCWRP) guidance (Schiff and Greenstein, 2016) on test organism age and size for *Hyalella azteca*.

For consistency with U.S. EPA Method EPA-821-R-02-012 and ELAP accreditation, *Hyalella azteca* water column toxicity testing for baseline monitoring must be performed at 20 degrees Celsius.

Quarterly monitoring shall be conducted for one year concurrent with the Pyrethroid Pesticides Water Column Chemistry Monitoring during Effluent and Receiving Water Characterization Monitoring (see section IX.B of this MRP for specific dates). Downstream receiving water monitoring shall be conducted at monitoring location RSW-002 when discharging to the Sacramento River and the results of such monitoring be submitted to the Central Valley Water Board with the quarterly self-monitoring reports. Monitoring can either be conducted by the Discharger or can be done as part of a group monitoring effort. If the Discharger chooses to participate in a group monitoring effort, the timing of the monitoring can be modified by the Executive Officer.

3. **Exceedance of Numeric Triggers.** If the Pyrethroid Pesticides Water Column Chemistry Monitoring identifies an exceedance of any pyrethroid pesticides numeric trigger, the Discharger shall notify the Central Valley Water Board in writing of the exceedance and the Discharger's intent to submit a Pyrethroid Management Plan. Monitoring results should be reviewed quarterly, and the Discharger shall notify the Central Valley Water Board of any exceedances of the Pyrethroid numeric triggers as soon as possible. The Pyrethroid Management Plan, as outlined in section VI.C.3.b of this Order, shall be submitted to the Central Valley Water Board within one year from the date that an exceedance is identified by either the Discharger or Central Valley Water Board staff. Pyrethroid concentrations that exceed the acute and/or chronic pyrethroid numeric triggers, as outlined in Table 4-2 of the Basin Plan, constitute an exceedance of a numeric trigger. In the absence of a pyrethroid numeric trigger exceedance, observed toxicity in the water column does not constitute a violation of the pyrethroid conditional prohibition.

Identification of an exceedance provides the information that the Pyrethroid Pesticides Water Column Chemistry Monitoring was designed to collect, per Chapter V of the Basin Plan; therefore, once an exceedance is identified, the Discharger may cease conducting subsequent Pyrethroid Pesticides Monitoring.

C. Effluent and Receiving Water Characterization

1. **Monitoring Frequency**
 - a. **Effluent Sampling.** Samples shall be collected from the effluent (Monitoring Location EFF-001) quarterly between 1 January 2027 and 31 December 2027.
 - b. **Receiving Water Sampling.** Samples shall be collected from the upstream receiving water (Monitoring Location RSW-001) quarterly between 1 January 2027 and 31 December 2027.
2. **Analytical Methods.** Constituents shall be collected and analyzed consistent with the Discharger's Analytical Methods Report (Attachment E, X.D.1) using sufficiently sensitive analytical methods and Reporting Levels (RLs) per the SSM Rule specified in 40 C.F.R. 122.21(e)(3) and 122.44(i)(1)(iv). The "Reporting Level" is synonymous with the "Method Minimum Level" described in the SSM Rule. The results of the monitoring shall be submitted to the Central Valley Water Board with the quarterly self-monitoring reports. Each individual monitoring event shall provide representative sample results for the effluent and upstream receiving water.
3. **Analytical Methods Report Certification.** Prior to beginning the Effluent and Receiving Water Characterization monitoring, the Discharger shall provide a certification acknowledging the scheduled start date of the Effluent and Receiving Water Characterization monitoring and confirming that samples will

be collected and analyzed as described in the previously submitted Analytical Methods Report. If there are changes to the previously submitted Analytical Methods Report, the Discharger shall outline those changes. A one-page certification form will be provided by Central Valley Water Board staff with the permit's Notice of Adoption that the Discharger can use to satisfy this requirement. The certification form shall be submitted electronically via CIWQS submittal by the due date in the Technical Reports Table E-11.

4. The Discharger shall conduct effluent and receiving water characterization monitoring in accordance with Table E-9 and the testing requirements described in section IX.C.5 below.

Table E-9. Effluent and Receiving Water Characterization Monitoring

VOLATILE ORGANICS

CTR Number	Volatile Organic Parameters	CAS Number	Units	Effluent Sample Type
25	2-Chloroethyl vinyl Ether	110-75-8	µg/L	Grab
17	Acrolein	107-02-8	µg/L	Grab
18	Acrylonitrile	107-13-1	µg/L	Grab
19	Benzene	71-43-2	µg/L	Grab
20	Bromoform	75-25-2	µg/L	Grab
21	Carbon Tetrachloride	56-23-5	µg/L	Grab
22	Chlorobenzene	108-90-7	µg/L	Grab
24	Chloroethane	75-00-3	µg/L	Grab
26	Chloroform	67-66-3	µg/L	Grab
35	Methyl Chloride	74-87-3	µg/L	Grab
23	Dibromochloromethane	124-48-1	µg/L	Grab
27	Dichlorobromomethane	75-27-4	µg/L	Grab
36	Methylene Chloride	75-09-2	µg/L	Grab
33	Ethylbenzene	100-41-4	µg/L	Grab
89	Hexachlorobutadiene	87-68-3	µg/L	Grab
34	Methyl Bromide (Bromomethane)	74-83-9	µg/L	Grab
94	Naphthalene	91-20-3	µg/L	Grab
38	Tetrachloroethylene (PCE)	127-18-4	µg/L	Grab
39	Toluene	108-88-3	µg/L	Grab
40	trans-1,2-Dichloroethylene	156-60-5	µg/L	Grab
43	Trichloroethylene (TCE)	79-01-6	µg/L	Grab
44	Vinyl Chloride	75-01-4	µg/L	Grab
21	Methyl-tert-butyl ether (MTBE)	1634-04-4	µg/L	Grab
41	1,1,1-Trichloroethane	71-55-6	µg/L	Grab
42	1,1,2-Trichloroethane	79-00-5	µg/L	Grab
28	1,1-Dichloroethane	75-34-3	µg/L	Grab
30	1,1-Dichloroethylene (DCE)	75-35-4	µg/L	Grab
31	1,2-Dichloropropane	78-87-5	µg/L	Grab

CTR Number	Volatile Organic Parameters	CAS Number	Units	Effluent Sample Type
32	1,3-Dichloropropylene	542-75-6	µg/L	Grab
37	1,1,2,2-Tetrachloroethane	79-34-5	µg/L	Grab
101	1,2,4-Trichlorobenzene	120-82-1	µg/L	Grab
29	1,2-Dichloroethane	107-06-2	µg/L	Grab
75	1,2-Dichlorobenzene	95-50-1	µg/L	Grab
76	1,3-Dichlorobenzene	541-73-1	µg/L	Grab
77	1,4-Dichlorobenzene	106-46-7	µg/L	Grab

SEMI-VOLATILE ORGANICS

CTR Number	Semi-Organic Volatile Parameters	CAS Number	Units	Effluent Sample Type
60	Benzo(a)Anthracene	56-55-3	µg/L	Grab
85	1,2-Diphenylhydrazine	122-66-7	µg/L	Grab
45	2-Chlorophenol	95-57-8	µg/L	Grab
46	2,4-Dichlorophenol	120-83-2	µg/L	Grab
47	2,4-Dimethylphenol	105-67-9	µg/L	Grab
49	2,4-Dinitrophenol	51-28-5	µg/L	Grab
82	2,4-Dinitrotoluene	121-14-2	µg/L	Grab
55	2,4,6-Trichlorophenol	88-06-2	µg/L	Grab
83	2,6-Dinitrotoluene	606-20-2	µg/L	Grab
50	2-Nitrophenol	88-75-5	µg/L	Grab
71	2-Chloronaphthalene	91-58-7	µg/L	Grab
78	3,3-Dichlorobenzidine	91-94-1	µg/L	Grab
62	Benzo(b)Fluoranthene	205-99-2	µg/L	Grab
52	4-Chloro-3-methylphenol	59-50-7	µg/L	Grab
48	2-Methyl-4,6-Dinitrophenol	534-52-1	µg/L	Grab
51	4-Nitrophenol	100-02-7	µg/L	Grab
69	4-Bromophenyl Phenyl Ether	101-55-3	µg/L	Grab
72	4-Chlorophenyl Phenyl Ether	7005-72-3	µg/L	Grab
56	Acenaphthene	83-32-9	µg/L	Grab
57	Acenaphthylene	208-96-8	µg/L	Grab
58	Anthracene	120-12-7	µg/L	Grab
59	Benzidine	92-87-5	µg/L	Grab
61	Benzo(a)Pyrene	50-32-8	µg/L	Grab
63	Benzo(ghi)Perylene	191-24-2	µg/L	Grab
64	Benzo(k)Fluoranthene	207-08-9	µg/L	Grab
65	Bis (2-Chloroethoxy) Methane	111-91-1	µg/L	Grab
66	Bis (2-Chloroethyl) Ether	111-44-4	µg/L	Grab
67	Bis (2-Chloroisopropyl) Ether	108-60-1	µg/L	Grab
68	Bis(2-Ethylhexyl) Phthalate	117-81-7	µg/L	Grab
70	Butylbenzyl Phthalate	85-68-7	µg/L	Grab
73	Chrysene	218-01-9	µg/L	Grab

CTR Number	Semi-Organic Volatile Parameters	CAS Number	Units	Effluent Sample Type
81	Di-n-butyl Phthalate	84-74-2	µg/L	Grab
84	Di-n-Octyl Phthalate	117-84-0	µg/L	Grab
74	Dibenzo(a,h)anthracene	53-70-3	µg/L	Grab
79	Diethyl Phthalate	84-66-2	µg/L	Grab
80	Dimethyl Phthalate	131-11-3	µg/L	Grab
86	Fluoranthene	206-44-0	µg/L	Grab
87	Fluorene	86-73-7	µg/L	Grab
88	Hexachlorobenzene	118-74-1	µg/L	Grab
90	Hexachlorocyclopentadiene	77-47-4	µg/L	Grab
91	Hexachloroethane	67-72-1	µg/L	Grab
92	Indeno(1,2,3-cd) Pyrene	193-39-5	µg/L	Grab
93	Isophorone	78-59-1	µg/L	Grab
98	N-Nitrosodiphenylamine	86-30-6	µg/L	Grab
96	N-Nitrosodimethylamine	62-75-9	µg/L	Grab
97	N-Nitrosodi-n-Propylamine	621-64-7	µg/L	Grab
95	Nitrobenzene	98-95-3	µg/L	Grab
53	Pentachlorophenol (PCP)	87-86-5	µg/L	Grab
99	Phenanthrene	85-01-8	µg/L	Grab
54	Phenol	108-95-2	µg/L	Grab
100	Pyrene	129-00-0	µg/L	Grab

INORGANICS

CTR Number	Inorganic Parameters	CAS Number	Units	Effluent Sample Type
NL	Aluminum	7429-90-5	µg/L	24-hour Composite
1	Antimony, Total	7440-36-0	µg/L	24-hour Composite
2	Arsenic, Total	7440-38-2	µg/L	24-hour Composite
15	Asbestos	1332-21-4	µg/L	24-hour Composite
3	Beryllium, Total	7440-41-7	µg/L	24-hour Composite
4	Cadmium, Total	7440-43-9	µg/L	24-hour Composite
5	Chromium, Total	7440-47-3	µg/L	24-hour Composite
6	Copper, Total	7440-50-8	µg/L	24-hour Composite
NL	Iron, Total	7439-89-6	µg/L	24-hour Composite
7	Lead, Total	7439-92-1	µg/L	24-hour Composite
8	Mercury, Total	7439-97-6	µg/L	Grab
NL	Mercury, Methyl	22967-92-6	µg/L	Grab
NL	Manganese, Total	7439-96-5	µg/L	24-hour Composite
9	Nickel, Total	7440-02-0	µg/L	24-hour Composite
10	Selenium, Total	7782-49-2	µg/L	24-hour Composite
11	Silver, Total	7440-22-4	µg/L	24-hour Composite
12	Thallium, Total	7440-28-0	µg/L	24-hour Composite
13	Zinc, Total	7440-66-6	µg/L	24-hour Composite

NON-METALS/MINERALS

CTR Number	Non-Metal/Mineral Parameters	CAS Number	Units	Effluent Sample Type
NL	Boron	7440-42-8	µg/L	24-hour Composite
NL	Chloride	16887-00-6	mg/L	24-hour Composite
14	Cyanide, Total (as CN)	57-12-5	µg/L	Grab
NL	Sulfate	14808-79-8	mg/L	24-hour Composite
NL	Sulfide (as S)	5651-88-7	mg/L	24-hour Composite

PESTICIDES/PCBs/DIOXINS

CTR Number	Pesticide/PCB/Dioxin Parameters	CAS Number	Units	Effluent Sample Type
110	4,4-DDD	72-54-8	µg/L	24-hour Composite
109	4,4-DDE	72-55-9	µg/L	24-hour Composite
108	4,4-DDT	50-29-3	µg/L	24-hour Composite
112	alpha-Endosulfan	959-98-8	µg/L	24-hour Composite
103	alpha-BHC (Benzene hexachloride)	319-84-6	µg/L	24-hour Composite
102	Aldrin	309-00-2	µg/L	24-hour Composite
113	beta-Endosulfan	33213-65-9	µg/L	24-hour Composite
104	beta-BHC (Benzene hexachloride)	319-85-7	µg/L	24-hour Composite
107	Chlordane	57-74-9	µg/L	24-hour Composite
106	delta-BHC (Benzene hexachloride)	319-86-8	µg/L	24-hour Composite
111	Dieldrin	60-57-1	µg/L	24-hour Composite
114	Endosulfan Sulfate	1031-07-8	µg/L	24-hour Composite
115	Endrin	72-20-8	µg/L	24-hour Composite
116	Endrin Aldehyde	7421-93-4	µg/L	24-hour Composite
117	Heptachlor	76-44-8	µg/L	24-hour Composite
118	Heptachlor Epoxide	1024-57-3	µg/L	24-hour Composite
105	gamma-BHC (Benzene hexachloride or Lindane)	58-89-9	µg/L	24-hour Composite
119	Polychlorinated Biphenyl (PCB) 1016	12674-11-2	µg/L	24-hour Composite
120	PCB 1221	11104-28-2	µg/L	24-hour Composite
121	PCB 1232	11141-16-5	µg/L	24-hour Composite
122	PCB 1242	53469-21-9	µg/L	24-hour Composite
123	PCB 1248	12672-29-6	µg/L	24-hour Composite
124	PCB 1254	11097-69-1	µg/L	24-hour Composite
125	PCB 1260	11096-82-5	µg/L	24-hour Composite
126	Toxaphene	8001-35-2	µg/L	24-hour Composite
16	2,3,7,8-TCDD (Dioxin)	1746-01-6	mg/L	24-hour Composite

CONVENTIONAL PARAMETERS

CTR Number	Conventional Parameters	CAS Number	Units	Effluent Sample Type
NL	pH	--	SU	Grab
NL	Temperature	--	°C	Grab

NON-CONVENTIONAL PARAMETERS

CTR Number	Nonconventional Parameters	CAS Number	Units	Effluent Sample Type
NL	Foaming Agents (MBAS)	MBAS	mg/L	24-hour Composite
NL	Hardness (as CaCO3)	471-34-1	mg/L	Grab
NL	Specific Conductance (Electrical Conductivity or EC)	EC	µmhos/cm	24-hour Composite
NL	Total Dissolved Solids (TDS)	TDS	mg/L	24-hour Composite
NL	Dissolved Organic Carbon (DOC)	DOC	mg/L	24-hour Composite

NUTRIENTS

CTR Number	Nutrient Parameters	CAS Number	Units	Effluent Sample Type
NL	Ammonia (as N)	7664-41-7	mg/L	24-hour Composite
NL	Nitrate (as N)	14797-55-8	mg/L	24-hour Composite
NL	Nitrite (as N)	14797-65-0	mg/L	24-hour Composite
NL	Phosphorus, Total (as P)	7723-14-0	mg/L	24-hour Composite

OTHER CONSTITUENTS OF CONCERN

CTR Number	Other Constituents of Concern	CAS Number	Units	Effluent Sample Type
NL	Dalapon	75-99-0	µg/L	24-hour Composite
NL	Diquat	85-00-7	µg/L	24-hour Composite
NL	Chlorpyrifos	2921-88-2	µg/L	24-hour Composite
NL	Diazinon	333-41-5	µg/L	24-hour Composite

5. **Table E-9 Testing Requirements.** The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table E-9:
 - a. **Applicable to All Parameters.** Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.

- b. **Grab Samples.** A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.
- c. **24-hour Composite Samples.** All 24-hour composite samples shall be collected from a 24-hour flow proportional composite.
- d. **Redundant Sampling.** The Discharger is not required to conduct effluent monitoring for constituents that have already been sampled in a given month, as required in Table E-4, with the exception of hardness which shall be sampled concurrently with the hardness-dependent metals (cadmium, chromium III, lead, nickel, silver, and zinc).
- e. **Concurrent Sampling.** Effluent and receiving water sampling shall be performed at approximately the same time, on the same date.
- f. **Sample Type.** All receiving water samples shall be taken as grab samples. Effluent samples shall be taken as described in Table E-9.
- g. **Bis (2-ethylhexyl) phthalate.** In order to verify if bis (2-ethylhexyl) phthalate is truly present, the Discharger shall take steps to assure that sample containers, sampling apparatus, and analytical equipment are not sources of the detected contaminant.
- h. **Total Mercury and Methyl Mercury.** Unfiltered methyl mercury and total mercury samples shall be taken using clean hands/dirty hands procedures, as described in U.S. EPA method 1669: Sampling Ambient Water for Trace Metals at EPA Water Quality Criteria Levels, for collection of equipment blanks (section 9.4.4.2). The analysis of methyl mercury and total mercury shall be by U.S. EPA method 1630 and 1631 (Revision E), respectively, with a reporting limit of 0.05 ng/L for methyl mercury and 0.5 ng/L for total mercury.
- i. **Ammonia (as N).** Sampling is only required in the upstream receiving water.
- j. **Chlorpyrifos and Diazinon** shall be sampled using U.S. EPA Method 625M, Method 8141, or equivalent GC/MS method with a lower Reporting Limit than the Basin Plan Water Quality Objectives of 0.015 µg/L and 0.1 µg/L for chlorpyrifos and diazinon, respectively.

D. Pond Monitoring

The Discharger shall monitor the sludge stabilization ponds (PND-003, PND-004, and PND-005) and the emergency storage pond (PND-006) as described below:

1. The Discharger shall conduct weekly inspections of the ponds and document their findings in a bound logbook. The records should detail the level of

freeboard (feet), the presence or absence of liquid, any odors or nuisance conditions, and the accumulation of substances such as grease, dead algae, scum, or debris in the ponds; berm condition observations shall be conducted once per month. Additionally, any instances of partially or untreated wastewater discharges to PND-006 should be noted. A summary of these observations shall be included in the monthly monitoring report.

2. If there is a discharge of partially or untreated wastewater to PND-006, the Discharger must provide comprehensive notes in the logbook, detailing the timing and cause of the discharge, how the wastewater was managed while in the pond, when it was returned to the Facility's treatment system, and the measures taken to prevent a recurrence of the issue.
3. The Discharger shall conduct regular observations and inspections of the asphalt and concrete-lined units at the Facility; frequency of the inspection of the asphalt and concrete-lined units shall be no less than once per 24 months. Central Valley Water Board staff shall be notified 30 days prior to a planned asphalt and concrete inspection. A summary of the inspections, including the dates, findings, and photo documentation of the inspection, shall be included with the Annual Operation Report, as specified below in section X.D.2.f.

Pursuant to Construction, Operation and Maintenance Specifications, section VI.C.4., the Discharger shall regularly inspect the condition of the constructed pond surfaces and sludge drying beds to ensure the integrity of the concrete and asphalt lined structure and prevent infiltration of waste constituents into soils in a mass or concentration that will violate groundwater limitations in section V.B. of this Order. The Discharger shall maintain and repair the ponds and storage facilities as necessary to ensure the integrity of the ponds and drying beds are maintained and leakage from the units is minimized. Necessary repairs shall be completed in reasonable timeframes that are consistent with the severity of the impairment and potential for impact to water quality.

4. The Discharger shall monitor pH in PND-006 weekly when unit is in use for more than 72 hours.

X. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D) related to monitoring, reporting, and recordkeeping.
2. Upon written request of the Central Valley Water Board, the Discharger shall submit a summary monitoring report. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year(s).

3. **Compliance Time Schedules.** For compliance time schedules included in the Order, the Discharger shall submit to the Central Valley Water Board, on or before each compliance due date, the specified document or a written report detailing compliance or noncompliance with the specific date and task. If noncompliance is reported, the Discharger shall state the reasons for noncompliance and include an estimate of the date when the Discharger will be in compliance. The Discharger shall notify the Central Valley Water Board by letter when it returns to compliance with the compliance time schedule.
4. The Discharger shall report to the Central Valley Water Board any toxic chemical release data it reports to the State Emergency Response Commission within 15 days of reporting the data to the Commission pursuant to section 313 of the "Emergency Planning and Community Right to Know Act" of 1986.

B. Self-Monitoring Reports (SMRs)

1. The Discharger shall electronically submit SMRs using the State Water Board's [California Integrated Water Quality System \(CIWQS\) Program](http://www.waterboards.ca.gov/water_issues/programs/ciwqs/) website (http://www.waterboards.ca.gov/water_issues/programs/ciwqs/). The CIWQS website will provide additional information for SMR submittal in the event there will be a planned service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP under sections III through X. The Discharger shall submit monthly, quarterly, semiannual, annual SMRs including the results of all required monitoring using U.S. EPA-approved test methods or other test methods specified in this Order. SMRs are to include all new monitoring results obtained since the last SMR was submitted. If the Discharger monitors any pollutant more frequently than required by this Order, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR. Monthly SMRs are required even if there is no discharge. If no discharge occurs during the month, the monitoring report must be submitted stating that there has been no discharge.
3. Monitoring periods and reporting for all required monitoring shall be completed according to the following schedule:

Table E-10. Monitoring Periods and Reporting Schedule

Sampling Frequency	Monitoring Period Begins On	Monitoring Period	SMR Due Date
Continuous	Permit effective date	All	Submit with monthly SMR
1/Hour	Permit effective date	Hourly	Submit with monthly SMR

Sampling Frequency	Monitoring Period Begins On	Monitoring Period	SMR Due Date
1/Day	Permit effective date	(Midnight through 11:59 PM) or any 24-hour period that reasonably represents a calendar day for purposes of sampling.	Submit with monthly SMR
1/Week	Permit effective date	Sunday through Saturday	Submit with monthly SMR
1/Month	Permit effective date	1st day of calendar month through last day of calendar month	First day of second calendar month following month of sampling
1/Quarter	Permit effective date	1 January through 31 March 1 April through 30 June 1 July through 30 September 1 October through 31 December	1 May 1 August 1 November 1 February of following year
2/Year	Permit effective date	1 January through 30 June 1 July through 31 December	1 August 1 February of following year
1/Year	Permit effective date	1 January through 31 December	1 February of following year

4. **Reporting Protocols.** The Discharger shall report with each sample result the applicable Reporting Level (RL) and the current laboratory’s Method Detection Limit (MDL), as determined by the procedure in 40 C.F.R. part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory’s MDL, shall be reported as “Detected, but Not Quantified,” or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ. The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (\pm a percentage of the reported value), numerical ranges

(low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory's MDL shall be reported as "Not Detected," or ND.
 - d. Dischargers are to instruct laboratories to establish calibration standards so that the Minimum Level (ML) value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from extrapolation beyond the lowest point of the calibration curve.
5. **Multiple Sample Data.** When determining compliance with an AMEL, AWEL, or MDEL for priority pollutants and more than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of "Detected, but Not Quantified" (DNQ) or "Not Detected" (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
- a. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
 - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.
6. **The Discharger shall submit SMRs** in accordance with the following requirements:
- a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data is required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
 - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the waste

discharge requirements; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation.

- c. The Discharger shall attach all final laboratory reports from all contracted commercial laboratories, including quality assurance/quality control information, with all its SMRs for which sample analyses were performed.
7. The Discharger shall submit in the SMRs calculations and reports in accordance with the following requirements:
- a. **Calendar Annual Average Limitations.** For constituents with effluent limitations specified as “calendar annual average” (electrical conductivity) the Discharger shall report the calendar annual average in the December SMR. The annual average shall be calculated as the average of the samples gathered for the calendar year.
 - b. **Removal Efficiency (BOD₅ and TSS).** The Discharger shall calculate and report the percent removal of BOD₅ and TSS in the SMRs. The percent removal shall be calculated as specified in section VII.A of the Waste Discharge Requirements.
 - c. **Total Coliform Organisms Effluent Limitations.** The Discharger shall calculate and report the 7-day median of total coliform organisms for the effluent. The 7-day median of total coliform organisms shall be calculated as specified in section VII.C of the Waste Discharge Requirements.
 - d. **Dissolved Oxygen Receiving Water Limitations.** The Discharger shall report monthly in the self-monitoring report the dissolved oxygen concentrations in the effluent (EFF-001) and the receiving water RSW-001 and RSW-002 or other downstream receiving water location.
 - f. **Turbidity Receiving Water Limitations.** The Discharger shall calculate and report the turbidity increase in the receiving water applicable to the natural turbidity condition specified in section V.A.17.a-e. of the Waste Discharge Requirements.
 - g. **Temperature Receiving Water Limitations.** The Discharger shall calculate and report the temperature increase in the receiving water based on the difference in temperature at Monitoring Locations RSW-001 and RSW-002.

C. Discharge Monitoring Reports (DMRs)

1. DMRs are U.S. EPA reporting requirements. The Discharger shall electronically certify and submit DMRs together with SMRs using Electronic Self-Monitoring Reports module eSMR 2.5 or any upgraded version. Electronic DMR submittal

will be in addition to electronic SMR submittal.

[Information about electronic DMR submittal](http://www.waterboards.ca.gov/water_issues/programs/discharge_monitoring/)

(http://www.waterboards.ca.gov/water_issues/programs/discharge_monitoring/)
is available on the Internet.

D. Other Reports

1. **Analytical Methods Report.** The Discharger shall complete and submit an Analytical Methods Report, electronically via CIWQS submittal, by the due date shown in the Technical Reports Table E-11. The Analytical Methods Report shall include the following for each constituent to be monitored in accordance with this Order: 1) applicable water quality objective, 2) reporting level (RL), 3) method detection limit (MDL), and 4) analytical method. The analytical methods shall be sufficiently sensitive with RLs consistent with the SSM Rule per 40 C.F.R. 122.21(e)(3) and 122.44(i)(1)(iv), and with the Minimum Levels (MLs) in the SIP, Appendix 4. The "Reporting Level or RL" is synonymous with the "Method Minimum Level" described in the SSM Rule. If an RL is not less than or equal to the applicable water quality objective for a constituent, the Discharger shall explain how the proposed analytical method complies with the SSM Rule as outlined above in Attachment E, section I.F. Central Valley Water Board staff will provide a tool with the permit's Notice of Adoption to assist the Discharger in completing this requirement. The tool will include the constituents and associated applicable water quality objectives to be included in the Analytical Methods Report.
2. **Annual Operations Report.** The Discharger shall submit a written report to the Central Valley Water Board, electronically via CIWQS submittal, containing the following by the due date in the Technical Reports Table E-11:
 - a. The names, certificate grades, and general responsibilities of all persons employed at the Facility.
 - b. The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
 - c. A statement certifying when the flow meter(s) and other monitoring instruments and devices were last calibrated, including identification of who performed the calibration.
 - d. A statement certifying whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last revised and last reviewed for adequacy.
 - e. The Discharger may also be requested to submit an annual report to the Central Valley Water Board with both tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the compliance record. If

violations have occurred, the report shall also discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.

- f. The asphalt and concrete-lined units inspection dates, a description of surface conditions at the time of inspection (e.g., surface preparation), inspection protocol, summary of findings, and photo documentation, as specified in section IX.D.A.3. An assessment of the containment's effectiveness for ensuring compliance with groundwater limitations and sludge specifications regarding containment shall be included with the Annual Report.
3. **Recycled Water Policy Annual Reports.** In accordance with section 3 of the Water Quality Control Policy for Recycled Water (Recycled Water Policy), the Discharger shall electronically submit an annual report of monthly data to the State Water Board by 30 April annually covering the previous calendar year using the State Water Board's [GeoTracker website](https://geotracker.waterboards.ca.gov/) (<https://geotracker.waterboards.ca.gov/>). Information for setting up and using the GeoTracker system can be found in the *ESI Guide for Responsible Parties* document on the State Water Board's website for [Electronic Submittal of Information](https://www.waterboards.ca.gov/ust/electronic_submittal/index.html) (https://www.waterboards.ca.gov/ust/electronic_submittal/index.html).

The annual report to GeoTracker must include volumetric reporting of the items listed in [section 3.2 of the Recycled Water Policy](https://www.waterboards.ca.gov/board_decisions/adopted_orders/resolutions/2018/121118_7_final_amendment_oal.pdf) (https://www.waterboards.ca.gov/board_decisions/adopted_orders/resolutions/2018/121118_7_final_amendment_oal.pdf). A pdf of the upload confirmation from GeoTracker for the Recycled Water Policy Annual Report shall be uploaded into CIWQS annually as a technical report per Table E-15, to demonstrate compliance with this reporting requirement.

4. **Report of Waste Discharge (ROWD).** For the 5-year permit renewal, the Discharger shall submit a written report to the Central Valley Water Board, electronically via CIWQS submittal, containing, at minimum, the following by the due date in the Technical Reports Table E-11:
 - a. Report of Waste Discharge (Form 200);
 - b. NPDES Form 2A
 - c. NPDES Form 2S;
 - d. **Salinity Evaluation and Minimization Plan (SEMP).** The Discharger shall evaluate the effectiveness of the SEMP and provide a summary with the Report of Waste Discharge; and

- e. **Mixing Zone Requests.** A mixing zone analysis for constituents the Discharger is requesting the continuation of dilution credits and mixing zones in the calculation of water quality-based effluent limits.
 - f. **Metal Translators Request.** A metal translator analysis for constituents the Discharger is requesting the continuation of site-specific metal translators in the calculation CTR criteria and Basin Plan Objectives for copper and zinc.
6. **Technical Report Submittals.** This Order includes requirements to submit a ROWD, special study technical reports, progress reports, and other reports identified in the MRP (hereafter referred to collectively as “technical reports”). The Technical Reports Table E-11 and subsequent table notes below summarize all technical reports required by this Order and the due dates for submittal. All technical reports shall be submitted electronically via CIWQS submittal. Technical reports should be uploaded as a PDF, Microsoft Word, or Microsoft Excel file attachment.

Table E-11. Technical Reports

Report #	Technical Report	Due Date	CIWQS Report Name
Intentionally left blank	Standard Reporting Requirements	Intentionally left blank	Intentionally left blank
1	Report of Waste Discharge	31 March 2029	ROWD
2	Analytical Methods Report	31 May 2025	MRP X.D.1
3	Analytical Methods Report Certification	1 October 2026	MRP IX.C.3
4	Annual Operations Report	1 February 2026	MRP X.D.2
5	Annual Operations Report	1 February 2027	MRP X.D.2
6	Annual Operations Report	1 February 2028	MRP X.D.2
7	Annual Operations Report	1 February 2029	MRP X.D.2
8	Annual Operations Report	1 February 2030	MRP X.D.2
9	Recycled Water Policy Annual Report Submittal Confirmation	30 April 2026	MRP X.D.3
10	Recycled Water Policy Annual Report Submittal Confirmation	30 April 2027	MRP X.D.3
11	Recycled Water Policy Annual Report Submittal Confirmation	30 April 2028	MRP X.D.3
12	Recycled Water Policy Annual Report Submittal Confirmation	30 April 2029	MRP X.D.3
13	Recycled Water Policy Annual Report Submittal Confirmation	30 April 2030	MRP X.D.3
14	Salinity Evaluation and Minimization Plan	With ROWD	SEMP

Report #	Technical Report	Due Date	CIWQS Report Name
15	Most Sensitive Species Screening	With ROWD	MRP V.F
16	Toxicity Reduction Evaluation (TRE) Workplan	30 June 2025	MRP V.H.2.
17	Salinity Evaluation and Minimization Plan	With ROWD	WDR VI.C.3.a
18	Sludge/Biosolids Management Plan	28 September 2025	WDR VI.C.5

ATTACHMENT F – FACT SHEET

Table of Contents

I.	Permit Information	F-3
II.	Facility Description	F-4
	A. Description of Wastewater and Biosolids Treatment and Controls	F-5
	B. Discharge Points and Receiving Waters.....	F-7
	C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data	F-7
	D. Compliance Summary.....	F-9
	E. Planned Changes	F-9
III.	Applicable Plans, Policies, and Regulations.....	F-9
	A. Legal Authorities	F-9
	B. California Environmental Quality Act (CEQA).....	F-9
	C. State and Federal Laws, Regulations, Policies, and Plans	F-10
	D. Impaired Water Bodies on CWA 303(d) List	F-13
	E. Other Plans, Policies and Regulations.....	F-14
IV.	Rationale For Effluent Limitations and Discharge Specifications.....	F-14
	A. Discharge Prohibitions.....	F-15
	B. Technology-Based Effluent Limitations.....	F-15
	1. Scope and Authority.....	F-15
	2. Applicable Technology-Based Effluent Limitations	F-16
	C. Water Quality-Based Effluent Limitations (WQBELs).....	F-17
	1. Scope and Authority.....	F-17
	2. Applicable Beneficial Uses and Water Quality Criteria and Objectives	F-18
	3. Determining the Need for WQBELs	F-35
	4. WQBEL Calculations	F-55
	5. Whole Effluent Toxicity (WET)	F-58
	D. Final Effluent Limitation Considerations.....	F-61
	1. Mass-based Effluent Limitations	F-61
	2. Averaging Periods for Effluent Limitations	F-62
	3. Satisfaction of Anti-Backsliding Requirements.....	F-62
	4. Antidegradation Policies	F-64
	5. Stringency of Requirements for Individual Pollutants.....	F-65
	E. Interim Effluent Limitations - Not Applicable	F-67
	F. Land Discharge Specifications – Not Applicable.....	F-67
	G. Recycling Specifications – Not Applicable	F-67
V.	Rationale for Receiving Water Limitations.....	F-67
	A. Surface Water.....	F-67
	B. Groundwater.....	F-68
VI.	Rationale for Provisions.....	F-69
	A. Standard Provisions.....	F-69
	B. Special Provisions.....	F-69
	1. Reopener Provisions.....	F-69
	2. Special Studies and Additional Monitoring Requirements- Not Applicable	F-70
	3. Best Management Practices and Pollution Prevention	F-70

4. Construction, Operation, and Maintenance Specifications.....	F-70
5. Special Provisions for POTWs.....	F-71
6. Other Special Provisions- NOT APPLICABLE	F-71
7. Compliance Schedules- NOT APPLICABLE.....	F-71
VII. Rationale for Monitoring and Reporting Requirements.....	F-71
A. Influent Monitoring	F-72
B. Effluent Monitoring.....	F-72
C. Receiving Water Monitoring.....	F-72
1. Surface Water.....	F-72
D. Whole Effluent Toxicity Testing Requirements	F-73
E. Other Monitoring Requirements.....	F-75
VIII. Public Participation	F-76
A. Notification of Interested Persons	F-76
B. Written Comments	F-76
C. Public Hearing	F-77
D. Reconsideration of Waste Discharge Requirements.....	F-77
E. Information and Copying.....	F-77
F. Register of Interested Persons	F-78
G. Additional Information	F-78

Tables

Table F-1 Facility Information	F-3
Table F-2 Historic Effluent Limitations (January 2020- February 2024).....	F-8
Table F-3 Basin Plan Beneficial Uses	F-10
Table F-4 303 (d) List for the Sacramento River from Keswick to Cottonwood Creek.....	F-14
Table F-5 Summary of Technology-based Effluent Limitations	F-17
Table F-6. Mixing Zone/Dilution Study Results.....	F-22
Table F-7. Site-Specific Translators for Copper and Zinc.....	F-23
Table F-8 Mixing Zones and Dilution Credits.....	F-32
Table F-9 Percent Assimilative Capacity Used Calculations	F-33
Table F-10. Summary of Criteria for CTR Hardness-dependent Metals	F-34
Table F-11 Salinity Water Quality Criteria/Objectives.....	F-39
Table F-12 Copper RPA Criteria.....	F-47
Table F-13 Zinc RPA Criteria.....	F-54
Table F-14 Summary of Water Quality-Based Effluent Limitations.....	F-57
Table F-15 Acute Whole Effluent Toxicity Testing Results	F-59
Table F-16 Chronic Whole Effluent Toxicity Testing Results – Test of Significant Toxicity at the IWC (100 Percent Effluent).....	F-61
Table F-17 Summary of Final Effluent Limitations	F-66
Table F-18 Summary of Monitoring Changes	F-73

ATTACHMENT F – FACT SHEET

As described in section II.C of this Order, the Central Valley Water Board incorporates this Fact Sheet as findings of the Central Valley Water Board supporting the issuance of this Order. This Fact Sheet discusses the legal requirements and technical rationale that serve as the basis for the requirements of this Order.

This Order has been prepared under a standardized format to accommodate a broad range of discharge requirements for Dischargers in California. Only those sections or subsections of this Order that are specifically identified as “not applicable” have been determined not to apply to this Discharger. Sections or subsections of this Order not specifically identified as “not applicable” are fully applicable to this Discharger.

I. PERMIT INFORMATION

The following table summarizes administrative information related to the Facility.

Table F-1 Facility Information

Waste Discharge ID:	5A450100001
CIWQS Facility Place ID:	205741
Discharger:	City of Anderson
Name of Facility:	Anderson Water Pollution Control Plant
Facility Address:	3701 Rupert Road
Facility City, State Zip:	Anderson, CA 96007
Facility County:	Shasta County
Facility Contact, Title and Phone Number:	Nick Jones, Chief Plant Operator, (530) 378-6665
Authorized Person to Sign and Submit Reports:	Nick Jones, Chief Plant Operator, (530) 378-6665
Mailing Address:	1887 Howard Street, Anderson, CA 96007
Billing Address:	Same as Mailing Address
Type of Facility:	Publicly Owned Treatment Works
Major or Minor Facility:	Major
Threat to Water Quality:	1
Complexity:	A
Pretreatment Program:	No
Recycling Requirements:	Not Applicable
Facility Permitted Flow:	2.0 million gallons per day (MGD), average dry weather flow
Facility Design Flow:	2.0 MGD
Watershed:	Sacramento-Lower Cow-Lower Clear
Receiving Water:	Sacramento River
Receiving Water Type:	Inland Surface Water

- A.** The City of Anderson (hereinafter Discharger) is the owner and operator of the City of Anderson, Water Pollution Control Plant (hereinafter Facility), a Publicly-Owned Treatment Works (POTW).

For the purposes of this Order, references to the “discharger” or “permittee” in applicable federal and state laws, regulations, plans, or policy are held to be equivalent to references to the Discharger herein.

- B.** The Facility discharges wastewater to the Sacramento River, a water of the United States. The Discharger was previously regulated by Order R5-2019-0068 and National Pollutant Discharge Elimination System (NPDES) Permit No. NPDES CA0077704 adopted on 11 October 2019 and expired on 30 November 2024. Attachment B provides a map of the area around the Facility (Figure B-1) and a Facility Site Map (Figure B-2). Attachment C provides a flow schematic of the Facility.
- C.** When applicable, state law requires dischargers to file a petition with the State Water Board, Division of Water Rights and receive approval for any change in the point of discharge, place of use, or purpose of use of treated wastewater that decreases the flow in any portion of a watercourse. The State Water Board retains separate jurisdictional authority to enforce any applicable requirements under Water Code section 1211. This is not an NPDES permit requirement.
- D.** The Discharger filed a Report of Waste Discharge (ROWD) and submitted an application for reissuance of its waste discharge requirements (WDRs) and NPDES permit on 3 November 2023. The application was deemed complete on 21 December 2023. A site visit was conducted on 4 April 2023, to observe operations and collect additional data to develop permit limitations and requirements for waste discharge.
- E.** Regulations at 40 C.F.R. section 122.46 limit the duration of NPDES permits to a fixed term not to exceed five years. Accordingly, Table 3 of this Order limits the duration of the discharge authorization. Under 40 C.F.R. section 122.6(d), States authorized to administer the NPDES program may administratively continue State-issued permits beyond their expiration dates until the effective date of the new permits, if State law allows it. Pursuant to California Code of Regulations (CCR), title 23, section 2235.4, the terms and conditions of an expired permit are automatically continued pending reissuance of the permit if the Discharger complies with all federal NPDES requirements for continuation of expired permits.

II. FACILITY DESCRIPTION

The Discharger provides sewerage service for the community of the City of Anderson. The City of Anderson has a population of approximately 11,323; however, the Facility provides service to a population of approximately 7,774. The design daily average flow capacity of the Facility is 2.0 million gallons per day (MGD).

A. Description of Wastewater and Biosolids Treatment and Controls

The treatment system at the Facility consists of a headworks with one mechanical bar screen, a backup manual screen, a backup comminutor, two activated sludge aeration basins, two secondary clarifiers, one ballast pond to equalize flow to the pressure filters, three pressurized multi-media filtration units, one chlorine contact basin, and sulfur dioxide dechlorination. Treated effluent is discharged to the Sacramento River through a multiport diffuser.

Influent Pump Station & Headworks: The influent pump station is equipped with three dry pit submersible pumps with a pumping capacity of 2.5 MGD each. The headworks also has a 3.5 MGD natural gas emergency pump if the backup diesel power generator fails or flows exceed 7.5 MGD.

Bar Screen: The mechanical screen (Aqua Guard) removes large debris and rags. The headworks also includes a backup comminutor and a manual bar rake for screenings. In the event of a total screening failure, a high-level alarm will sound and notify the standby operator. The influent flow will eventually overflow into the emergency basin pipeline located at the headworks.

Complete Mix Activated Sludge: Flow from the headworks is distributed evenly between the two 420,000-gallon aeration basins. Detention times run from 4 to 8 hours, depending on flows.

Secondary Clarifiers: Flow from aeration basins enters a distribution box, dividing the flow to each clarifier. Surface loading rates range from 276 to 1,104 gallons per day per square foot. The return-activated sludge rate is 30% to 100% of the influent flow. Waste-activated sludge is pumped to the digester at 36,000 to 50,400 gallons daily. Scum and floatable are skimmed and pumped (approximately 3,000 gallons per week) to the aerobic digester.

Pressure Filtration: Clarifier effluent flows to an equalization ballast pond (290,000 gallons), where filter pumps draw from. Filters No.1 and No. 2 have a maximum flow rate of 1.7 MGD each, and filter No. 3 is 2 MGD. The filter's maximum surface loading rate is 5 gallons per minute per square foot. Backwash rates are 18,000 gallons to 25,000 gallons per backwash. A typical backwash occurs every 24 to 72 hours. Backwash flow is typically sent to the sludge stabilization ponds or can be routed to either aeration basins. A fourth pump (2 MGD) is available for bypass pumping to the chlorine contact chamber if emergency storage (5.3 MG) is at capacity and influent flow exceeds 6 MGD.

Chlorination: Two chlorinators supply a gas solution for disinfection with a maximum feed rate of 400 lbs/day. The dose is applied at the beginning of the 134,000-gallon chlorine contact chamber. Detention time during the average flow is around 2.5 hours. The chlorine gas solution can also be valved to the influent maintenance hole for odor control and is also used for pre-filtration, MLSS filamentous control, and algae control on clarifier launders.

De-chlorination: The effluent discharged from the chlorine contact chamber is dosed with a sodium bisulfite solution. The sodium bisulfite neutralizes any remaining chlorine to have a zero-chlorine residual, leaving the Facility. Between the two peristaltic chemical feed pumps, there is a combined max feed rate of 120 gallons/day.

Digester: The Facility has two aerobic digesters. Digester No. 1 has a capacity of 256,000 gallons, and Digester No. 2 has a capacity of 453,000 gallons. Currently, only Digester No. 2 is online. Approximately 36,000 to 46,000 gallons per day of waste-activated sludge is pumped to the digester daily. Every evening, an automatic decant valve opens to decant off the supernatant to one of the ponds. The digester is wasted twice weekly to one of the three sludge stabilization ponds at approximately 120,000 gallons weekly. Solids retention time is 25 days.

Sludge Stabilization Ponds and Drying Beds: Ponds receive digester decant, wasting, and filter backwash flows. The ponds are decanted back to the headworks at a maximum flow of 0.04 MGD. Ponds are dewatered in the spring to an empty pond. The solids are dried in the pond or in conjunction with the drying beds if solid levels are too high. The drying beds have an underdrain system that flows back to the headworks. Once the sludge has dried in ponds and beds, it is removed and trucked to the landfill.

Sludge stabilization ponds No. 3 and No. 4 are identical in specifications: total surface area is 1-acre, overall depth is 8.4 feet, design liquid depth is 6.4 feet and the total volume is 2 million gallons (each). The invert elevation is 395.85 feet. Sludge stabilization pond No. 5 has a total surface area of 1.75 acres, the overall depth is 8.33 feet, the design liquid depth is 6.33 feet and the total volume is 3.6 million gallons. The invert elevation for sludge stabilization pond No. 5 is 396.57 feet. The sludge stabilization ponds are typically operated in an annual rotation; sludge stabilization ponds No. 3 and No. 4 are operated concurrently when sludge stabilization pond No. 5 is offline, and vice versa. As a result, approximately every 18 months one or two of the ponds will be emptied of solids in the fall.

Sludge drying beds: The sludge drying beds have a total surface area of 30,000 square feet. Individual surface areas of the drying beds are as follows: Drying bed No. 1, No. 2, No. 3, and No. 4 are 7,000, 8,000, 8,000, and 7,000 square feet respectively. The sludge drying beds' overall depth is 26 inches and the design liquid depth is 16 inches.

The Facility also has two historic sludge stabilization ponds located northwest of the sludge drying beds. These ponds do not receive or return any flows from/to the treatment process and only receive precipitation.

Emergency Storage Pond: The Facility's emergency storage pond is only used in the event of catastrophic mechanical failures where sufficient treatment cannot be achieved prior to discharge or if there is a 100-year flood and the treatment plant is pushed beyond operational capacity and needs additional storage. In the event the

emergency storage pond is filled, there is an overflow from the emergency overflow pond piped to sludge stabilization ponds No. 3, No. 4, and No. 5. The sludge stabilization ponds can be used in emergency situations to increase storage capacity. The emergency storage pond stays empty year-round, not accounting for any rainfall accumulation.

The emergency storage pond has a total surface area of 1.5 acres, the overflow elevation is 403.8 feet, the pond bottom elevation is 396.0 feet, and the total volume is 3.8 million gallons.

Side streams: All other plant processes with minor flows or decants are piped back to headworks.

Storm Drainage: Plant stormwater is drained into the emergency storage pond and removed by pumping to the headworks if needed.

Unit Construction: The ballast pond was constructed in 1972 with concrete and rebar walls with an asphalt bottom. The ballast pond is inspected during cleaning, which typically occurs at least once per year. The Discharger has reported that no defects have been observed. Sludge stabilization ponds No. 3 and No. 4 were constructed in 1989. Both have concrete with rebar sides and asphalt bottoms. Sludge stabilization pond No. 5 was constructed in 2010 with concrete, rebar sides, and asphalt bottom. The sludge stabilization ponds are inspected when they are emptied, approximately every 18 months, in the fall. The Discharger has reported that no defects have been noted. The Discharger reports that they have not had to make any repairs to the original construction of these basins.

B. Discharge Points and Receiving Waters

1. The Facility is located in section 11, T30N, R4W, MDB&M, as shown in Attachment B, a part of this Order.
2. Treated municipal wastewater is discharged at Discharge Point 001 to the Sacramento River a water of the United States at a point latitude 40° 28' 8" N and longitude 122° 16' 45" W.

C. Summary of Existing Requirements and Self-Monitoring Report (SMR) Data

Effluent limitations contained in Order R5-2019-0068 for discharges from Describe Discharge Point 001 (Monitoring Location EFF-001 and representative monitoring data from the term of Order R5-2019-0068 are as follows:

Table F-2 Historic Effluent Limitations (January 2020- February 2024)

Parameter	Units	Historic Effluent Limitations	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge
Ammonia, Total (as N)	mg/L	AMEL 5.4 AWEL 11	2.01 (6/30/2021)	1.46 (4/16/2023)	--
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	AMEL 10 AWEL 15	3.75 (2/28/2022)	14 (5/31/2021)	--
Total Suspended Solids (TSS)	mg/L	AMEL 10 AWEL 15	5 (12/31/2023)	11.3 (5/31/2022)	--
pH	SU	Instantaneous Max 8.5 Instantaneous Min 6.0	--	--	Instantaneous Max 7.18 (6/13/2022) Instantaneous Min 6.42 (12/11/2023)
Copper, Total Recoverable	µg/L	AMEL 22 MDEL 32	10.1 (12/31/2021)	--	9.2 (10/5/2023)
Cyanide	µg/L	AMEL 70 MDEL 140	9.8 (1/31/2024)	--	9.8 (1/4/2024)
Chlorodibromomethane	µg/L	AMEL 14 MDEL 36	2.08 (1/31/2020)	--	0.5 (6/1/2023)
Dichlorobromomethane	µg/L	AMEL 31 MDEL 59	10.1 (7/31/2022)	--	4.6 (12/7/2023)
Electrical Conductivity @ 25°C	µmhos/cm	430 Annual Average	--	--	416 (max annual average 2022)
Nitrate plus Nitrite, Total (as N)	mg/L	AMEL 40 AWEL 64	15.2 (10/31/2022)	11.7 (10/29/2023)	--
Zinc, Total Recoverable	µg/L	AMEL 85 MDEL 130	67.1 (4/30/2022)	--	67 (11/3/2022)
Total Residual Chlorine.	mg/L	0.011 as a 4-day average 0.019 mg/L, as a 1-hour average	0.009 (4-day average)	--	0.009 (1-hour average).

Parameter	Units	Historic Effluent Limitations	Highest Average Monthly Discharge	Highest Average Weekly Discharge	Highest Daily Discharge
Total Coliform Organisms	MPN/100 mL	23 as a 7-day median 240 more than once in any 30-day period	--	130 (7-day median, 4/3/2021)	--

Table F-2 Notes:

1. The average monthly percent removal of 5-day biochemical oxygen demand (BOD5) and total suspended solids (TSS) shall not be less than 85 percent.

D. Compliance Summary

1. **2024 July 18, Notice of Violation.** Effluent limit violations (April 2021 – April 2024) for total coliform.

E. Planned Changes

The Discharger has contracted with an engineering firm to prepare and submit a grant application to the Clean Water State Revolving Fund to upgrade the city's collection system and wastewater treatment plant. The entire scope of the project is yet to be determined. The application has been in progress since September 2023.

III. APPLICABLE PLANS, POLICIES, AND REGULATIONS

The requirements contained in this Order are based on the requirements and authorities described in this section.

A. Legal Authorities

This Order serves as WDRs pursuant to article 4, chapter 4, division 7 of the California Water Code (commencing with section 13260). This Order is also issued pursuant to section 402 of the federal Clean Water Act (CWA) and implementing regulations adopted by the U.S. EPA and chapter 5.5, division 7 of the Water Code (commencing with section 13370). It shall serve as an NPDES permit for point source discharges from this Facility to surface waters.

B. California Environmental Quality Act (CEQA)

Under Water Code section 13389, this action to adopt an NPDES permit is exempt from the provisions of Chapter 3 of CEQA, (commencing with section 21100) of Division 13 of the Public Resources Code. Additionally, the adoption of land discharge requirements for the Facility constitutes permitting of an existing facility that is categorically exempt from the provisions of CEQA pursuant to CCR, title 14, section 15301.

C. State and Federal Laws, Regulations, Policies, and Plans

1. **Water Quality Control Plan.** Requirements of this Order specifically implement the applicable Water Quality Control Plans.
 - a. Basin Plan. The Central Valley Water Board adopted a Water Quality Control Plan for the Sacramento River and San Joaquin River Basins, Fifth Edition, February 2019 (hereinafter Basin Plan) (hereinafter Basin Plan) that designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. Requirements in this Order implement the Basin Plan. In addition, the Basin Plan implements State Water Board Resolution 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply. Beneficial uses applicable to the Sacramento River are as follows:

Table F-3 Basin Plan Beneficial Uses

Discharge Point	Receiving Water Name	Beneficial Use(s)
001	Sacramento River (Shasta Dam to Colusa Basin Drain)	<u>Existing:</u> Municipal and domestic supply (MUN); agricultural supply, including irrigation and stock watering (AGR); industrial service supply (IND); industrial power supply (POW); water contact recreation, including canoeing and rafting (REC-1); non-contact water recreation (REC-2); warm freshwater habitat (WARM); cold freshwater habitat (COLD); migration of aquatic organisms, warm and cold (MIGR); spawning, reproduction, and/or early development, warm and cold (SPWN); wildlife habitat (WILD); and navigation (NAV).

- b. **Water Quality Control Plan for Inland Surface Waters, Enclosed Bays, and Estuaries of California.** The Water Quality Control Plan for Inland Surface Waters, Enclosed Bays, and Estuaries of California (ISWEBE Plan) was adopted by the State Water Resources Control Board (State Water Board) on 1 December 2020, under authority provided by Water Code sections 13140 and 13170. Except as otherwise indicated, this ISWEBE Plan establishes provisions for toxicity, water quality and sediment quality that apply to all inland surface waters, enclosed bays, and estuaries and coastal lagoons of the state, including both waters of the United States and surface waters of the state.

2. **National Toxics Rule (NTR) and California Toxics Rule (CTR).** U.S. EPA adopted the NTR on 22 December 1992, and later amended it on 4 May 1995 and 9 November 1999. About forty criteria in the NTR applied in California. On 18 May 2000, U.S. EPA adopted the CTR. The CTR promulgated new toxics criteria for California and, in addition, incorporated the previously adopted NTR criteria that were applicable in the state. The CTR was amended on 13 February 2001. These rules contain federal water quality criteria for priority pollutants.
3. **State Implementation Policy.** On 2 March 2000, the State Water Board adopted the Policy for Implementation of Toxics Standards for Inland Surface Waters, Enclosed Bays, and Estuaries of California (State Implementation Policy or SIP). The SIP became effective on 28 April 2000, with respect to the priority pollutant criteria promulgated for California by the U.S. EPA through the NTR and to the priority pollutant objectives established by the Central Valley Water Board in the Basin Plan. The SIP became effective on 18 May 2000, with respect to the priority pollutant criteria promulgated by the U.S. EPA through the CTR. The State Water Board adopted amendments to the SIP on 24 February 2005, that became effective on 13 July 2005. The SIP establishes implementation provisions for priority pollutant criteria and objectives and provisions for chronic toxicity control. Requirements of this Order implement the SIP.
4. **Antidegradation Policy.** Federal regulation 40 C.F.R. section 131.12 requires that the state water quality standards include an antidegradation policy consistent with the federal policy. The State Water Board established California's antidegradation policy in State Water Board Resolution 68-16 ("Statement of Policy with Respect to Maintaining High Quality of Waters in California") (State Anti-Degradation Policy). The State Anti-Degradation Policy is deemed to incorporate the federal antidegradation policy where the federal policy applies under federal law. The State Anti-Degradation Policy requires that existing water quality be maintained unless degradation is justified based on specific findings. The Central Valley Water Board's Basin Plan implements, and incorporates by reference, both the State and federal antidegradation policies. The permitted discharge must be consistent with the antidegradation provision of 40 C.F.R. section 131.12 and the State Anti-Degradation Policy. The Board finds this order is consistent with the Federal and State Water Board antidegradation regulations and policy.
5. **Anti-Backsliding Requirements.** Sections 402(o) and 303(d)(4) of the CWA and federal regulations at 40 C.F.R. section 122.44(l) restrict backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed.
6. **Domestic Water Quality.** In compliance with Water Code section 106.3, it is the policy of the State of California that every human being has the right to

safe, clean, affordable, and accessible water adequate for human consumption, cooking, and sanitary purposes. This Order promotes that policy by requiring discharges to meet maximum contaminant levels (MCLs) designed to protect human health and ensure that water is safe for domestic use.

7. **Endangered Species Act Requirements.** This Order does not authorize any act that results in the taking of a threatened or endangered species or any act that is now prohibited, or becomes prohibited in the future, under either the California Endangered Species Act (Fish and Game Code, sections 2050 to 2097) or the Federal Endangered Species Act (16 U.S.C.A. sections 1531 to 1544). This Order requires compliance with effluent limits, receiving water limits, and other requirements to protect the beneficial uses of waters of the state.
8. **Emergency Planning and Community Right to Know Act.** Section 13263.6(a) of the Water Code, requires that “the Regional Water Board shall prescribe effluent limitations as part of the waste discharge requirements of a POTW for all substances that the most recent toxic chemical release data reported to the state emergency response commission pursuant to section 313 of the Emergency Planning and Community Right to Know Act of 1986 (42 U.S.C. Sec. 11023) (EPCRA) indicate as discharged into the POTW, for which the State Water Board or the Regional Water Board has established numeric water quality objectives, and has determined that the discharge is or may be discharged at a level which will cause, have the reasonable potential to cause, or contribute to, an excursion above any numeric water quality objective”.

The most recent toxic chemical data report does not indicate any reportable off-site releases or discharges to the collection system for this Facility. Therefore, a reasonable potential analysis based on information from EPCRA cannot be conducted. Based on information from EPCRA, there is no reasonable potential to cause or contribute to an excursion above any numeric water quality objectives included within the Basin Plan or in any State Water Board plan, so no effluent limitations are included in this permit pursuant to Water Code section 13263.6(a).

However, as detailed elsewhere in this Order, available effluent data indicate that there are constituents present in the effluent that have a reasonable potential to cause or contribute to exceedances of water quality standards and require inclusion of effluent limitations based on federal and state laws and regulations.

9. **Storm Water Requirements.** U.S. EPA promulgated federal regulations for storm water on 16 November 1990 in 40 C.F.R. parts 122, 123, and 124. The NPDES Industrial Storm Water Program regulates storm water discharges from wastewater treatment facilities. Wastewater treatment plants are applicable industries under the storm water program and are obligated to comply with the

federal regulations. The State Water Resources Control Board Water Quality Order 2014-0057-DWQ, General Permit for Storm Water Discharges Associated with Industrial Activities (NPDES General Permit No. CAS000001), does not require facilities to obtain coverage if discharges of storm water are regulated under another individual or general NPDES permit adopted by the State Water Board or Regional Water Board (Finding I.B.20). All storm water at the Facility is captured and directed to the Facility headworks for treatment and disposal under this Order. Therefore, coverage under the General Storm Water Permit is not required.

11. **Statewide General Waste Discharge Requirements for Sanitary Sewer Systems.** The State Water Board issued General Waste Discharge Requirements for Sanitary Sewer Systems, Water Quality Order 2006-0003-DWQ (General Order) on 2 May 2006. The State Water Board amended the MRP for the General Order through Order WQ 2013-0058-EXEC on 6 August 2013. The General Order requires public agencies that own or operate sanitary sewer systems with greater than 1 mile of pipes or sewer lines to enroll for coverage under the General Order. The General Order requires agencies to develop sanitary sewer management plans (SSMPs) and report all sanitary sewer overflows (SSOs), among other requirements and prohibitions.

The Discharger is subject to the requirements of, and must comply with, State Water Board Order 2006-0003-DWQ, Statewide General Waste Discharge Requirements for Sanitary Sewer Systems, as amended by State Water Board Order WQ 2013-0058-EXEC and any subsequent order.

12. **Sewage Sludge and Biosolids.** This Order does not authorize any act that results in violation of requirements administered by U.S. EPA to implement 40 C.F.R. Part 503, Standards for the Use or Disposal of Sewage Sludge. These standards regulate the final use or disposal of sewage sludge that is generated during the treatment of domestic sewage in a municipal wastewater treatment facility. The Discharger is responsible for meeting all applicable requirements of 40 C.F.R. Part 503 that are under U.S. EPA's enforcement authority.

D. Impaired Water Bodies on CWA 303(d) List

1. Under section 303(d) of the 1972 CWA, states, territories, and authorized tribes are required to develop lists of water quality limited segments. The waters on these lists do not meet water quality standards, even after point sources of pollution have installed the minimum required levels of pollution control technology. On 11 May 2022 U.S. EPA gave final approval to California's 2020 – 2022 section 303(d) List of Water Quality Limited Segments. The Basin Plan references this list of Water Quality Limited Segments (WQLSs), which are defined as "...those sections of lakes, streams, rivers or other fresh water bodies where water quality does not meet (or is not expected to meet) water quality standards even after the application of appropriate limitations for point

sources (40 C.F.R. part 130, et seq.).” The Basin Plan also states, “Additional treatment beyond minimum federal standards will be imposed on dischargers to [WQLSs]. Dischargers will be assigned or allocated a maximum allowable load of critical pollutants so that water quality objectives can be met in the segment.” The listing for the Sacramento River from Keswick Dam to Cottonwood Creek includes: temperature and unknown toxicity

2. **Total Maximum Daily Loads (TMDLs).** Table F-4, below, identifies the 303(d) listings and any applicable TMDLs.

Table F-4 303 (d) List for the Sacramento River from Keswick to Cottonwood Creek

Pollutant	Potential Sources	TMDL Status
Temperature	Source Unknown	2033
Toxicity	Source Unknown	2019 - Not Completed

3. The 303(d) listings and TMDLs have been considered in the development of the Order.

E. Other Plans, Polices and Regulations

1. **Title 27.** The discharge authorized herein, and the treatment and storage facilities associated with the discharge of treated municipal wastewater, except for discharges of residual sludge and solid waste, are exempt from the requirements of Title 27, CCR, section 20005 et seq (hereafter Title 27). The exemption, pursuant to Title 27 CCR section 20090(a), is based on the following:
 - a. The waste consists primarily of domestic sewage and treated effluent;
 - b. The waste discharge requirements are consistent with water quality objectives; and
 - c. The treatment and storage facilities described herein are associated with a municipal wastewater treatment plant.

IV. RATIONALE FOR EFFLUENT LIMITATIONS AND DISCHARGE SPECIFICATIONS

The CWA requires point source dischargers to control the amount of conventional, non-conventional, and toxic pollutants that are discharged into the waters of the United States. The control of pollutants discharged is established through effluent limitations and other requirements in NPDES permits. There are two principal bases for effluent limitations in the Code of Federal Regulations: 40 C.F.R. section 122.44(a) requires that permits include applicable technology-based limitations and standards; and 40 C.F.R. section 122.44(d) requires that permits include water quality-based effluent limitations to attain and maintain applicable numeric and narrative water quality criteria to protect the beneficial uses of the receiving water.

A. Discharge Prohibitions

1. **Prohibition III.A (No discharge or application of waste other than that described in this Order).** This prohibition is based on Water Code section 13260 that requires filing of a ROWD before discharges can occur. The Discharger submitted a ROWD for the discharges described in this Order; therefore, discharges not described in this Order are prohibited.
2. **Prohibition III.B (No bypasses or overflow of untreated wastewater, except under the conditions at CFR section 122.41(m)(4)).** As stated in section I.G of Attachment D, Standard Provisions, this Order prohibits bypass from any portion of the treatment facility. Federal regulations, 40 C.F.R. section 122.41(m), define “bypass” as the intentional diversion of waste streams from any portion of a treatment facility. This section of the federal regulations, 40 C.F.R. section 122.41(m)(4), prohibits bypass unless it is unavoidable to prevent loss of life, personal injury, or severe property damage. In considering the Regional Water Board’s prohibition of bypasses, the State Water Board adopted a precedential decision, Order No. WQO 2002-0015, which cites the federal regulations, 40 C.F.R. section 122.41(m), as allowing bypass only for essential maintenance to assure efficient operation.
3. **Prohibition III.C (No controllable condition shall create a nuisance).** This prohibition is based on Water Code section 13050 that requires water quality objectives established for the prevention of nuisance within a specific area. The Basin Plan prohibits conditions that create a nuisance
4. **Prohibition III.D (No discharge of hazardous waste).** This prohibition is based on CCR, title 22, section 66261.1 et seq, that prohibits discharge of hazardous waste.
5. **Prohibition III.E (Average Dry Weather Flow).** This prohibition is based on the design average dry weather flow treatment capacity rating for the Facility and ensures the Facility is operated within its treatment capacity. Previous Order R5-2019-0068 included flow as an effluent limit based on the Facility design flow. Flow is not a pollutant and therefore has been changed from an effluent limit to a discharge prohibition in this Order, which is an equivalent level of regulation. This Order is not less stringent because compliance with flow as a discharge prohibition will be calculated the same way as the previous Order.

B. Technology-Based Effluent Limitations

1. Scope and Authority

Section 301(b) of the CWA and implementing U.S. EPA permit regulations at 40 C.F.R. section 122.44 require that permits include conditions meeting applicable technology-based requirements at a minimum, and any more stringent effluent limitations necessary to meet applicable water quality standards. The discharge authorized by this Order must meet minimum federal

technology-based requirements based on Secondary Treatment Standards at 40 C.F.R. part 133.

Regulations promulgated in 40 C.F.R. section 125.3(a)(1) require technology-based effluent limitations for municipal Dischargers to be placed in NPDES permits based on Secondary Treatment Standards or Equivalent to Secondary Treatment Standards.

The Federal Water Pollution Control Act Amendments of 1972 (PL 92-500) established the minimum performance requirements for POTWs [defined in section 304(d)(1)]. Section 301(b)(1)(B) of that Act requires that such treatment works must, as a minimum, meet effluent limitations based on secondary treatment as defined by the U.S. EPA Administrator.

Based on this statutory requirement, U.S. EPA developed secondary treatment regulations, which are specified in 40 C.F.R. part 133. These technology-based regulations apply to all municipal wastewater treatment plants and identify the minimum level of effluent quality attainable by secondary treatment in terms of BOD₅, TSS, and pH.

2. **Applicable Technology-Based Effluent Limitations**

- a. **BOD₅ and TSS.** Federal regulations at 40 C.F.R. part 133, establish the minimum weekly and monthly average level of effluent quality attainable by secondary treatment for BOD₅ and TSS. A daily maximum effluent limitation for BOD₅ and TSS is also included in the Order to ensure that the treatment works are not organically overloaded and operate in accordance with design capabilities. In addition, 40 C.F.R. section 133.102, in describing the minimum level of effluent quality attainable by secondary treatment, states that the 30-day average percent removal shall not be less than 85 percent. This Order contains a limitation requiring an average of 85 percent removal of BOD₅ and TSS over each calendar month.
- b. **pH.** The secondary treatment regulations at 40 C.F.R. part 133 also require that pH be maintained between 6.0 and 9.0 standard units. This Order, however, requires more stringent WQBELs for pH to comply with the Basin Plan's water quality objectives for pH.

**Summary of Technology-based Effluent Limitations
 Discharge Point 001**

Table F-5 Summary of Technology-based Effluent Limitations

Parameter	Units	Effluent Limitations
BOD5	mg/L	AMEL 30 AWEL 45
BOD5	Percent Removal	85
TSS	mg/L	AMEL 30 AWEL 45
TSS	Percent Removal	85
pH	Standard Units	Instantaneous Max 9.0 Instantaneous Min 6.0

Table F-5 Notes:

- Note that more stringent WQBELs for BOD₅, pH, and TSS are applicable and are established as final effluent limitations in this Order (see section IV.C.3 of this Fact Sheet).

C. Water Quality-Based Effluent Limitations (WQBELs)

1. Scope and Authority

CWA section 301(b) and 40 C.F.R. section 122.44(d) require that permits include limitations more stringent than applicable federal technology-based requirements where necessary to achieve applicable water quality standards. This Order contains requirements, expressed as a technology equivalence requirement, more stringent than secondary treatment requirements that are necessary to meet applicable water quality standards. The rationale for these requirements, which consist of advanced-secondary treatment or equivalent requirements, is discussed in section IV.C.3 of this Fact Sheet.

Section 122.44(d)(1)(i) of 40 C.F.R. requires that permits include effluent limitations for all pollutants that are or may be discharged at levels that have the reasonable potential to cause or contribute to an exceedance of a water quality standard, including numeric and narrative objectives within a standard. Where reasonable potential has been established for a pollutant, but there is no numeric criterion or objective for the pollutant, WQBELs must be established using: (1) U.S. EPA criteria guidance under CWA section 304(a), supplemented where necessary by other relevant information; (2) an indicator parameter for the pollutant of concern; or (3) a calculated numeric water quality criterion, such as a proposed state criterion or policy interpreting the state’s narrative criterion,

supplemented with other relevant information, as provided in section 122.44(d)(1)(vi).

The process for determining reasonable potential and calculating WQBELs when necessary is intended to protect the designated beneficial uses of the receiving water as specified in the Basin Plan and achieve applicable water quality objectives and criteria that are contained in other state plans and policies, or any applicable water quality criteria contained in the CTR and NTR.

Finally, 40 C.F.R. section 122(d)(1)(vii) requires effluent limits to be developed consistent with any available WLAs developed and approved for the discharge.

2. Applicable Beneficial Uses and Water Quality Criteria and Objectives

The Basin Plan designates beneficial uses, establishes water quality objectives, and contains implementation programs and policies to achieve those objectives for all waters addressed through the plan. In addition, the Basin Plan implements State Water Board Resolution No. 88-63, which established state policy that all waters, with certain exceptions, should be considered suitable or potentially suitable for municipal or domestic supply.

The Basin Plan on page 2-1 states: "Protection and enhancement of existing and potential beneficial uses are primary goals of water quality planning..." and with respect to disposal of wastewaters states that "...disposal of wastewaters is [not] a prohibited use of waters of the State; it is merely a use which cannot be satisfied to the detriment of beneficial uses."

The federal CWA section 101(a)(2), states: "it is the national goal that wherever attainable, an interim goal of water quality which provides for the protection and propagation of fish, shellfish, and wildlife, and for recreation in and on the water be achieved by July 1, 1983." Federal Regulations, developed to implement the requirements of the CWA, create a rebuttable presumption that all waters be designated as fishable and swimmable. Federal Regulations, 40 CFR sections 131.2 and 131.10, require that all waters of the State regulated to protect the beneficial uses of public water supply, protection and propagation of fish, shellfish and wildlife, recreation in and on the water, agricultural, industrial and other purposes including navigation. 40 C.F.R. section 131.3(e) defines existing beneficial uses as those uses actually attained after 28 November 1975, whether or not they are included in the water quality standards. Federal Regulation, 40 C.F.R. section 131.10 requires that uses be obtained by implementing effluent limitations, requires that all downstream uses be protected and states that in no case shall a state adopt waste transport or waste assimilation as a beneficial use for any waters of the United States.

- a. **Receiving Water and Beneficial Uses.** Refer to III.C.1. above for a complete description of the receiving water and beneficial uses.

- b. **Effluent and Ambient Background Data.** The reasonable potential analysis (RPA), as described in section IV.C.3 of this Fact Sheet, was based on data from 1 January 2021 through 29 February 2024, unless otherwise noted, which includes effluent and ambient background data submitted in SMRs and with the Report of Waste Discharge (ROWD).

Receiving water total recoverable and dissolved data for copper and zinc was utilized in the analysis of background data. There were three instances where laboratory analysis reported the concentrations of dissolved zinc in the receiving water in exceedance with the corresponding total recoverable concentrations. The subject sample dates were 7 July 2022, 3 August 2023 and 7 September 2023. Zinc data from these three samples dates were excluded from the analysis as a result.

- c. **Assimilative Capacity/Mixing Zone**

- i. The CWA directs the states to adopt water quality standards to protect the quality of its waters. U.S. EPA's current water quality standards regulation authorizes states to adopt general policies, such as mixing zones, to implement state water quality standards (40 CFR sections 122.44 and 122.45). The U.S. EPA allows states to have broad flexibility in designing its mixing zone policies. Primary policy and guidance on determining mixing zone and dilution credits is provided by the SIP and the Basin Plan. If no procedure applies in the SIP or the Basin Plan, then the Central Valley Water Board may use the U.S. EPA Technical Support Document for Water Quality-Based Toxics Control (EPA/505/2-90-001) (TSD).

For non-Priority Pollutant constituents, the allowance of mixing zones by the Central Valley Water Board is discussed in the Basin Plan, Policy for Application of Water Quality Objectives, which states the following, in part: *"In conjunction with the issuance of NPDES and storm water permits, the Regional Board may designate mixing zones within which water quality objectives will not apply provided the discharger has demonstrated to the satisfaction of the Regional Board that the mixing zone will not adversely impact beneficial uses. If allowed, different mixing zones may be designated for different types of objectives, including, but not limited to, acute aquatic life objectives, chronic aquatic life objectives, human health objectives, and acute and chronic whole effluent toxicity objectives, depending in part on the averaging period over which the objectives apply. In determining the size of such mixing zones, the Regional Board will consider the applicable procedures and guidelines in the EPA's Water Quality Standards Handbook and the [TSD]. Pursuant to EPA guidelines, mixing zones designated for acute aquatic life objectives*

will generally be limited to a small zone of initial dilution in the immediate vicinity of the discharge.”

For Priority Pollutants, the SIP supersedes the Basin Plan mixing zone provisions. Section 1.4.2 of the SIP states, in part, “...with the exception of effluent limitations derived from TMDLs, in establishing and determining compliance with effluent limitations for applicable human health, acute aquatic life, or chronic aquatic life priority pollutant criteria/objectives or the toxicity objective for aquatic life protection in a basin plan, the Regional Board may grant mixing zones and dilution credits to dischargers...The applicable priority pollutant criteria and objectives are to be met through a water body except within any mixing zone granted by the Regional Board.

The allowance of mixing zones is discretionary and shall be determined on a discharge-by-discharge basis. The Regional Board may consider allowing mixing zones and dilution credits only for discharges with a physically identifiable point of discharge that is regulated through an NPDES permit issued by the Regional Board.” [emphasis added]

For incompletely mixed discharges, the Discharger must complete an independent mixing zone study to demonstrate to the Central Valley Water Board that a dilution credit is appropriate. In granting a mixing zone, section 1.4.2.2 of the SIP requires the following to be met:

“A mixing zone shall be as small as practicable. The following conditions must be met in allowing a mixing zone:

A mixing zone shall not:

1. *compromise the integrity of the entire water body;*
2. *cause acutely toxic conditions to aquatic life passing thorough the mixing zone;*
3. *restrict the passage of aquatic life;*
4. *adversely impact biologically sensitive or critical habitats, including, but not limited to, habitat of species listed under federal or State endangered species laws;*
5. *produce undesirable or nuisance aquatic life;*
6. *result in floating debris, oil, or scum;*
7. *produce objectionable color, odor, taste, or turbidity;*
8. *cause objectionable bottom deposits;*
9. *cause nuisance;*

10. *dominate the receiving water body or overlap a mixing zone from different outfalls; or*
11. *be allowed at or near any drinking water intake. A mixing zone is not a source of drinking water. To the extent of any conflict between this determination and the Sources of Drinking Water Policy (Resolution No. 88-63), this SIP supersedes the provisions of that policy.”*

Section 1.4.2.1 of the SIP establishes the authority for the Central Valley Water Board to consider dilution credits based on the mixing zone conditions in a receiving water. Section 1.4.2.1 in part states:

*“The dilution credit, D, is a numerical value associated with the mixing zone that accounts for the receiving water entrained into the discharge. The dilution credit is a value used in the calculation of effluent limitations (described in section 1.4). **Dilution credits may be limited or denied on a pollutant-by-pollutant basis, which may result in a dilution credit for all, some, or no priority pollutants in the discharge.**”*

ii. **Sacramento River and Outfall Characteristics**

The Facility discharges to the Sacramento River approximately 18 miles downstream of Keswick Dam. The river channel width at the location of the diffuser is at least 359 feet at any receiving water flow. The Facility’s effluent outfall multi-port diffuser extends under the surface water, approximately 30 feet northward from the south bank of the Sacramento River. The diffuser consists of an 18-inch (outside diameter) steel pipe with six 8-inch torch-cut holes (or ports) facing downstream and a seventh similarly sized hole at the end of the pipe pointed northward toward the middle of the river. There are approximately 5 to 7 inches in width between each port. The outfall was designed in 1972 and has been in service after construction in 1974. The harmonic mean flow (1982-2023) of the Sacramento River is 6,410 cfs and the average dry weather flow design capacity of the discharge is 2.0 MGD.

- iii. **Dilution/Mixing Zone Study Results.** As described below, the Discharger submitted an initial Mixing Zone Study modeling report and Dye Study in 2006 to determine mixing zone sizes and dilution ratios achieved within each mixing zone. The Discharger submitted an update to the 2006 Mixing Zone Study in July 2012 which provided dilution ratios for additional delineations within the mixing zone.

(a) **2006 Modeling Studies.** The Discharger submitted a Mixing Zone Study report on 7 June 2006. The Mixing Zone Study

implemented the numeric Cornell Mixing Zone Expert System (CORMIX) computer model to calculate dilution of effluent downstream from the point of discharge into the receiving water. A Dye Study was conducted on 27 January 2006 to provide a comparison to the modeling results.

The 2006 Mixing Zone Study was based on critical effluent flows and critical receiving water flows for combined data from Keswick Dam in Redding (Station No. 11370500) and Clear Creek approximately 10 miles before its confluence with the Sacramento River (Station No. 11372000). The Discharger reviewed data from these stations based on current operating agreements and historical flow data. The Discharger also made adjustments for withdrawals by the Anderson-Cottonwood Irrigation District upstream of the discharge. Information provided in the 2006 Mixing Zone Study is provided in the table below.

- (b) 2012 Mixing Zone Study Update.** The Discharger provided an update to the 2006 Mixing Zone Study with additional dilution delineations from 5 to 800 feet. The Discharger also provided a Biological Evaluation of potential impacts to biological resources as a result of a mixing zone. The Biological Evaluation concluded that a mixing zone up to 300 feet was protective of aquatic life. California Department of Fish and Wildlife reviewed and concurred with the findings of the Biological Evaluation.

A subset of the results presented in the Discharger’s 2012 Mixing Zone Study Update, and referenced in this Order, are summarized in the table below:

Table F-6. Mixing Zone/Dilution Study Results

Distance Downstream (ft.)	Acute Dilution Factor	Chronic Dilution Factor	Human Health Dilution Factor
10	5.2	13.9	38.8
30	5.7	14.9	54.8
200	9.4	22.2	110.2
300	10.7	25.6	132.1

- (c) Conversion Factors.** The CTR contains aquatic life criteria for arsenic, cadmium, chromium III, chromium VI, copper, lead, nickel, silver, and zinc which are presented in dissolved concentrations. U.S. EPA recommends conversion factors to translate dissolved concentrations to total concentrations. For priority pollutant metals, the SIP requires the use of U.S. EPA conversion factors contained in Appendix 3 to convert the applicable dissolved criteria to total recoverable criteria.

Alternatively, the SIP allows the use of site-specific metals translators that “...can be developed from field data by either direct determination of the fraction dissolved, or by development of a site-specific partition coefficient that relates the fraction dissolved to ambient background conditions such as pH, suspended load, or organic carbon.”

Order R5-2019-0068 allowed site-specific metals translators for copper and zinc based on a July 2012 translator study and a 1 February 2019 translator study update. Receiving water data was collected from monitoring location RSW-001 and tested for total recoverable and dissolved copper and zinc. The Central Valley finds that the proposed translators are appropriate, and the 2019 updated translators have been used for copper and zinc in this Order.

Table F-7 below summarizes the site-specific translators: Aquatic Life Criteria.

Table F-7. Site-Specific Translators for Copper and Zinc

Condition	Copper Translator	Zinc Translator
Chronic (Median)	0.69	0.59
Acute (90 th Percentile)	0.81	0.72

The default U.S. EPA conversion factors contained in Appendix 3 of the SIP were used to convert the applicable dissolved criteria to total recoverable criteria for the remaining metals.

- iv. **Evaluation of Available Dilution for Human Health Criteria.**
 The SIP requires a mixing zone must be as small as practicable and comply with eleven (11) mixing zone prohibitions under section 1.4.2.2.A. Based on Central Valley Water Board staff evaluation, the mixing zone extends up to 300 feet downstream of the Facility’s outfall and a maximum available dilution credit of 132 meets the eleven prohibitions of the SIP as follows:

- (1) Shall not compromise the integrity of the entire water body – The TSD states that, “*If the total area affected by elevated concentrations within all mixing zones combined is small compared to the total area of a water body (such as a river segment), then mixing zones are likely to have little effect on the integrity of the water body as a whole, provided that the mixing zone does not impinge on unique or critical habitats.*” The mixing zone is not applicable to

aquatic life criteria. The mixing zone does not compromise the integrity of the entire water body.

- (2) Shall not cause acutely toxic conditions to aquatic life passing through the mixing zone – The mixing zone is not applicable to aquatic life criteria. Therefore, acutely toxic conditions will not occur in the mixing zone.
- (3) Shall not restrict the passage of aquatic life – The human health mixing zone is not applicable to aquatic life criteria. Therefore, the mixing zone will not restrict the passage of aquatic life.
- (4) Shall not adversely impact biologically sensitive or critical habitats, including, but not limited to, habitat of species listed under federal or State endangered species laws – The mixing zone is not applicable to aquatic life criteria. The mixing zone will not impact biologically sensitive or critical habitats.
- (5-9) Shall not produce undesirable or nuisance aquatic life; result in floating debris, oil, or scum; produce objectionable color, odor, taste, or turbidity; cause objectionable bottom deposits; cause nuisance – The allowance of the mixing zone will not produce undesirable or nuisance aquatic life, result in floating debris, oil, or scum; produce objectionable color, odor, taste, or turbidity; cause objectionable bottom deposits; or cause nuisance. This Order requires the discharge to meet advanced secondary treatment, which will ensure continued compliance with these mixing zone requirements. Therefore, the allowance of the mixing zone will not produce undesirable or nuisance aquatic life, result in floating debris, oil, or scum; produce objectionable color, odor, taste, or turbidity; cause objectionable bottom deposits, or cause nuisance.
- (10) Shall not dominate the receiving water body or overlap a mixing zone from different outfalls – The mixing zone is small relative to the water body, so it will not dominate the water body. Furthermore, the mixing zone does not overlap mixing zones from other outfalls. There are no outfalls or mixing zones in the vicinity of the discharge.
- (11) Shall not be allowed at or near any drinking water intake – The mixing zone is not near a drinking water intake.

A pollutant-by-pollutant evaluation is provided in subsection vi below to evaluate whether the mixing zones

for each pollutant are as small as practicable and comply with the State and federal antidegradation requirements.

- v. **Evaluation of Available Dilution for Acute and Chronic Aquatic Life Criteria.** The SIP requires a mixing zone must be as small as practicable and comply with eleven (11) prohibitions under section 1.4.2.2.A. Based on Central Valley Water Board staff evaluation, the mixing zones extend up to 300 feet downstream of the Facility's outfall diffuser and a maximum available acute dilution credit of 10.7 and a maximum available chronic dilution credit of 25.6 are available and meet the eleven prohibitions of the SIP as follows:
- (1) Shall not compromise the integrity of the entire water body – The TSD states that, “If the total area affected by elevated concentrations within all mixing zones combined is small compared to the total area of a water body (such as a river segment), then mixing zones are likely to have little effect on the integrity of the water body as a whole, provided that the mixing zone does not impinge on unique or critical habitats.” The Sacramento River is approximately 380 feet wide at the diffuser. The largest mixing zone (acute aquatic-life) of 300 feet is less than 20 feet wide near the diffuser outfall and is estimated to be less than 13 feet wide at the furthest downstream edge of the mixing zone. The mixing zones are small relative to the waterbody and do not compromise the integrity of the entire waterbody.
 - (2) Shall not cause acutely toxic conditions to aquatic life passing through the mixing zone – The SIP requires that the acute mixing zone be appropriately sized to prevent lethality to organisms passing through the mixing zone. U.S. EPA recommends that float times through a mixing zone less than 15 minutes ensures that there will not be lethality to passing organisms. The acute mixing zone allowed in this Order extends 300 feet downstream from the diffuser. The float time at critical low receiving water flow conditions is less than 2.0 minutes. In addition, this Order includes an acute toxicity effluent limitation that requires compliance to be determined based on acute bioassays using 100% effluent. Compliance with these requirements ensures that acutely toxic conditions to aquatic life passing through the acute and chronic mixing zones do not occur.

- (3) Shall not restrict the passage of aquatic life – The Discharger conducted a mixing zone study to evaluate the near-field effects of the discharge. The Discharger evaluated the zone of passage around the mixing zone where water quality objectives are met. The result of the mixing zone study indicates there is an adequate zone of passage for aquatic life that is at least 79 percent of the width (approximately 300 feet) of the Sacramento River.
- (4) Shall not adversely impact biologically sensitive or critical habitats, including, but not limited to, habitat of species listed under federal or State endangered species laws – The acute and chronic mixing zones will not cause acutely toxic conditions, allow an adequate zone of passage, and are sized appropriately to ensure that there will be no adverse impacts to biologically sensitive or critical habitats.
- (5-9) Shall not produce undesirable or nuisance aquatic life; result in floating debris, oil, or scum; produce objectionable color, odor, taste, or turbidity; cause objectionable bottom deposits; cause nuisance – The current discharge has not been shown to result in floating debris, oil, or scum; produce objectionable color, odor, taste, or turbidity; cause objectionable bottom deposits; or cause nuisance. This Order requires the discharge to meet advanced-secondary treatment standards, which will ensure continued compliance with these mixing zone requirements. With these requirements the acute and chronic mixing zones will not produce undesirable or nuisance aquatic life, result in floating debris, oil, or scum; produce objectionable color, odor, taste, or turbidity; cause objectionable bottom deposits; or cause nuisance.
- (10) Shall not dominate the receiving water body or overlap a mixing zone from different outfalls – The acute and chronic mixing zones are small relative to the water body, so they will not dominate the water body. The outfall is located less than 1 mile upstream of the City of Redding’s Stillwater Wastewater Treatment Facility effluent outfall diffuser; however, the proposed mixing zones do not overlap with the mixing zones from the downstream outfall. There are no other outfalls or mixing zones in the vicinity of the discharge.
- (11) Shall not be allowed at or near any drinking water intake – The acute and chronic mixing zones are not near a drinking water intake.

A pollutant-by-pollutant evaluation is provided in subsection vi. below to evaluate whether the mixing zones for each pollutant are as small as practicable and comply with the State and federal antidegradation requirements.

vi. **Evaluation of Available Dilution for Specific Constituents (Pollutant-by-Pollutant Evaluation)**

When determining whether to allow dilution credits for a specific pollutant, several factors must be considered, such as, available assimilative capacity, facility performance, and compliance with state and federal antidegradation requirements. The receiving water contains assimilative capacity for ammonia, chlorodibromomethane, copper, cyanide, dichlorobromomethane, nitrate plus nitrite, zinc, and chronic whole effluent toxicity, and human health criteria, acute aquatic life criteria, and chronic aquatic life criteria mixing zones meet the mixing zone prohibitions of the SIP section 1.4.2.2.A.

The SIP also requires that “[a] mixing zone shall be as small as practicable” and states in section 1.4.2.2.B that “[t]he RWQCB shall deny or significantly limit a mixing zone and dilution credits as necessary to protect beneficial uses, meet the conditions of this Policy, or comply with other regulatory requirements.” The State Anti-Degradation Policy, which incorporates the federal antidegradation policy (State Water Board Order WQ 86-17 [Fay]), requires that existing quality of waters be maintained unless degradation is justified based on specific findings. Item 2 of the State Anti-Degradation Policy states:

“Any activity which produces or may produce a waste or increased volume or concentration of waste and which discharges or proposes to discharge to existing high quality waters will be required to meet waste discharge requirements which will result in the best practicable treatment or control of the discharge necessary to assure that (a) a pollution or nuisance will not occur and (b) the highest water quality consistent with maximum benefit to the people of the State will be maintained.”

The mixing zones allowed in this Order are as small as practicable and will result in the Discharger implementing best practicable treatment or control of the discharge necessary to assure that pollution or nuisance will not occur and the highest

water quality consistent with maximum benefit to the people of the State will be maintained.

A pollutant-by-pollutant evaluation is provided below that evaluates facility performance and percent assimilative capacity used for each pollutant.

- (a) **Ammonia.** As outlined above, acute and chronic aquatic life criteria mixing zones extending 300 feet downstream of the Facility's outfall and a dilution credit of 10.7 and 25.6, respectively, meet the eleven mixing zone prohibitions of section 1.4.2.2.A of the SIP. In this case, however, to ensure the mixing zone is as small as practicable and considering section 1.4.2.2.B of the SIP, the Central Valley Water Board finds the mixing zone must be limited. The dilution credit for ammonia has been adjusted based on Facility performance resulting in an acute and chronic aquatic life dilution credit of 1.5 and 1.3, respectively, and an acute and chronic mixing zone extending less than 5 feet and less than 5 feet, respectively, downstream has been granted for ammonia.

This Order is carrying forward the effluent limitations for ammonia from previous Order R5-2019-0068 based on the allowance of the mixing zone. Therefore, no additional use of assimilative capacity is being authorized by this Order. The effluent limits continue to result in the implementation of best practicable treatment or control of the discharge necessary to assure that a pollution or nuisance will not occur and the highest water quality consistent with maximum benefit to the people of the State will be maintained.

- (b) **Chlorodibromomethane (CDBM).** As outlined above, a human health mixing zone extending 300 feet downstream of the Facility's outfall and a dilution credit of 132 meets the eleven mixing zone prohibitions of Section 1.4.2.2.A of the SIP. In this case, however, to ensure the mixing zone is as small as practicable and considering section 1.4.2.2.B of the SIP, the Central Valley Water Board finds the mixing zone must be limited. The dilution credit for CDBM has been adjusted based on Facility performance resulting in a dilution credit of 20 and a mixing zone extending less than 10 feet downstream has been granted for CDBM.

This Order is establishing effluent limitations for CDBM, based on the allowance of a mixing zone, that are more

stringent than those in the previous Order. Therefore, no additional use of assimilative capacity is being authorized by this Order. The effluent limits continue to result in the implementation of best practicable treatment or control of the discharge necessary to assure that a pollution or nuisance will not occur and the highest water quality consistent with maximum benefit to the people of the State will be maintained.

- (c) **Copper.** As outlined above, acute and chronic aquatic life criteria mixing zones extending 300 feet downstream of the Facility's outfall and a dilution credit of 10.7 and 25.6, respectively, meet the eleven mixing zone prohibitions of Section 1.4.2.2.A of the SIP. In this case, however, to ensure the mixing zone is as small as practicable and considering section 1.4.2.2.B of the SIP, the Central Valley Water Board finds the mixing zone must be limited. The dilution credit for copper has been adjusted based on Facility performance resulting in an acute and chronic aquatic life dilution credit of 9 and 12, respectively, and an acute and chronic mixing zone extending 200 feet and less than 10 feet, respectively, downstream of the outfall has been granted for copper.

This Order is carrying forward the effluent limitations for copper from previous Order R5-2019-0068 based on the allowance of the mixing zone. Therefore, no additional use of assimilative capacity is being authorized by this Order. The effluent limits continue to result in the implementation of best practicable treatment or control of the discharge necessary to assure that a pollution or nuisance will not occur and the highest water quality consistent with maximum benefit to the people of the State will be maintained.

- (d) **Cyanide.** As outlined above, acute and chronic aquatic life criteria mixing zones extending 300 feet downstream of the Facility's outfall and a dilution credit of 10.7 and 25.6, respectively, meet the eleven mixing zone prohibitions of Section 1.4.2.2.A of the SIP. In this case, however, to ensure the mixing zone is as small as practicable and considering section 1.4.2.2.B of the SIP, the Central Valley Water Board finds the mixing zone must be limited. The dilution credit for cyanide has been adjusted based on Facility performance resulting in an acute and chronic aquatic life dilution credit of 2.6 and 9.6, respectively, and an acute and chronic mixing zone extending less than

10 feet and less than 10 feet, respectively, downstream of the outfall has been granted for cyanide.

This Order establishes effluent limitations for cyanide that are more stringent than those in the previous R5-2019-0068. Therefore, no additional use of assimilative capacity is being authorized by this Order. The effluent limits continue to result in the implementation of best practicable treatment or control of the discharge necessary to assure that a pollution or nuisance will not occur and the highest water quality consistent with maximum benefit to the people of the State will be maintained.

- (e) **Dichlorobromomethane (DCBM).** As outlined above, a human health mixing zone extending 300 feet downstream of the Facility's outfall and a dilution credit of 132 meets the eleven mixing zone prohibitions of Section 1.4.2.2.A of the SIP. In this case, however, to ensure the mixing zone is as small as practicable and considering section 1.4.2.2.B of the SIP, the Central Valley Water Board finds the mixing zone must be limited. The dilution credit for DCBM has been adjusted based on Facility performance resulting in a dilution credit of 43 and a mixing zone extending less than 30 feet downstream has been granted for DCBM.

This Order establishes effluent limitations for DCBM that are more stringent than those in the previous R5-2019-0068. Therefore, no additional use of assimilative capacity is being authorized by this Order. The effluent limits continue to result in the implementation of best practicable treatment or control of the discharge necessary to assure that a pollution or nuisance will not occur and the highest water quality consistent with maximum benefit to the people of the State will be maintained.

- (f) **Nitrate plus Nitrite.** As outlined above, a human health mixing zone extending 300 feet downstream of the Facility's outfall and a dilution credit of 132 meets the eleven mixing zone prohibitions of Section 1.4.2.2.A of the SIP. In this case, however, to ensure the mixing zone is as small as practicable and considering section 1.4.2.2.B of the SIP, the Central Valley Water Board finds the mixing zone must be limited. The dilution credit for nitrate plus nitrite has been adjusted based on Facility performance resulting in a dilution credit of 3 and a mixing zone extending less than 10 feet downstream has been granted for nitrate plus nitrite.

This Order is carrying forward the effluent limitations for Nitrate plus Nitrite from previous Order R5-2019-0068 based on the allowance of the mixing zone. Therefore, no additional use of assimilative capacity is being authorized by this Order. The effluent limits continue to result in the implementation of best practicable treatment or control of the discharge necessary to assure that a pollution or nuisance will not occur and the highest water quality consistent with maximum benefit to the people of the State will be maintained.

- (g) **Zinc.** As outlined above, acute and chronic aquatic life criteria mixing zones extending 300 feet downstream of the Facility's outfall and a dilution credit of 10.7 and 25.6, respectively, meet the eleven mixing zone prohibitions of Section 1.4.2.2.A of the SIP. In this case, however, to ensure the mixing zone is as small as practicable and considering section 1.4.2.2.B of the SIP, the Central Valley Water Board finds the mixing zone must be limited. The dilution credit for zinc has been adjusted based on Facility performance resulting in an acute and chronic aquatic life dilution credit of 10.7 and 1, respectively, and an acute and chronic mixing zone extending 300 feet and less than 10 feet, respectively, downstream of the outfall has been granted for zinc.

This Order establishes effluent limitations for zinc that are more stringent than those in the previous R5-2019-0068. Therefore, no additional use of assimilative capacity is being authorized by this Order. The effluent limits continue to result in the implementation of best practicable treatment or control of the discharge necessary to assure that a pollution or nuisance will not occur and the highest water quality consistent with maximum benefit to the people of the State will be maintained.

- (h) **Chronic Whole Effluent Toxicity.** As outlined above, a chronic aquatic life criteria mixing zone extending 300 feet downstream of the Facility's outfall and a dilution credit of up to 25.6 meet the eleven mixing zone prohibitions of Section 1.4.2.2.A of the SIP. In this case, however, to ensure the mixing zone is as small as practicable and considering section 1.4.2.2.B of the SIP, the Central Valley Water Board finds the whole effluent toxicity mixing zone must be limited. A chronic dilution credit of 8 (IWC of 11.1 percent effluent) is granted for chronic whole effluent toxicity. The effluent limits will result in the implementation

of best practicable treatment or control of the discharge necessary to assure that a pollution or nuisance will not occur and the highest water quality consistent with maximum benefit to the people of the State will be maintained.

Based on the findings above, this Order grants mixing zones and dilution credits that have been used for the calculation of WQBELs for ammonia, CDBM, copper, cyanide, DCBM, nitrate plus nitrite, zinc, and chronic whole effluent toxicity. The dimensions of the mixing zones and allowable dilution credits are shown in Table F-8, below. The percent assimilative used was calculated for antidegradation purposes comparing current permitted discharge to the revised permitted discharge with the mixing zone at the long-term receiving water flow (harmonic mean) of 6,410 cfs. Use of the long-term receiving water flow is appropriate for antidegradation purposes which considers the long-term effect of an allowed permitted increase in the mass loading on the receiving water. The percent assimilative capacity used calculations are summarized in Table F-9, below.

Table F-8 Mixing Zones and Dilution Credits

Parameter	Mixing Zone Type	Allowed Dilution Credit	Mixing Zone Size (feet)
Ammonia	Acute and Chronic Aquatic Life	Acute: 1.5 Chronic: 1.3	Acute: <5 Chronic: <5
CDBM	Human Health	20	<10
Copper	Acute and Chronic Aquatic Life	Acute: 9 Chronic:12	Acute: 200 Chronic: <10
Cyanide	Acute and Chronic Aquatic Life	Acute: 2.6 Chronic:9.6	Acute: <10 Chronic: <10
DCBM	Human Health	43	<30
Nitrate plus Nitrite	Human Health	3	<10
Zinc	Acute and Chronic Aquatic Life	Acute: 10.7 Chronic: 1	Acute: 300 Chronic: <10
Whole Effluent Toxicity	Chronic Aquatic Life	Chronic: 8	<10

Table F-9 Percent Assimilative Capacity Used Calculations

Parameter	Ammonia as N	Copper, Total	Cyanide	CDBM	DCBM	Nitrate	Zinc, Total
Water Quality Objective/ Criteria	Acute: 6.8 mg/L Chronic: 3 mg/L	Acute: 5.4 µg/L 4.6 Chronic: µg/L	Acute:5.2 µg/L Chronic: 22 µg/L	0.41 µg/L	0.56 µg/L	10 mg/L	Acute (Basin Plan):18 µg/L Chronic: 73 µg/L
Maximum Background Concentration	0.14 mg/L	2.09 µg/L	1.1 µg/L	0.11µg/L	0.11µg/L	0.07 mg/L	7.4 µg/L
Existing Permitted Condition	5.4 mg/L	22 µg/L	70 µg/L	14 µg/L	31 µg/L	40 mg/L	85 µg/L
Revised Permitted Condition	5.4 mg/L	22 µg/L	40 µg/L	8 µg/L	22 µg/L	40 mg/L	70 µg/L
Existing Permitted Assimilative Capacity	2.9	1.6	4	0.3	0.4	9.8	11
Revised Permitted Assimilative Capacity	2.8	2.5	4	0.3	0.4	9.92	10
Percent Assimilative Capacity Used	3.1	-57	-0.2	-0.6	-2.9	-0.9	1.8

Table F-9 Notes:

1. Existing Permitted Condition is the existing average monthly effluent limitation or applicable water quality objective/criteria if there is currently no effluent limitation.
2. Revised Permitted Condition is new average monthly effluent limitation implemented in this Order with the allowed mixing zone(s).
3. Assimilative Capacity calculated using mas balance equation with a long-term average (harmonic mean) receiving water flow of 6,410 cfs and permitted effluent Average Dry Weather flow of 2 MGD.
 - a. **Hardness-Dependent CTR Metals Criteria.** The CTR and the NTR contain water quality criteria for seven metals that vary as a function of hardness. The lower the hardness the lower the water quality criteria. The metals with hardness-dependent criteria include cadmium, copper, chromium III, lead, nickel, silver, and zinc. For the Sacramento River the Basin Plan contains hardness-dependent site-specific objectives for

cadmium, copper, and zinc that apply in lieu of the CTR acute criteria for these metals. This Order has established the criteria for hardness-dependent metals based on the hardness of the receiving water (actual ambient hardness) as required by the SIP and the CTR.

The ambient hardness for the Sacramento River ranges from 30.5 mg/L to 138 mg/L based on collected hardness data from January 2021 through February 2024. Given the high variability in ambient hardness values, there is no single hardness value that describes the ambient receiving water for all possible scenarios (e.g., minimum, maximum). Because of this variability, staff has determined that based on the ambient hardness concentrations measured in the receiving water, the Central Valley Water Board has discretion to select ambient hardness values within the range of 30.5 mg/L (minimum) up to 138 mg/L (maximum).

The Central Valley Water Board finds that the use of the ambient hardness values and associated acute and chronic criteria shown in Table F-10 to conduct the reasonable potential analysis (RPA) and calculate WQBELs, protect beneficial uses under all ambient receiving water conditions and comply with the SIP, CTR, and Basin Plan.

Table F-10. Summary of Criteria for CTR Hardness-dependent Metals

CTR Metals	Ambient Hardness (mg/L)	Acute Criteria (µg/L, total)	Chronic Criteria (µg/L, total)
Copper	30.5	4.5	5.4
Chromium III	30.5	657	79
Cadmium	30.5	0.2	1.0
Lead	30.5	18	0.7
Nickel	30.5	172	19
Silver	30.5	0.5	--
Zinc	30.5	18	73

Table F-10 Notes:

- Criteria (µg/L total).** Acute and chronic criteria were rounded to two significant figures in accordance with the CTR (40 C.F.R. section 131.38(b)(2)).
- Ambient hardness (mg/L).** Values in Table F-10 represent actual observed receiving water hardness measurements.
- Acute Criteria.** The acute criteria for Cadmium, Copper, and Zinc are based on site-specific objectives provided in the Basin Plan.
- Copper and Zinc.** This Order allows a site-specific metal translator for copper and zinc to calculate the criteria (see section IV.C.2.c.iii.(c)).
- Copper and Zinc.** This Order allows a mixing zone for copper and zinc. The ambient hardness shown above is only appropriate for conducting the RPA, because dilution has not been considered. As discussed in section IV.C.2.c, when

considering dilution to calculate the WQBELs, the appropriate ambient hardness is 30.5 mg/L (as CaCO₃) based solely on upstream receiving water hardness.

3. Determining the Need for WQBELs

Clean Water Act section 301(b)(1)(C) requires effluent limitations necessary to meet water quality standards, and 40 C.F.R. section 122.44(d) requires NPDES permits to include conditions that are necessary to achieve water quality standards established under section 303 of the CWA, including State narrative criteria for water quality. Federal regulations at 40 C.F.R 122.44(d)(1)(i) state, "Limitations must control all pollutants or pollutant parameters (either conventional, nonconventional, or toxic pollutants) which the Director determines are or may be discharged at a level that will cause, have the reasonable potential to cause, or contribute to an excursion above any State water quality standard, including State narrative criteria for water quality." Additionally, 40 C.F.R. section 122(d)(1)(vii) requires effluent limits to be developed consistent with any available WLAs developed and approved for the discharge. The process to determine whether a WQBEL is required as described in 40 C.F.R. section 122.44(d)(1)(i) is referred to as a reasonable potential analysis or RPA. Central Valley Water Board staff conducted RPAs for nearly 200 constituents, including the 126 U.S. EPA priority toxic pollutants. This section includes details of the RPAs for constituents of concern for the Facility. The entire RPA is included in the administrative record and a summary of the constituents of concern is provided in Attachment G.

For priority pollutants, the SIP dictates the procedures for conducting the RPA. For non-priority pollutants the Central Valley Water Board is not restricted to one particular RPA method; therefore, the RPAs have been conducted based on U.S. EPA guidance considering multiple lines of evidence and the site-specific conditions of the discharge. Ammonia, acute toxicity, chlorine residual, nitrate plus nitrite, pH, pathogens, and temperature are not priority pollutants. Due to the site-specific conditions of the discharge, the Central Valley Water Board has used professional judgment in determining the appropriate method for conducting the RPA for these non-priority pollutant parameters based on a qualitative assessment as recommended by U.S. EPA guidance. U.S. EPA's September 2010 NPDES Permit Writer's Manual, page 6-30, states, "State implementation procedures might allow, or even require, a permit writer to determine reasonable potential through a qualitative assessment process without using available facility-specific effluent monitoring data or when such data are not available...A permitting authority might also determine that WQBELs are required for specific pollutants for all facilities that exhibit certain operational or discharge characteristics (e.g., WQBELs for pathogens in all permits for POTWs discharging to contact recreational waters)." U.S. EPA's TSD also recommends that factors other than effluent data should be considered in the RPA, "When determining whether or not a discharge causes, has the reasonable potential to cause, or contributes to an excursion of a numeric or narrative water quality criterion for individual

toxicants or for toxicity, the regulatory authority can use a variety of factors and information where facility-specific effluent monitoring data are unavailable. These factors also should be considered with available effluent monitoring data.” With regard to POTWs, U.S. EPA recommends that, “POTWs should also be characterized for the possibility of chlorine and ammonia problems.” (TSD, p. 50)

a. **Constituents with Total Maximum Daily Load (TMDL).**

40 C.F.R. section 122.44(d)(1)(vii) provides: “When developing water quality-based effluent limits under [section 122.44(d)(1)], the permitting authority shall ensure that: (A) The level of water quality to be achieved by limits on point sources established under this paragraph is derived from, and complies with all applicable water quality standards; and (B) Effluent limits developed to protect a narrative water quality criterion, a numeric water quality criterion, or both, are consistent with the assumptions and requirements of any available WLA for the discharge prepared by the State and approved by U.S. EPA pursuant to [Total Maximum Daily Loads regulations].” U.S. EPA construes 40 C.F.R. section 122.44(d)(1)(vii)(B) to mean that “when WLAs are available, they must be used to translate water quality standards into NPDES permit limits.” 54 Fed. Reg. 23868, 23879 (June 2, 1989).

The Sacramento River is subject to TMDLs for diazinon and chlorpyrifos and WLAs under those TMDLs are available. The Central Valley Water Board developed WQBELs for these pollutants pursuant to 40 C.F.R. section 122.44(d)(1)(vii), which does not require or contemplate a reasonable potential analysis.

i. **Diazinon and Chlorpyrifos.**

- (a) **WQO.** The Central Valley Water Board completed a TMDL for diazinon and chlorpyrifos for the Sacramento River and San Joaquin River Basins and amended the Basin Plan to include diazinon and chlorpyrifos waste load allocations and water quality objectives. The Basin Plan Amendment for the Sacramento River and San Joaquin River Basins for Control of Diazinon and Chlorpyrifos Discharges was adopted by the Central Valley Water Board on 28 March 2014 and became effective on 16 August 2017.

The amendment modified Basin Plan Chapter 3 (Water Quality Objectives) to establish site-specific numeric objectives for diazinon and chlorpyrifos for waters with COLD and/or WARM beneficial uses below major dams and identified the requirements to meet the additive formula already in Basin Plan Chapter 4 (Implementation) for the additive toxicity of diazinon and chlorpyrifos.

The amendment states that the waste load allocations for all NPDES-permitted dischargers shall not exceed the sum (S) of one (1) as defined below:

$$S = C_d/WQO_d + C_c/WQO_c \leq 1.0$$

Where:

C_d = diazinon concentration in $\mu\text{g/L}$ of point source discharge

C_c = chlorpyrifos concentration in $\mu\text{g/L}$ of point source discharge

WQO_d = acute or chronic diazinon water quality objective in $\mu\text{g/L}$

WQO_c = acute or chronic chlorpyrifos water quality objective in $\mu\text{g/L}$

Available samples collected within the applicable averaging period for the water quality objective will be used to determine compliance with the allocations and loading capacity. For purposes of calculating the sum (S) above, analytical results that are reported as 'non-detectable' concentrations are considered to be zero.

The WLAs apply to waterbodies that are downstream of the major dams in Table 3-5 of the Basin Plan, which includes Keswick Dam on the Sacramento River. The Facility discharges to the Sacramento River, downstream of Keswick Dam.

- (b) **WQBELs.** WQBELs for diazinon and chlorpyrifos are required per the TMDL. This Order includes effluent limits calculated based on the WLAs contained in the TMDL, as follows:

Average Monthly Effluent Limitation (AMEL)

$$S(\text{AMEL}) = C_d (\text{M-avg})/0.079 + C_c (\text{M-avg})/0.012 \leq 1.0$$

Where:

$C_d(\text{M-avg})$ = average monthly diazinon effluent concentration in $\mu\text{g/L}$

$C_c (\text{M-avg})$ = average monthly chlorpyrifos effluent concentration in $\mu\text{g/L}$

Average Weekly Effluent Limitation (AWEL)

$$S(\text{AWEL}) = C_d (W\text{-avg})/0.14 + C_c (W\text{-avg})/0.021 \leq 1.0$$

Where:

$C_d(W\text{-avg})$ = average weekly diazinon effluent concentration in $\mu\text{g/L}$

$C_c (W\text{-avg})$ = average weekly chlorpyrifos effluent concentration in $\mu\text{g/L}$

- (c) **Plant Performance and Attainability.** Chlorpyrifos and diazinon were not detected in the effluent 3 sampling events conducted between July 2021 and July 2023. Furthermore, since these pesticides have been banned for public use, they are not expected to be present in the influent to the Facility. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.
- b. **Constituents with No Reasonable Potential.** Central Valley Water Board staff conducted reasonable potential analyses for nearly 200 constituents, including the 126 U.S. EPA priority toxic pollutants. All reasonable potential analyses are included in the administrative record and a summary of the constituents of concern is provided in Attachment G. WQBELs are not included in this Order for constituents that do not demonstrate reasonable potential to cause or contribute to an instream excursion of an applicable water quality objective; however, monitoring for those pollutants is established in this Order as required by the SIP. If the results of effluent monitoring demonstrate reasonable potential, this Order may be reopened and modified by adding an appropriate effluent limitation.

Most constituents with no reasonable potential are not discussed in this Order. This section only provides the rationale for the reasonable potential analyses for the following constituents of concern that were found to have no reasonable potential after assessment of the data:

i. **Diquat**

- (a) **WQO.** The Basin Plan requires that no individual pesticides shall be present in concentrations that adversely affect beneficial uses; discharges shall not result in pesticide concentrations in bottom sediments or aquatic life that adversely affect beneficial uses; persistent chlorinated hydrocarbon pesticides shall not be present in the water column at detectable concentrations; and pesticide concentrations shall not exceed those allowable by applicable antidegradation policies. Previous Waste Discharge Requirements Order R5-2019-0068 established routine monitoring for diquat.

- (b) **RPA Results.** Based on samples from January 2021 to January 2024, the MEC for diquat was non-detect (<1.60 µg/L) and the maximum ambient background diquat concentration was non-detect (<1.60 µg/L). Therefore, diquat does not demonstrate reasonable potential, and the routine monitoring for diquat has not been retained in this Order.

ii. **Salinity**

- (a) **WQO.** The Basin Plan contains a chemical constituent objective that incorporates state MCLs, contains a narrative objective, and contains numeric water quality objectives for certain specified water bodies for electrical conductivity, total dissolved solids, sulfate, and chloride. The U.S. EPA Ambient Water Quality Criteria for Chloride recommends acute and chronic criteria for the protection of aquatic life. There are no U.S. EPA water quality criteria for the protection of aquatic life for electrical conductivity, total dissolved solids, and sulfate. Additionally, there are no U.S. EPA numeric water quality criteria for the protection of agricultural, livestock, and industrial uses. Numeric values for the protection of these uses are typically based on site specific conditions and evaluations to determine the appropriate constituent threshold necessary to interpret the narrative chemical constituent Basin Plan objective. The Central Valley Water Board must determine the applicable numeric limit to implement the narrative objective for the protection of agricultural supply. Table F-11, below, contains various recommended levels for EC or TDS, sulfate, and chloride.

Table F-11 Salinity Water Quality Criteria/Objectives

Parameters	Secondary MCL Recommended Level.	Secondary MCL Upper Level	Secondary MCL Short-term Maximum	U.S. EPA NAWQC	Maximum Calendar Annual Average Effluent Concentration	Maximum Daily Effluent Concentration
EC (µmhos/cm) or TDS (mg/L)	EC 900 or TDS 500	EC 1,600 or TDS 1,000	EC 2,200 or TDS 1,500	N/A	416	454
Sulfate (mg/L)	250	500	600	N/A	35	38.7
Chloride (mg/L)	250	500	600	860 1-hour / 230 4-day	47	48.1

Table F-11 Notes:

1. **Agricultural Water Quality Objectives.** Applicable agricultural water quality objectives vary. Procedures for establishing the applicable numeric limitation to implement the narrative chemical constituent objective can be found in the Policy for Application of Water Quality Objectives, section 4.2.2.1.9 of the Basin Plan. However, the Basin Plan does not require improvement over naturally occurring background concentrations. In cases where the natural background concentration of a particular constituent exceeds an applicable water quality objective, the natural background concentration will be considered to comply with the objective.
2. **Secondary MCLs.** Secondary MCLs are for protection of public welfare and are stated as a recommended level, upper level, and a short-term maximum level.
3. **Chloride.** The Secondary MCL for chloride is 250 mg/L, as a recommended level, 500 mg/L as an upper level, and 600 mg/L as a short-term maximum.
4. **Electrical Conductivity or Total Dissolved Solids.** The Secondary MCL for EC is 900 μ mhos/cm as a recommended level, 1600 μ mhos/cm as an upper level, and 2200 μ mhos/cm as a short-term maximum, or when expressed as TDS is 500 mg/L as a recommended level, 1000 mg/L as an upper level, and 1500 mg/L as a short-term maximum.
5. **Sulfate.** The Secondary MCL for sulfate is 250 mg/L as a recommended level, 500 mg/L as an upper level, and 600 mg/L as a short-term maximum.

(b) **RPA Results.**

- (1) **Chloride.** Chloride concentrations in the effluent ranged from 45.1 mg/L to 48.1 mg/L, with an average of 47 mg/L. These levels do not exceed the Secondary MCL. Background concentrations in Receiving Water ranged from 1.79 mg/L to 2.95 mg/L, with an average of 2.66 mg/L, for 6 samples collected by the Discharger from January 2021 through July 2023.
- (2) **Electrical Conductivity or Total Dissolved Solids.** A review of the Discharger's monitoring reports shows an average effluent EC of 397 μ mhos/cm, with a range from 331 μ mhos/cm to 454 μ mhos/cm. The maximum annual average for effluent EC was 416 μ mhos/cm, measured in 2022. These levels do not exceed the Secondary MCL. The background receiving water EC averaged 130 μ mhos/cm. The average TDS effluent concentration was 255 mg/L with concentrations ranging from 197 mg/L to 330 mg/L. The maximum annual average for effluent TDS was 296, measured in 2022. These levels do not exceed the Secondary MCL. The background receiving water TDS ranged from 74 mg/L to 100 mg/L, with an average of 86 mg/L.

- (3) **Sulfate.** Sulfate concentrations in the effluent ranged from 32.3 mg/L to 38.7 mg/L, with an average of 35 mg/L. These levels do not exceed the Secondary MCL. Background concentrations in the Sacramento River ranged from 3.52 mg/L to 3.96 mg/L, with an average of 3.71 mg/L.

(b) **WQBELs.**

As discussed above, the discharge does not have reasonable potential to cause or contribute to an in-stream excursion of water quality objectives for salinity. On 17 January 2020, certain amendments to the Basin Plan incorporating a Program to Control and Permit Salt Discharges to Surface and Groundwater (Salt Control Program) became effective. Other amendments became effective on 2 November 2020 when approved by the U.S. EPA. The Salt Control Program is a three-phased program, with each phase lasting 10 to 15 years. The Basin Plan requires all salt dischargers to comply with the provisions of the program. Two compliance pathways are available for salt dischargers during Phase 1.

The Phase 1 Compliance pathways are: 1) Conservative Salinity Permitting Approach, which utilizes the existing regulatory structure and focuses on source control, conservative salinity limits on the discharge, and limits the use of assimilative capacity and compliance time schedules; and, 2) Alternative Salinity Permitting Approach, which is an alternative approach to compliance through implementation of specific requirements such as participating in the Salinity Prioritization and Optimization Study (P&O) rather than the application of conservative discharge limits.

The Discharger submitted a Notice of Intent for the Salinity Control Program indicating its intent to meet the Alternative Salinity Permitting Approach. This Order requires implementation of a Salinity Evaluation and Minimization Plan, participation in the Salinity P&O Study, and includes a performance-based trigger for EC consistent with the Alternative Salinity Permitting Approach.

- c. **Constituents with No Data or Insufficient Data.** No parameters.
- d. **Constituents with Reasonable Potential.** The Central Valley Water Board finds that the discharge has a reasonable potential to cause or contribute to an instream excursion above a water quality standard for ammonia, chloride residual, chlorodibromomethane, total recoverable copper, cyanide, dichlorobromomethane, nitrate plus nitrite, total

suspended solids, BOD5, pathogens, pH, and total recoverable zinc. WQBELs for these constituents are included in this Order. A summary of the RPA is provided in Attachment G, and a detailed discussion of the RPA for each constituent is provided below.

i. **Ammonia**

- (a) **WQO.** The 2013 U.S. EPA National Ambient Water Quality Criteria (NAWQC) for the protection of freshwater aquatic life for total ammonia (2013 Criteria), recommends acute (1-hour average; criteria maximum concentration or CMC) and chronic (30-day average; criteria continuous concentration or CCC) standards based on pH and temperature. U.S. EPA also recommends that no 4-day average concentration should exceed 2.5 times the 30-day CCC. The 2013 Criteria reflects the latest scientific knowledge on the toxicity of ammonia to certain freshwater aquatic life, including toxicity data on sensitive freshwater unionid mussels, non-pulmonary snails, and other freshwater organisms.

The Central Valley Clean Water Association (CVCWA) organized a coordinated effort for POTWs within the Central Valley Region, the Freshwater Mussel Collaborative Study for Wastewater Treatment Plants, to determine how the latest scientific knowledge on the toxicity of ammonia reflected in the 2013 Criteria could be implemented in the Central Valley Region. Through this effort a Criteria Recalculation Report was developed in January 2020 using toxicity studies for the freshwater mussel species present in Central Valley Region waters.

The Criteria Recalculation Report implemented U.S. EPA's Recalculation Procedure utilizing toxicity bioassays conducted on resident mussel species to replace the toxicity data for the eastern mussel species in the national dataset to develop site-specific ammonia criteria for waters within the Central Valley Region, including all surface waters in the Sacramento River, San Joaquin River, and Tulare Lake Basin Plans.

U.S. EPA Office of Science and Technology reviewed and approved the Criteria Recalculation Report with a more conservative approach for utilizing the acute-to-chronic ratio procedure for developing the site-specific chronic criterion. The Central Valley Water Board finds that the site-specific ammonia criteria provided in the January 2020 Criteria Recalculation Report implements the Basin Plan's narrative toxicity objective to protect aquatic life beneficial uses of the receiving water.

Site-specific Criteria for the Sacramento River. The recalculated site-specific criteria developed in the Criteria Recalculation Report for the acute and chronic criteria are presented based on equations that vary according to pH and temperature for situations where freshwater mussels are present and where they are absent. In this case, for the Sacramento River freshwater mussels have been assumed to be present. In addition, the recalculated criteria include equations that provide enhanced protection for important salmonid species in the genus *Oncorhynchus*, that can be implemented for receiving waters where salmonid species are present. Because the Sacramento River has a beneficial use of cold freshwater habitat and the presence of salmonids in the Sacramento River is well-documented, the criteria equations for waters where salmonids are present were used.

The acute (1-hour average) criterion or CMC was calculated using paired effluent pH and temperature data, collected during the period from January 2021 and February 2024. The most stringent CMC of 21.5 mg/L (ammonia as N) calculated has been implemented in this Order.

The chronic (30-day average) criterion or CCC was calculated using paired downstream receiving water pH and temperature data, collected during the period from January 2021 and February 2024. The most stringent 30-day rolling average CCC of 3.07 mg/L (ammonia as N) has been implemented in this Order.

The chronic (4-day average) concentration is derived in accordance with the U.S. EPA criterion as 2.5 times the 30-day CCC. Based on the 30-day CCC of 3.07 mg/L (ammonia as N), the 4-day average concentration that should not be exceeded is 7.7 mg/L (ammonia as N).

- (b) **RPA Results.** The Facility is a POTW that treats domestic wastewater. Untreated domestic wastewater contains ammonia in concentrations that is harmful to aquatic life and exceed the Basin Plan narrative toxicity objective. Inadequate or incomplete treatment may result in the discharge of ammonia to the receiving stream, which creates the basis for the discharge to have a reasonable potential to cause or contribute to an instream excursion above the site-specific acute and chronic criteria for ammonia provided by the January 2020 Criteria Recalculation Report. Therefore, the Central Valley Water Board finds the discharge has reasonable potential for ammonia and WQBELs are required.

- (c) **WQBELs.** The Central Valley Water Board calculates WQBELs in accordance with SIP procedures for non-CTR constituents, and ammonia is a non-CTR constituent. The SIP procedure assumes a 4-day averaging period for calculating the long-term average discharge condition (LTA). However, U.S. EPA recommends modifying the procedure for calculating permit limits for ammonia using a 30-day averaging period for the calculation of the LTA corresponding to the 30-day CCC. Therefore, while the LTAs corresponding to the acute and 4-day chronic criteria were calculated according to SIP procedures, the LTA corresponding to the 30-day CCC was calculated assuming a 30-day averaging period. The receiving water contains assimilative capacity for ammonia, therefore, acute and chronic aquatic life dilution credits of 1.5 and 1.3, respectively, were allowed in the development of the WQBELs for ammonia. This Order contains a final average monthly effluent limitation (AMEL) and average weekly effluent limitation (AWEL) for ammonia of 5.4 mg/L and 12 mg/L, respectively, based on the site-specific ammonia criteria for the Sacramento River.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 3.98 µg/L is less than the applicable WQBELs. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.

ii. **Chlorine Residual**

- (a) **WQO.** U.S. EPA developed NAWQC for protection of freshwater aquatic life for chlorine residual. The recommended 4-day average (chronic) and 1-hour average (acute) criteria for chlorine residual are 0.011 mg/L and 0.019 mg/L, respectively. These criteria are protective of the Basin Plan's narrative toxicity objective.
- (b) **RPA Results.** The concentrations of chlorine used to disinfect wastewater are high enough to harm aquatic life and violate the Basin Plan narrative toxicity objective if discharged to the receiving water. Reasonable potential therefore does exist and effluent limits are required.

The Discharger uses chlorine for disinfection, which is extremely toxic to aquatic organisms. Although the Discharger uses a sodium bisulfate process to dechlorinate the effluent prior to discharge to the Sacramento River, the existing chlorine use and the potential for chlorine to be discharged provides the

basis for the discharge to have a reasonable potential to cause or contribute to an instream excursion above the NAWQC.

- (c) **WQBELs.** The U.S. EPA's TSD for Water Quality-Based Toxics Control [EPA/505/2-90-001] contains statistical methods for converting chronic (4-day) and acute (1-hour) aquatic life criteria to average monthly and maximum daily effluent limitations based on the variability of the existing data and the expected frequency of monitoring. However, because chlorine is an acutely toxic constituent that can and will be monitored continuously, an average 1-hour limitation is considered more appropriate than an average daily limitation. This Order contains a 4-day average effluent limitation and 1-hour average effluent limitation for chlorine residual of 0.011 mg/L and 0.019 mg/L, respectively, based on U.S. EPA's NAWQC, which implements the Basin Plan's narrative toxicity objective for protection of aquatic life.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of <0.009 mg/L is less than the applicable WQBELs. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.

iii. **Chlorodibromomethane**

- (a) **WQO.** The CTR includes a criterion of 0.41 µg/L for chlorodibromomethane for the protection of human health for waters from which both water and organisms are consumed.
- (b) **RPA Results.** The MEC for chlorodibromomethane was 0.93 µg/L based on 41 samples collected from January 2021 through February 2024. Chlorodibromomethane was not detected (<0.11 µg/L) in the upstream receiving water based on three samples collected between from January 2021 through February 2024. Therefore, chlorodibromomethane in the discharge has a reasonable potential to cause or contribute to an in-stream excursion above the CTR criterion for the protection of human health.
- (c) **WQBELs.** The receiving water contains assimilative capacity for chlorodibromomethane, therefore, a human health dilution credit of 20 was allowed in the development of the WQBELs for chlorodibromomethane. This Order contains a final average monthly effluent limitation (AMEL) and maximum daily effluent limitation (MDEL) for chlorodibromomethane of 8 µg/L and

17 µg/L, respectively, based on the CTR criterion for the protection of human health.

- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 0.93 µg/L is less than the applicable WQBELs. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.

iv. **Copper**

- (a) **WQO.** The CTR includes hardness-dependent criteria for the protection of freshwater aquatic life for copper. These criteria for copper are presented in dissolved concentrations, as 1-hour acute criterion and 4-day chronic criteria. U.S. EPA recommends conversion factors to translate dissolved concentrations to total concentrations. Site specific translators were used for the effluent and receiving water (see section IV.C.2.c.iii.(c)). The applicable acute and chronic criteria for copper in the effluent are 5.4 µg/L and 4.6 µg/L, respectively, as total recoverable.

The Basin Plan includes a site-specific, hardness-dependent, maximum concentration water quality objective for the Sacramento River and its tributaries above the State Highway 32 Bridge at Hamilton City. Using site specific translators and the selected ambient hardness described in section IV.C.2 of this Fact Sheet, the applicable Basin Plan maximum concentration objective for copper in the effluent is 5.4 µg/L, as total recoverable.

- (b) **RPA Results.** The maximum effluent concentration for copper was 10.1 µg/L, based on 39 samples collected between January 2021 and February 2024. The maximum observed upstream receiving water total copper concentration was 9.32 µg/L, based on 42 samples collected between January 2021 and February 2024, however, the maximum dissolved copper concentration was 2.09 µg/L, collected on 5 January 2023. The RPA was conducted using the upstream receiving water hardness to calculate the criteria for comparison to the maximum ambient background concentration, and likewise using the reasonable worst-case downstream hardness shown in section IV.C.2 of this Fact Sheet to compare the maximum effluent concentration. The table below shows the specific criteria used for the RPA:

Table F-12 Copper RPA Criteria

Water Type	CTR Chronic Criterion (Total)	Maximum Concentration	Criteria Exceeded? (Y/N)
Receiving Water	4.6 µg/L	9.32 µg/L (total) 2.09 µg/L (dissolved)	Yes No
Effluent	4.6 µg/L	10.1 µg/L (total recoverable)	Yes

Table F-12 Notes:

1. **Receiving Water.** The CTR Chronic Criterion (Total) for the receiving water is based on lowest observed upstream hardness of 30.5 mg/L (as CaCO₃).
2. **Effluent.** The CTR Chronic Criterion (Total) for the effluent is based on reasonable worst-case downstream hardness of 30.5 mg/L (as CaCO₃).

Based on the available data, the maximum effluent concentration exceeded the applicable criteria. Therefore, per section 1.3, step 6 of the SIP, copper in the discharge has a reasonable potential to cause or contribute to an instream excursion above the CTR criteria for the protection of freshwater aquatic life.

- (c) **WQBELs.** This Order contains a final average monthly effluent limitation (AMEL) and maximum daily effluent limitation (MDEL) for copper of 22 µg/L and 31 µg/L, respectively. The WQBELs were calculated with the allowance of acute and chronic aquatic life criteria mixing zones and dilution credits based on the CTR criteria for the protection of freshwater aquatic life as discussed in section IV.C.2 of this Fact Sheet.
 - (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 10.1 µg/L is less than the applicable WQBELs. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.
- v. **Cyanide**
- (a) **WQO.** The CTR includes maximum 1-hour average and 4-day average criteria of 22 µg/L and 5.2 µg/L, respectively, for cyanide for the protection of freshwater aquatic life.
 - (b) **RPA Results.** The maximum effluent concentration (MEC) for cyanide was 14 µg/L (total as CN) based on 38 samples collected from January 2021 through February 2024. Cyanide

was not detected ($<1.1 \mu\text{g/L}$) in the upstream receiving water based on three samples from January 2021 through February 2024. Therefore, cyanide in the discharge has a reasonable potential to cause or contribute to an in-stream excursion above the CTR criteria for the protection of freshwater aquatic life.

- (c) **WQBELs.** The receiving water contains assimilative capacity for cyanide, therefore, an acute aquatic life dilution credit of 2.6 and a chronic aquatic life dilution credit of 9.6 was allowed in the development of the WQBELs for cyanide. This Order contains a final average monthly effluent limitation (AMEL) for cyanide of $40 \mu\text{g/L}$ and a max daily effluent limitation (MDEL) of $77 \mu\text{g/L}$ based on the CTR criteria for the protection of acute and chronic aquatic life.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of $14 \mu\text{g/L}$ is less than the applicable WQBELs. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.

vi. **Dichlorobromomethane**

- (a) **WQO.** The CTR includes a criterion of $0.56 \mu\text{g/L}$ for dichlorobromomethane for the protection of human health for waters from which both water and organisms are consumed.
- (b) **RPA Results.** The MEC for dichlorobromomethane was $10.1 \mu\text{g/L}$ based on 41 samples collected from January 2021 through February 2024. Dichlorobromomethane was not detected ($<0.11 \mu\text{g/L}$) in the upstream receiving water three samples collected from January 2021 through February 2024. Therefore, dichlorobromomethane in the discharge has a reasonable potential to cause or contribute to an in-stream excursion above the CTR criterion for the protection of human health.
- (c) **WQBELs.** The receiving water contains assimilative capacity for dichlorobromomethane, therefore, a human health dilution credit of 43 was allowed in the development of the WQBELs for dichlorobromomethane. This Order contains a final average monthly effluent limitation (AMEL) and maximum daily effluent limitation (MDEL) for dichlorobromomethane of $22 \mu\text{g/L}$ and $42 \mu\text{g/L}$, respectively, based on the CTR criterion for the protection of human health.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of $10.1 \mu\text{g/L}$ is less than the applicable

WQBELs. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.

vii. **Nitrate and Nitrite**

- (a) **WQO.** DDW has adopted Primary MCLs for the protection of human health for nitrite and nitrate that are equal to 1 mg/L and 10 mg/L (measured as nitrogen), respectively. DDW has also adopted a Primary MCL of 10 mg/L for the sum of nitrate and nitrite, measured as nitrogen.

U.S. EPA has developed a primary MCL and an MCL goal of 1 mg/L for nitrite (as nitrogen). For nitrate, U.S. EPA has developed Drinking Water Standards (10 mg/L as Primary MCL) and NAWQC for protection of human health (10 mg/L for non-cancer health effects).

- (b) **RPA Results.** The Facility is a POTW that treats domestic wastewater. Untreated domestic wastewater contains ammonia in concentrations that is harmful to aquatic life and exceed the Basin Plan's narrative toxicity objective. Inadequate or incomplete treatment may result in the discharge of nitrate and/or nitrite to the receiving stream in concentrations that may exceed the Primary MCL and would violate the Basin Plan's narrative chemical constituents' objective. Therefore, the Central Valley Water Board finds the discharge has a reasonable potential to cause or contribute to an instream excursion above the Primary MCL and WQBELs are required for nitrate plus nitrite.
- (c) **WQBELs.** The receiving water contains assimilative capacity for nitrate plus nitrite, therefore, a dilution credit of 3 was allowed in the development of the WQBELs for nitrate plus nitrite. This Order contains an average monthly effluent limitation (AMEL) and average weekly effluent limitation (AWEL) for nitrate plus nitrite of 40 mg/L and 65 mg/L, respectively, based on the Basin Plan's narrative chemical constituents objective for protection of the MUN beneficial use. These effluent limitations are included in this Order to assure the treatment process adequately nitrifies and denitrifies the waste stream to protect the beneficial use of municipal and domestic supply.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 15.2 mg/L is less than the applicable WQBELs. The Central Valley Water Board

concludes, therefore, that immediate compliance with these effluent limitations is feasible.

viii. **Pathogens**

- (a) **WQO.** In a letter to the Central Valley Water Board dated 8 April 1999, DDW indicated it would consider wastewater discharged to water bodies with identified beneficial uses of irrigation or contact recreation and where the wastewater receives dilution of more than 20:1 to be adequately disinfected if the effluent coliform concentration does not exceed 23 MPN/100 mL as a 7-day median and if the effluent coliform concentration does not exceed 240 MPN/100 mL more than once in any 30 day period. Based on a review of the period of record for the United States Geological Survey monitoring stations on the Sacramento River, there is at least a 20:1 (river flow to design effluent flow) dilution available at all times.
- (b) **RPA Results.** Raw domestic wastewater inherently contains human pathogens that threaten human health and life, and constitute a threatened pollution and nuisance under CWC section 13050 if discharged untreated to the receiving water. Municipal and domestic supply, agricultural irrigation, and body contact water recreation are beneficial uses of the Sacramento River. Although the Discharger provides disinfection, inadequate or incomplete disinfection creates the potential for pathogens to be discharged. Therefore, the Central Valley Water Board finds the discharge has reasonable potential for pathogens and WQBELs are required.
- (c) **WQBELs.** Pursuant to guidance from DDW, this Order includes effluent limitations for total coliform organisms of 23 MPN/100 mL as a 7-day median and 240 MPN/100 mL, not to be exceeded more than once in a 30-day period. These total coliform organisms limits are imposed to protect the beneficial uses of the receiving water, including public health through contact recreation agricultural supply, and drinking water pathways.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows the Facility can meet these WQBELs.

ix. **Persistent Chlorinated Hydrocarbon Pesticides**

- (a) **WQO.** The Basin Plan requires that no individual pesticides shall be present in concentrations that adversely affect beneficial uses; discharges shall not result in pesticide concentrations in bottom sediments or aquatic life that adversely

affect beneficial uses; persistent chlorinated hydrocarbon pesticides shall not be present in the water column at detectable concentrations; and pesticide concentrations shall not exceed those allowable by applicable antidegradation policies.

Persistent chlorinated hydrocarbon pesticides include aldrin; alpha-BHC; beta-BHC; gamma-BHC; delta-BHC; chlordane; 4,4-DDT; 4,4-DDE; 4,4-DDD; dieldrin; alpha-endosulfan; beta-endosulfan; endosulfan sulfate; endrin; endrin aldehyde; heptachlor; heptachlor epoxide; and toxaphene.

- (b) **RPA Results.** 4,4-DDE was detected in the effluent in concentrations as high as 0.027 µg/L. The detection of 4,4-DDE in the effluent presents a reasonable potential to exceed the Basin Plan objectives for persistent chlorinated hydrocarbon pesticides.
- (c) **WQBELs.** Effluent limitations for 4,4-DDE are included in this Order and are based on the CTR criterion for protection of human health for waters from which both water and organisms are consumed. For 4,4-DDE, this Order contains a final average monthly effluent limitation (AMEL) and maximum daily effluent limitation (MDEL) of 0.00059 µg/L and 0.0012 µg/L, respectively, based on the CTR criterion for the protection of human health.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 0.027 µg/L (4,4-DDE) is greater than applicable WQBELs. However, three out of the four samples collected between 2020 and 2021 for 4,4-DDE were reported as non-detect (<0.00018). Therefore, compliance with the final effluent limitations for 4,4- DDE is achievable.

x. **pH**

- (a) **WQO.** The Basin Plan includes a water quality objective for surface waters (except for Goose Lake) that the “pH shall not be depressed below 6.5 nor raised above 8.5.”
- (b) **RPA Results.** Raw domestic wastewater inherently has variable pH. Additionally, some wastewater treatment processes can increase or decrease wastewater pH which if not properly controlled, would violate the Basin Plan’s numeric objective for pH in the receiving water. Between January 2021 and February 2024, the effluent pH ranged from 6.42 to 7.18, the upstream receiving water pH ranged from 6.7 to 7.85, and downstream receiving water pH ranged from 6.77 to 7.9. The data indicates that the effluent did exceed the Basin Plan

objectives but did not cause or contribute to any identifiable exceedances of pH in the receiving water. Therefore, reasonable potential exists for pH and WQBELs are required.

- (c) **WQBELs.** Consistent with Order R5-2019-0068, this Order includes an instantaneous minimum effluent limitation of 6.0 and an instantaneous maximum effluent limitation of 8.5.
 - (d) **Plant Performance and Attainability.** The effluent pH range was within the instantaneous minimum and instantaneous maximum effluent limitations established in this Order based on 1,158 samples. Therefore, the Central Valley Water Board concludes that the Discharger can consistently comply with these effluent limitations.
- xi. **Total Suspended Solids (TSS) and Biochemical Oxygen Demand (BOD5)**
- (a) **WQO.** There are no applicable water quality objectives for BOD5 and TSS in the receiving water. However, these compounds are oxygen-demanding substances that can reduce dissolved oxygen concentrations in the receiving water. The Basin Plan contains a water quality objective for the Sacramento River from Keswick Dam to Hamilton City for dissolved oxygen of 9.0 mg/L, from 1 June to 31 August, and 7.0 mg/L at all other times.. Furthermore, the Basin Plan contains a water quality objective for suspended material that states, “Water shall not contain suspended material in concentrations that cause nuisance or adversely affect beneficial uses.”
 - (b) **RPA Results.** The Facility provides advanced-secondary filtration, therefore, based on water quality data for the effluent, the discharge does not demonstrate reasonable potential to cause or contribute to the applicable water quality objectives. However, the Facility type may be used as information to aid in determining if a WQBEL is required. BOD5 is a measure of the amount of oxygen used in the biochemical oxidation of organic matter. The Discharger is a POTW that treats domestic wastewater. Domestic wastewater inherently contains BOD5 and TSS. Unless properly treated, the discharge of BOD5 and TSS can cause or contribute to the applicable water quality objectives in the receiving water.
 - (c) **WQBELs.** There are no numeric water quality objectives that are available to calculate WQBEL’s for BOD5 and TSS. However, the Facility provides advanced-secondary treatment

and the treatment process includes filtration. The principal design parameter for wastewater treatment plants is the daily BOD5 and TSS loading rates and the corresponding removal rate of the system. The advanced-secondary treatment process removes BOD5 and TSS and these compounds are used as indicators of the effectiveness of the treatment processes. Consequently, this Order includes effluent limits for BOD5 and TSS that reflect the technical capability of the advanced-secondary (or tertiary) filtration process, protect the beneficial uses of the receiving water, and minimize degradation.

This Order contains AMEL's and AWEL's for BOD5 and TSS of 10 mg/L and 15 mg/L, respectively, which is technically based on the capability of an advanced-secondary or tertiary system.

xii. **Zinc**

- (a) **WQO.** The CTR includes hardness-dependent criteria for the protection of freshwater aquatic life for zinc. These criteria for zinc are presented in dissolved concentrations, as 1-hour acute criteria and 4-day chronic criteria. Site specific translators were used in the conversion of dissolved criteria for zinc to total recoverable criteria for zinc (as discussed in Fact Sheet section IV.C.2.c.iii(c)). The applicable CTR acute and chronic criteria for zinc in the effluent are 73 µg/L and 73 µg/L, respectively, as total recoverable.

The Basin Plan includes a site-specific, hardness-dependent, maximum concentration water quality objective for the Sacramento River and its tributaries above the State Highway 32 Bridge at Hamilton City. Using site specific conversion factors and the selected ambient hardness described in section IV.C.2.b of this Fact Sheet, the applicable Basin Plan maximum concentration objective for zinc in the effluent is 18 µg/L, as total recoverable.

- (b) **RPA Results.** The maximum effluent concentration for zinc was 67.1 µg/L, based on 38 samples collected between January 2021 and February 2024. The maximum observed upstream receiving water total recoverable zinc concentration was 63.6 µg/L, based on 40 samples collected between January 2021 and February 2024. However, the zinc dissolved concentration on the same day as the reported maximum total recoverable zinc concentration of 63.6 µg/L, was reported at 1.7 µg/L (detected but not qualified). Furthermore, the maximum dissolved zinc concentration observed in the receiving water for the 2021 to 2024 monitoring period was

7.4 µg/L. The RPA was conducted using the upstream receiving water hardness to calculate the criteria for comparison to the maximum ambient background concentration, and likewise using the reasonable worst-case downstream hardness shown in section IV.C.2 of this Fact Sheet to compare the maximum effluent concentration. The table below shows the specific criteria used for the RPA:

Table F-13 Zinc RPA Criteria

Water Type	Basin Plan Objective (Total)	Maximum Concentration	Criteria Exceeded? (Y/N)
Receiving Water	18 µg/L	63.6 µg/L (total) 7.4 µg/L (diss.)	Yes No
Effluent	18 µg/L	67.1 µg/L (total)	Yes

Table F-13 Notes:

1. **Receiving Water.** The CTR Chronic Criterion (Total) for the receiving water is based on the lowest observed upstream hardness of 30.5 mg/L (as CaCO₃).
2. **Effluent.** The CTR Chronic Criterion (Total) for the effluent is based on reasonable worst-case downstream hardness of 30.5 mg/L (as CaCO₃).

Based on the available data, the maximum effluent concentration exceeded the applicable criteria. Therefore, per section 1.3, step 6 of the SIP, zinc in the discharge has a reasonable potential to cause or contribute to an instream excursion above the CTR criteria for the protection of freshwater aquatic life.

- (c) **WQBELs.** This Order contains a final average monthly effluent limitation (AMEL) and maximum daily effluent limitation (MDEL) for zinc of 70 µg/L and 98 µg/L, respectively. The WQBELs were calculated with the allowance of acute and chronic aquatic life criteria mixing zones and dilution credits based on the CTR criteria for the protection of freshwater aquatic life as discussed in section IV.C.2 of this Fact Sheet.
- (d) **Plant Performance and Attainability.** Analysis of the effluent data shows that the MEC of 67.1 µg/L is less than the applicable WQBELs. The Central Valley Water Board concludes, therefore, that immediate compliance with these effluent limitations is feasible.

4. WQBEL Calculations

- a. This Order includes WQBELs for ammonia, 4,4-DDE, BOD5, pH, TSS, chlorodibromomethane, dichlorobromomethane, total recoverable zinc, total residual chlorine, total recoverable copper, cyanide, nitrate plus nitrite, diazinon and chlorpyrifos, and total coliform organisms. The general methodology for calculating WQBELs based on the different criteria/objectives is described in subsections IV.C.5.b through e, below. See Attachment H for the WQBEL calculations.
- b. **Effluent Concentration Allowance.** For each water quality criterion/objective, the ECA is calculated using the following steady-state mass balance equation from section 1.4 of the SIP:

$$ECA = C + D(C - B) \text{ where } C > B, \text{ and}$$

$$ECA = C \text{ where } C \leq B$$

Where:

ECA = effluent concentration allowance

D = dilution credit

C = the priority pollutant criterion/objective

B = the ambient background concentration.

According to the SIP, the ambient background concentration (B) in the equation above shall be the observed maximum with the exception that an ECA calculated from a priority pollutant criterion/objective that is intended to protect human health from carcinogenic effects shall use the arithmetic mean concentration of the ambient background samples.

- c. **Primary and Secondary MCLs.** For non-priority pollutants with primary MCLs to protect human health (e.g., nitrate plus nitrite), the AMEL is set equal to the primary MCL and the AWEL is calculated using the AWEL/AMEL multiplier, where the AWEL multiplier is based on a 98th percentile occurrence probability and the AMEL multiplier is from Table 2 of the SIP.

For non-priority pollutants with secondary MCLs that protect public welfare (e.g., taste, odor, and staining), WQBELs were calculated by setting the LTA equal to the secondary MCL and using the AMEL multiplier to set the AMEL. The AWEL was calculated using the MDEL/AMEL multiplier from Table 2 of the SIP.

- d. **Aquatic Toxicity Criteria.** For priority pollutants with acute and chronic aquatic toxicity criteria, the WQBELs are calculated in accordance with section 1.4 of the SIP. The ECAs are converted to equivalent long-term averages (i.e. LTA_{acute} and LTA_{chronic}) using statistical multipliers and the lowest LTA is used to calculate the AMEL and MDEL using additional

statistical multipliers. For non-priority pollutants, WQBELs are calculated using similar procedures, except that an AWEL is determined utilizing multipliers based on a 98th percentile occurrence probability.

- e. **Human Health Criteria.** For priority pollutants with human health criteria, the WQBELs are calculated in accordance with section 1.4 of the SIP. The AMEL is set equal to the ECA and the MDEL is calculated using the MDEL/AMEL multiplier from Table 2 of the SIP. For non-priority pollutants with human health criteria, WQBELs are calculated using similar procedures, except that an AWEL is established using the MDEL/AMEL multiplier from Table 2 of the SIP.

$$\begin{aligned}
 AMEL &= mult_{AMEL} \left[\min \left(\overbrace{M_A ECA_{acute}, M_C ECA_{chronic}}^{LTA_{acute}} \right) \right] \\
 MDEL &= mult_{MDEL} \left[\min \left(M_A ECA_{acute}, \underbrace{M_C ECA_{chronic}}_{LTA_{chronic}} \right) \right] \\
 MDEL_{HH} &= \left(\frac{mult_{MDEL}}{mult_{AMEL}} \right) AMEL_{HH}
 \end{aligned}$$

Where:

- mult_{AMEL} = statistical multiplier converting minimum LTA to AMEL
- mult_{MDEL} = statistical multiplier converting minimum LTA to MDEL
- M_A = statistical multiplier converting acute ECA to LTA_{acute}
- M_C = statistical multiplier converting chronic ECA to LTA_{chronic}

**Summary of Water Quality-Based Effluent Limitations
 Discharge Point 001**

Table F-14 Summary of Water Quality-Based Effluent Limitations

Parameter	Units	Average Monthly Effluent Limitations	Average Weekly Effluent Limitations	Maximum Daily Effluent Limitations
Ammonia Nitrogen, Total (as N)	mg/L	5.4	12	--
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	10	15	--
4,4-DDE	µg/L	0.00059		0.0012
Chlorodibromomethane	µg/L	8	--	17
Chlorine, Total Residual	mg/L	0.011	0.019	--
Copper, Total Recoverable	µg/L	22	--	31
Cyanide	µg/L	40	--	77
Diazinon and Chlorpyrifos	µg/L	See Table Notes	See Table Notes	--
Dichlorobromomethane	µg/L	22	--	42
Nitrate plus Nitrite	mg/L	40	65	
pH	Standard Units	--	--	6.0 – 8.5
Total Coliform Organisms	MPN/100mL	240	23	
Total Suspended Solids	mg/L	10	15	
Zinc, Total Recoverable	µg/L	70	--	98

Table F-14 Notes:

- Chlorine, Total Residual** – Average Monthly Effluent Limitation. Applied as a 4-day average effluent limitation.
- Chlorine, Total Residual** – Average Weekly Effluent Limitation. Applied as a 1- hour average effluent limitation.
- Diazinon and Chlorpyrifos** – Average Monthly Effluent Limitation.

$$S_{avg} = \frac{C_{D\ avg}}{0.079} + \frac{C_{C\ avg}}{0.012} \leq 1.0$$

- Diazinon and Chlorpyrifos** – Average Weekly Effluent Limitation.

$$S_{avg} = \frac{C_{D\ avg}}{0.14} + \frac{C_{C\ avg}}{0.021} \leq 1.0$$

- pH – Effluent Limitations.** Applied as a range from instantaneous minimum to instantaneous maximum.
- Total Coliform Organisms** – Average Monthly Effluent Limitation. Applied as: Not to exceed 240 MPN/100mL more than once in any 30-day period.

7. **Total Coliform Organisms – Average Weekly Effluent Limitation.** Applied as a 7-day median.

5. **Whole Effluent Toxicity (WET)**

The State Water Board's toxicity provisions, which include numeric objectives for acute and chronic aquatic toxicity, are applicable to this discharge and are hereafter referred to as the Toxicity Provisions.

To evaluate compliance with the Statewide Toxicity Provisions aquatic toxicity numeric objectives, acute and chronic whole effluent toxicity testing data has been evaluated in the development of this Order.

a. **Acute Toxicity**

- i. **WQO.** The acute aquatic toxicity water quality objective is expressed as a null hypothesis and an alternative hypothesis with a regulatory management decision (RMD) of 0.80, where the following null hypothesis, H_0 , shall be used:

H_0 : Mean response (ambient water) \leq 0.80 • mean response (control)

And where the following alternative hypothesis, H_a , shall be used:

H_a : Mean response (ambient water) $>$ 0.80 • mean response (control)

Attainment of the water quality objective is demonstrated by conducting acute aquatic toxicity testing and rejecting this null hypothesis in accordance with the TST statistical approach. When the null hypothesis is rejected, the alternative hypothesis is accepted in its place, and there is no exceedance of the acute aquatic toxicity water quality objective. Failing to reject the null hypothesis (referred to as a “fail”) is equivalent to an exceedance of the acute aquatic toxicity water quality objective.

- ii. **RPA.** In accordance with section III.C.3.b of the Statewide Toxicity Provisions, an RPA for acute aquatic toxicity was conducted. The basis for the decision to conduct an RPA for acute aquatic toxicity was because the facility discharges to a waterbody inhabited by threatened or endangered species. Table F-15 below is acute WET testing performed by the Discharger from January 2019 through January 2024.

Table F-15 Acute Whole Effluent Toxicity Testing Results

Date	Rainbow Trout (<i>Oncorhynchus mykiss</i>) Survival
	Percent Survival
1/14/2021	100
4/1/2021	95
7/1/2021	100
10/7/2021	100
1/20/2022	100
4/7/2022	100
7/7/2022	100
10/6/2022	100
1/5/2023	100
4/3/2023	100
7/10/2023	100
10/2/2023	100
1/4/2024	100

Acute WET testing performed by the Discharger was conducted at an IWC of 100 percent. Results of testing were limited to reporting on percent survival; and the evaluated toxicity data conducted at the IWC was not analyzed using the Test for Significant Toxicity (TST). Due to the lack of TST results, an RPA consistent with Statewide Toxicity Provisions section III.C.3.c.i is not possible. However, consistent with section III.C.3.c.ii of the Statewide Toxicity Provisions, Central Valley Water Board staff may utilize other information or data to make a reasonable potential determination. Other information or data includes the Discharger’s January 2019 through January 2024 acute toxicity testing that was conducted with an IWC of 100 percent, and although this data did not have the TST results, Central Valley Water Board staff are able to make the determination that the discharge does not have a reasonable potential to cause or contribute to an instream exceedance of the Statewide Toxicity Provisions aquatic toxicity numeric objectives and the Basin Plan’s narrative toxicity objective based on the high percent survival rates demonstrated in the acute WET testing results. Therefore, water quality-based effluent limits for acute toxicity are not required.

- iii. **WQBELs.** Effluent limitations have not been established for acute whole effluent toxicity because there is no reasonable potential to cause or contribute to an instream exceedance of the Statewide Toxicity Provisions numeric chronic aquatic toxicity objective and Basin Plan’s narrative toxicity objective.

b. **Chronic Toxicity**

- i. **WQO.** The chronic aquatic toxicity water quality objective is expressed as a null hypothesis and an alternative hypothesis with a regulatory management decision (RMD) of 0.75, where the following null hypothesis, H_0 , shall be used

H_0 : Mean response (ambient water) $\leq 0.75 \cdot$ mean response (control)

And where the following alternative hypothesis, H_a , shall be used:

H_a : Mean response (ambient water) $> 0.75 \cdot$ mean response (control)

Attainment of the water quality objective is demonstrated by conducting chronic aquatic toxicity testing and rejecting this null hypothesis in accordance with the Test of Significant Toxicity (TST) statistical approach described in National Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document (EPA 833-R-10-003, 2010), Appendix A, Figure A-1 and Table A-1 (Chronic Freshwater and East Coast Methods) and Appendix B, Table B-1. When the null hypothesis is rejected, the alternative hypothesis is accepted in its place, and there is no exceedance of the chronic aquatic toxicity water quality objective. Failing to reject the null hypothesis (referred to as a "fail") is equivalent to an exceedance of the chronic aquatic toxicity water quality objective.

- ii. **RPA.** Chronic toxicity testing has been conducted at an instream waste concentration (IWC) of 100 percent effluent. A test result that fails the Test of Significant Toxicity (TST) or has a percent effect of 10 percent or greater at the IWC demonstrates the discharge has a reasonable potential to cause or contribute to an exceedance of the Statewide Toxicity Provisions aquatic toxicity numeric objectives and Basin Plan's narrative toxicity objective. Based on chronic toxicity testing conducted between July 2019 through July 2013 there were one or more fails of the TST and the percent effect exceeded 10 percent, therefore, the discharge has a reasonable potential to cause or contribute to an instream exceedance of the Statewide Toxicity Provisions numeric chronic aquatic toxicity objective and Basin Plan's narrative toxicity objective.

The table below is chronic WET testing performed by the Discharger from July 2019 through July 2023.

Table F-16 Chronic Whole Effluent Toxicity Testing Results – Test of Significant Toxicity at the IWC (100 Percent Effluent)

Date	Fathead Minnow (<i>Pimephales promelas</i>) Survival		Fathead Minnow (<i>Pimephales promelas</i>) Growth		Water Flea (<i>Ceriodaphnia dubia</i>) Survival		Water Flea (<i>Ceriodaphnia dubia</i>) Reproduction		Green Algae (<i>Selenastrum capricornutum</i>) Growth	
	Pass/Fail	Percent Effect	Pass/Fail	Percent Effect	Pass/Fail	Percent Effect	Pass/Fail	Percent Effect	Pass/Fail	Percent Effect
7/22/2019	Pass	1.63	Pass	1.67	NA	0.36	Pass	0.36	Pass	-218
7/14/2020	NA	NA	Pass	2.02	NA	NA	Pass	-5.82	Pass	-40.04
7/13/2021	Pass	-5.56	Pass	-22.07	NA	10	Pass	-0.58	Pass	-115.17
7/11/2022	Pass	-2.56	Pass	-29.95	NA	6	Fail	39.61	Pass	-50.21
7/10/2023	Pass	-11.11	Pass	-29.84	NA	-11.11	Pass	-3.45	Pass	-140.50

- iii. **WQBELs.** As discussed in Attachment F, section IV.C.2.c.vi(h), a dilution credit of 8 (IWC of 11.1 percent effluent) is available for chronic whole effluent toxicity. Effluent limitations have been established in Section IV.A.1 of this Order for chronic whole effluent toxicity. The following effluent limitations have been established for chronic whole effluent toxicity:

Chronic Whole Effluent Toxicity Maximum Daily Effluent Limitation (MDEL). No *Ceriodaphnia dubia* (water flea) chronic aquatic toxicity test shall result in a “Fail” at the chronic Instream Waste Concentration (IWC) for the sub-lethal endpoint measured in the test AND a percent effect for the survival endpoint greater than or equal to 50 percent.

Chronic Whole Effluent Toxicity Monthly Median Effluent Limitation (MMEL). No more than one *Ceriodaphnia dubia* (water flea) chronic aquatic toxicity test initiated in a toxicity calendar month shall result in a “Fail” at the chronic IWC for any endpoint.

D. Final Effluent Limitation Considerations

1. Mass-based Effluent Limitations

40 C.F.R section 122.45(f)(1) requires effluent limitations be expressed in terms of mass, with some exceptions, and 40 C.F.R. section 122.45(f)(2) allows pollutants that are limited in terms of mass to additionally be limited in terms of other units of measurement. Pursuant to the exceptions to mass limitations provided in 40 C.F.R. section 122.45(f)(1), some effluent limitations are not expressed in terms of mass, such as pH and temperature, and when the applicable standards are expressed in terms of concentration (e.g., CTR criteria

and MCLs) and mass limitations are not necessary to protect the beneficial uses of the receiving water.

2. Averaging Periods for Effluent Limitations

40 C.F.R. section 122.45 (d) requires average weekly and average monthly discharge limitations for POTWs unless impracticable. For chlorodibromomethane, copper, cyanide, dichlorobromomethane, 4,4-DDE, and zinc, average weekly effluent limitations have been replaced with maximum daily effluent limitations in accordance with section 1.4 of the SIP. Furthermore, for pH, chlorine residual, and total coliform organisms, weekly average effluent limitations have been replaced or supplemented with effluent limitations utilizing shorter averaging periods. The rationale for using shorter averaging periods for these constituents is discussed in section IV.C.3 of this Fact Sheet.

3. Satisfaction of Anti-Backsliding Requirements

The CWA specifies that a revised permit may not include effluent limitations that are less stringent than the previous permit unless a less stringent limitation is justified based on exceptions to the anti-backsliding provisions contained in CWA sections 402(o) or 303(d)(4), or, where applicable, 40 C.F.R. section 122.44(l).

The effluent limitations in this Order are at least as stringent as the effluent limitations in the previous Order, with the exception of effluent limitations for electrical conductivity and acute whole effluent toxicity. The electrical conductivity annual average effluent limit (430 $\mu\text{mhos/cm}$) established in Order No. 2019-0068 has not been retained in this Order, instead the Order includes performance-based annual average trigger of 520 $\mu\text{mhos/cm}$. The trigger has been established as a result of the Discharge's enrollment in the CV-SALTS Prioritization & Optimization Study (P&O Study). This adjustment ensures that the impact of the discharge is monitored and managed in alignment with the broader objectives of the P&O Study, allowing for a more adaptive and research-informed approach to maintaining water quality. The effluent limitation for acute whole effluent toxicity has been removed.

This relaxation of effluent limitations is consistent with the anti-backsliding requirements of the CWA and federal regulations.

- a. **CWA section 402(o)(1) and 303(d)(4).** CWA section 402(o)(1) prohibits the establishment of less stringent water quality-based effluent limits “except in compliance with section 303(d)(4).” CWA section 303(d)(4) has two parts: paragraph (A) which applies to nonattainment waters and paragraph (B) which applies to attainment waters.
 - i. For waters where standards are not attained, CWA section 303(d)(4)(A) specifies that any effluent limit based on a TMDL or

other WLA may be revised only if the cumulative effect of all such revised effluent limits based on such TMDLs or WLAs will assure the attainment of such water quality standards.

- ii. For attainment waters, CWA section 303(d)(4)(B) specifies that a limitation based on a water quality standard may be relaxed where the action is consistent with the antidegradation policy.

The Sacramento River is considered an attainment water for electrical conductivity and acute aquatic toxicity because the receiving water is not listed as impaired on the 303(d) list for these constituents. While the Sacramento River (Keswick Dam to Cottonwood Creek) is listed for toxicity based on the narrative water quality toxicity objective, the historical lines of evidence do not demonstrate exceedances of the acute aquatic toxicity objective established by the Toxicity Provisions. The exceptions in section 303(d)(4) address both waters in attainment with water quality standards and those not in attainment, i.e. waters on the section 303(d) impaired waters list. As discussed in section IV.D.5, below, relaxation or removal of the effluent limits complies with federal and state antidegradation requirements. Thus, the removal of the effluent limitation for electrical conductivity and acute whole effluent toxicity from Order R5-2019-0068 meets the exception in CWA section 303(d)(4)(B).

- b. **CWA section 402(o)(2).** CWA section 402(o)(2) provides several exceptions to the anti-backsliding regulations. CWA 402(o)(2)(B)(i) allows a renewed, reissued, or modified permit to contain a less stringent effluent limitation for a pollutant if information is available which was not available at the time of permit issuance (other than revised regulations, guidance, or test methods) and which would have justified the application of a less stringent effluent limitation at the time of permit issuance.

As described further in section IV.C.3.b of this Fact Sheet, updated information that was not available at the time Order R5-2019-0068 was issued indicates that electrical conductivity does not exhibit reasonable potential to cause or contribute to an exceedance of water quality objectives in the receiving water. Additionally, the Discharger is enrolled in the CV-SALTS Prioritization & Optimization Study (P&O Study) and a performance-based annual average trigger for electrical conductivity of 520 $\mu\text{mhos/cm}$ has been included in this Order. Enrollment in the P&O Study and the performance trigger ensures that the impact of the discharge is monitored and managed in alignment with the broader objectives of the CV-Salts Program, allowing for a more adaptive and research-informed approach to maintaining water quality.

This Order removes the effluent limitation for acute whole effluent toxicity consistent with the Statewide Toxicity Provisions as described in Fact Sheet Section IV.C.5.ii.. Effluent monitoring data collected from January 2019 through January 2024 indicate the discharge does not exhibit reasonable potential to cause or contribute to an exceedance of the acute aquatic toxicity objective.

Thus, removal or relaxation of the effluent limitations for electrical conductivity and acute whole effluent toxicity from Order R5-2019-0068 is in accordance with CWA section 402(o)(2)(B)(i), which allows for less stringent effluent limitations based on information that was not available at the time of permit issuance.

4. Antidegradation Policies

This Order does not allow for an increase in flow or mass of pollutants to the receiving water. The Order requires compliance with applicable federal technology-based standards and with WQBELs where the discharge could have the reasonable potential to cause or contribute to an exceedance of water quality standards. Accordingly, the permitted discharge is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and the State Anti-Degradation Policy.

This Order removes the annual average effluent limitation for electrical conductivity based on updated monitoring data demonstrating that the effluent does not cause or contribute to an exceedance of the applicable water quality criteria or objectives in the Sacramento River, further the Discharger is enrolled in the CV-SALTS P&O Study and a performance-based annual average trigger for electrical conductivity has been applied to the discharge in this Order. The removal of the WQBEL for electrical conductivity will not result in a decrease in the level of treatment or control, or a reduction of water quality. Therefore, the Central Valley Water Board finds that the removal of the electrical conductivity effluent limitation does not result in any additional degradation of the receiving water. Thus, the removal of effluent limitations is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and the State Anti-Degradation Policy.

This Order also removes the effluent limitation for acute whole effluent toxicity based on updated monitoring data demonstrating that the effluent does not cause or contribute to an exceedance of the applicable water quality criteria or objectives in the receiving water. The Central Valley Water Board finds that the removal and revision of the effluent limitation for acute whole effluent toxicity does not result in an increase in pollutants or any additional degradation of the receiving water. Thus, the removal and revision of effluent limitations is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and the State Anti-Degradation Policy.

This Order also removes the mass-based effluent limitation for ammonia based on 40 CFR parts 122.45 (d) and (f). The removal of mass-based effluent limits for ammonia will not result in a decrease in the level of treatment or control or a reduction in water quality. Furthermore, both a concentration-based AMEL and AWEL remain for ammonia as well as an average dry weather flow prohibition that limits the amount of flow that can be discharged to the receiving water during dry weather months. The combination of concentration-based effluent limits and a flow prohibition in this Order are equivalent to mass-based effluent limitations, which were redundant limits contained in previous Orders by multiplying the concentration-based effluent limits and permitted average dry weather flow by a conversion factor to determine the mass-based effluent limitations. The Central Valley Water Board finds that the removal of the mass-based effluent limit for ammonia does not result in an allowed increase in pollutants or any additional degradation of the receiving water. Thus, the removal of mass-based effluent limits ammonia is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and the State Antidegradation Policy.

5. Stringency of Requirements for Individual Pollutants

This Order contains both technology-based effluent limitations and WQBELs for individual pollutants. The technology-based effluent limitations consist of restrictions on BOD5, pH, and TSS. Restrictions on BOD5, pH, and TSS are discussed in Section IV.B.2 of the Fact Sheet. This Order's technology-based pollutant restrictions implement the minimum, applicable federal technology-based requirements. In addition, this Order contains effluent limitations more stringent than the minimum, federal technology-based requirements that are necessary to meet water quality standards. For BOD5, pH, and TSS, both technology-based effluent limitations and water quality-based effluent limitations are applicable. The more stringent of these effluent limitations are implemented by this Order. These limitations are not more stringent than required by the CWA.

WQBELs have been derived to implement water quality objectives that protect beneficial uses. Both the beneficial uses and the water quality objectives have been approved pursuant to federal law and are the applicable federal water quality standards. To the extent that toxic pollutant WQBELs were derived from the CTR, the CTR is the applicable standard pursuant to 40 C.F.R. section 131.38. The procedures for calculating the individual WQBELs for priority pollutants are based on the CTR implemented by the SIP, which was approved by U.S. EPA on 18 May 2000. Collectively, this Order's restrictions on individual pollutants are no more stringent than required to implement the requirements of the CWA.

**Summary of Final Effluent Limitations
 Discharge Point - 001**

Table F-17 Summary of Final Effluent Limitations

Parameter	Units	Effluent Limitations	Basis
4,4, DDE	µg/L	AMEL 0.00059 MDEL 0.0012	CTR
Ammonia, Total (as N)	mg/L	AMEL 5.4 AWEL 12	NAWQC
Biochemical Oxygen Demand (5-day @ 20°C)	mg/L	AMEL 10 AWEL 15	TTC
Biochemical Oxygen Demand (5-day @ 20°C)	% Removal	AMEL 85	CFR
Chlorine, Total Residual	mg/L	4-day average 0.011 1-hour average 0.019	NAWQC
Chlorodibromomethane	µg/L	AMEL 8 MDEL 17	CTR
Copper, Total Recoverable	µg/L	AMEL 22 MDEL 31	CTR
Cyanide	µg/L	AMEL 40 MDEL 77	CTR
Diazinon and Chlorpyrifos	µg/L	See table notes 2 and 3	TMDL
Dichlorobromomethane	µg/L	AMEL 22 MDEL 42	CTR
pH	SU	Instantaneous Max 8.5 Instantaneous Min 6.0	BP, CFR
Nitrate plus Nitrite (as N)	mg/L	AMEL 40 AWEL 65	MCL
Total Coliform Organisms	MPN/100 mL	7-day median: 23 More than once in a 30-day period: 240	Title 22
Total Suspended Solids	mg/L	AMEL 10 AWEL 15	TTC
Total Suspended Solids	% Removal	AMEL 85	CFR
Zinc, Total Recoverable	µg/L	AMEL 70 MDEL 98	BP
Chronic Toxicity	Pass/Fail	MDEL: Pass MMEL: Pass	TOX

Table F-17 Notes:

1. **DC** – Based on the design capacity of the Facility.
TTC – Based on tertiary treatment capability. These effluent limitations reflect the capability of a properly operated tertiary treatment plant.

CFR – Based on secondary treatment standards contained in 40 CFR part 133.

BP – Based on water quality objectives contained in the Basin Plan.

CTR – Based on water quality criteria contained in the California Toxics Rule and applied as specified in the SIP.

NAWQC – Based on U.S. EPA’s National Ambient Water Quality Criteria for the protection of freshwater aquatic life.

TMDL – Based on the TMDL for diazinon and chlorpyrifos in the Sacramento River.

MCL – Based on the Primary Maximum Contaminant Level.

Title 22 – Based on State Water Board Division of Drinking Water Reclamation Criteria, CCR, Division 4, Chapter 3 (Title 22).

2. **Diazinon and Chlorpyrifos – Average Monthly Effluent Limitation.**

$$S_{avg} = \frac{C_{D\ avg}}{0.079} + \frac{C_{C\ avg}}{0.012} \leq 1.0$$

3. **Diazinon and Chlorpyrifos – Average Weekly Effluent Limitation.**

$$S_{avg} = \frac{C_{D\ avg}}{0.14} + \frac{C_{C\ avg}}{0.021} \leq 1.0$$

E. Interim Effluent Limitations - Not Applicable

F. Land Discharge Specifications – Not Applicable

G. Recycling Specifications – Not Applicable

V. RATIONALE FOR RECEIVING WATER LIMITATIONS

A. Surface Water

1. CWA section 303(a-c), requires states to adopt water quality standards, including criteria where they are necessary to protect beneficial uses. The Central Valley Water Board adopted water quality criteria as water quality objectives in the Basin Plan. The Basin Plan states that “[t]he numerical and narrative water quality objectives define the least stringent standards that the Regional Water Board will apply to regional waters in order to protect the beneficial uses.” The Basin Plan includes numeric and narrative water quality objectives for various beneficial uses and water bodies. This Order contains receiving surface water limitations based on the Basin Plan numerical and narrative water quality objectives for ammonia, bacteria, biostimulatory substances, color, chemical constituents, dissolved oxygen, floating material, oil and grease, pH, pesticides, radioactivity, suspended sediment, settleable substances, suspended material, tastes and odors, temperature, toxicity, and turbidity.

- a. **Bacteria.** On 7 August 2018 the State Water Board adopted Resolution No. 2018-0038 establishing Bacteria Provisions, which are specifically titled “Part 3 of the Water Quality Control Plan for Inland Surface Waters, Enclosed Bays,

and Estuaries of California—Bacteria Provisions and a Water Quality Standards Variance Policy” and “Amendment to the Water Quality Control Plan for Ocean Waters of California—Bacteria Provisions and a Water Quality Standards Variance Policy.” The Bacteria Water Quality Objectives established in the Bacteria Provisions supersede any numeric water quality objective for bacteria for the REC-1 beneficial use contained in a water quality control plan before the effective date of the Bacteria Provisions.

The Bacteria Water Quality Objectives correspond with the risk protection level of 32 illnesses per 1,000 recreators and use *E. coli* as the indicator of pathogens in freshwaters and enterococci as the indicator of pathogens in estuarine waters and ocean waters.

The Bacteria Provisions provide that where a permit, waste discharge requirement (WDR), or waiver of WDR includes an effluent limitation or discharge requirement that is derived from a water quality objective or other guidance to control bacteria (for any beneficial use) that is more stringent than the Bacteria Water Quality Objective, the Bacteria Water Quality Objective would not be implemented in the permit, WDR, or waiver of WDR. This standard has not been met in this Order, therefore, the Bacteria Water Quality Objective has been implemented as a receiving water limitation.

The bacteria receiving water limitation in this Order has been established based on the Bacterial Water Quality Objective for inland surface waters, which requires the six-week rolling geometric mean of *Escherichia coli* (*E. coli*) shall not exceed 100 colony forming units (cfu) per 100 milliliters (mL), calculated weekly, and a statistical threshold value (STV) of 320 cfu/100 mL not to be exceeded by more than 10 percent of the samples collected in a calendar month, calculated in a static manner.

B. Groundwater

Release of waste constituents from any portion of the Facility shall not cause or contribute to groundwater containing constituent concentrations in excess of the concentrations specified below or in excess of background groundwater quality, whichever is greater:

1. The Primary or Secondary MCLs established in Title 22 of the California Code of Regulations, excluding salinity.
2. Taste or odor-producing constituents, toxic substances, or any other constituents in concentrations that cause nuisance or adversely affect any beneficial use.
3. A total coliform organism level of 2.2 MPN/100 mL over any seven-day period.

VI. RATIONALE FOR PROVISIONS

A. Standard Provisions

Standard Provisions, which apply to all NPDES permits in accordance with 40 C.F.R. section 122.41, and additional conditions applicable to specified categories of permits in accordance with 40 C.F.R. section 122.42, are provided in Attachment D. The discharger must comply with all standard provisions and with those additional conditions that are applicable under section 122.42.

Sections 122.41(a)(1) and (b) through (n) of 40 C.F.R. establish conditions that apply to all state issued NPDES permits. These conditions must be incorporated into the permits either expressly or by reference. If incorporated by reference, a specific citation to the regulations must be included in the Order. Section 123.25(a)(12) of 40 C.F.R. allows the state to omit or modify conditions to impose more stringent requirements. In accordance with 40 C.F.R. section 123.25, this Order omits federal conditions that address enforcement authority specified in 40 C.F.R. sections 122.41(j)(5) and (k)(2) because the enforcement authority under the Water Code is more stringent. In lieu of these conditions, this Order incorporates by reference Water Code section 13387(e).

B. Special Provisions

1. Reopener Provisions

- a. **Mercury.** This provision allows the Central Valley Water Board to reopen this Order in the event mercury is found to be causing toxicity based on acute or chronic toxicity test results, or if a TMDL program is adopted. In addition, this Order may be reopened if the Central Valley Water Board determines that a mercury offset program is feasible for dischargers subject to NPDES permits.
- b. **Central Valley Salinity Alternatives for Long-Term Sustainability (CV-SALTS).** On 17 January 2020, certain Basin Plan Amendments to incorporate new strategies for addressing ongoing salt and nitrate accumulation in the Central Valley became effective. Other provisions subject to U.S. EPA approval became effective on 2 November 2020, when approved by U.S. EPA. As the Central Valley Water Board moves forward to implement those provisions that are now in effect, this Order may be amended or modified to incorporate new or modified requirements necessary for implementation of the Basin Plan Amendments. More information regarding these Amendments can be found on the [Central Valley Salinity Alternatives for Long-Term Sustainability \(CV-SALTS\)](https://www.waterboards.ca.gov/centralvalley/water_issues/salinity/) web page:
(https://www.waterboards.ca.gov/centralvalley/water_issues/salinity/)
- c. **Water Effects Ratio (WER) and Metal Translators.** A default WER of 1.0 has been used in this Order for calculating criteria for applicable

inorganic constituents. In addition, site-specific dissolved-to-total metal translators have been used to convert water quality objectives from dissolved to total when developing effluent limitations for copper and zinc. If the Discharger performs studies to determine site-specific WERs and/or update the site-specific dissolved-to-total metal translators, this Order may be reopened to modify the effluent limitations for the applicable inorganic constituents.

2. Special Studies and Additional Monitoring Requirements- Not Applicable

3. Best Management Practices and Pollution Prevention

- a. **Salinity Evaluation and Minimization Plan (SEMP).** The Basin Plan includes a Salt Control Program for discharges to groundwater and surface water. The Salt Control Program is a phased approach to address salinity in the Central Valley Region. During Phase I the focus will be on conducting a Prioritization and Optimization (P&O) Study to provide information for subsequent phases of the Salt Control Program. During Phase I, the Salt Control Program includes two compliance pathways for dischargers to choose; a Conservative Salinity Permitting Approach and an Alternative Salinity Permitting Approach.

The Discharger submitted a Notice of Intent (NOI) for the Salt Control Program on 2 March 2021 indicating its intent to meet the Alternative Salinity Permitting Approach. Under the Alternative Permitting Approach, the Basin Plan requires dischargers implement salinity minimization measures to maintain existing salinity levels and participate in the P&O Study. The Discharger's NOI demonstrated adequate participation in the P&O and this Order requires continued participation to meeting the requirements of the Alternative Salinity Permitting Approach. This Order also requires continued implementation of the Discharger's SEMP and includes a performance-based salinity trigger to ensure salinity levels do not increase. In accordance with the Basin Plan, the salinity trigger was developed based on existing facility performance and considers possible temporary increases that may occur due to water conservation and/or drought.

4. Construction, Operation, and Maintenance Specifications

- a. The operation and maintenance specifications for the emergency storage pond, sludge stabilization ponds, and the sludge drying beds are necessary to protect the beneficial uses of the groundwater. The specifications included in this Order are retained from Order R5-2019-0068. In addition, reporting requirements related to use of the emergency storage and sludge stabilization ponds are required to monitor their use and the potential impact on groundwater.

5. Special Provisions for POTWs

a. Pretreatment Requirements- NOT APPLICABLE

b. Sludge/Biosolids Treatment or Discharge Specifications. Sludge in this Order means the solid, semisolid, and liquid residues removed during primary, secondary, or advanced wastewater treatment processes. Solid waste refers to grit and screening material generated during preliminary treatment. Residual sludge means sludge that will not be subject to further treatment at the wastewater treatment plant. Biosolids refer to sludge that has been treated and tested and shown to be capable of being beneficially and legally used pursuant to federal and state regulations as a soil amendment for agricultural, silvicultural, horticultural, and land reclamation activities as specified under 40 C.F.R. part 503. This Order does not regulate offsite use or disposal of biosolids, which are regulated instead under 40 C.F.R. part 503; administered by U.S. EPA. The Sludge/Biosolids Treatment or Discharge Specifications in this Order implement the California Water Code to ensure sludge/biosolids are properly handled onsite to prevent nuisance, protect public health, and protect groundwater quality.

c. Sludge/Biosolids Management Plan. A Sludge/Biosolids Management Plan is needed to ensure the Discharger properly handles biosolids onsite to prevent nuisance, protect public health, and protect groundwater quality.

6. Other Special Provisions- NOT APPLICABLE

7. Compliance Schedules- NOT APPLICABLE

VII. RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS

CWA section 308 and 40 C.F.R. sections 122.41(h), (j)-(l), 122.44(i), and 122.48 require that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 authorize the Central Valley Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. The Monitoring and Reporting Program (MRP), Attachment E of this Order establishes monitoring, reporting, and recordkeeping requirements that implement federal and state requirements. The burden, including costs, of these monitoring and reporting requirements bears a reasonable relationship to the need for the reports and the benefits to be obtained therefrom. The Discharger, as owner and operator of the Facility, is required to comply with these requirements, which are necessary to determine compliance with this Order. The following provides additional rationale for the monitoring and reporting requirements contained in the MRP for this facility.

Water Code section 13176, subdivision (a), states: "The analysis of any material required by [Water Code sections 13000-16104] shall be performed by a laboratory that has accreditation or certification pursuant to Article 3 (commencing with section 100825) of

Chapter 4 of Part 1 of Division 101 of the Health and Safety Code.” The DDW accredits laboratories through its Environmental Laboratory Accreditation Program (ELAP).

Section 13176 cannot be interpreted in a manner that would violate federal holding time requirements that apply to NPDES permits pursuant to the CWA. (Wat. Code sections 13370, subd. (c), 13372, 13377.). Section 13176 is inapplicable to NPDES permits to the extent it is inconsistent with CWA requirements. (Wat. Code section 13372, subd. (a).) Lab accreditation is not required for field tests such as tests for color, odor, turbidity, pH, temperature, dissolved oxygen, electrical conductivity, and disinfectant residual. The holding time requirements are 15 minutes for dissolved oxygen, and pH, and temperature (40 C.F.R. section 136.3(e), Table II). Due to the location of the Facility, it is both legally and factually impossible for the Discharger to comply with section 13176 for constituents with short holding times.

A. Influent Monitoring

1. Influent monitoring is required to collect data on the characteristics of the wastewater and to assess compliance with effluent limitations (e.g., BOD₅ and TSS reduction requirements). The monitoring frequencies and sample types have been retained from Order R5-2019-0068.

B. Effluent Monitoring

1. Pursuant to the requirements of 40 C.F.R. section 122.44(i)(2) effluent monitoring is required for all constituents with effluent limitations. Effluent monitoring is necessary to assess compliance with effluent limitations, assess the effectiveness of the treatment process, and to assess the impacts of the discharge on the receiving stream and groundwater.
2. Effluent monitoring frequencies and sample types have been retained from Order R5-2019-0068, except as noted in Table F-18, below:

C. Receiving Water Monitoring

1. Surface Water

- a. Receiving water monitoring is necessary to assess compliance with receiving water limitations and to assess the impacts of the discharge on the receiving stream. Receiving surface water monitoring frequencies and sample types have been retained from Order R5-2019-0068, except as noted in Table F-18, below:

Table F-18 Summary of Monitoring Changes

Parameter, Units	Type of Monitoring	Prior Sample Frequency	Revised Sample Frequency	Reason for Change
Ammonia Nitrogen, Total (as N)	Effluent	2/Month	1/Week	Compliance determination
Dalapon	Effluent	1/Quarter	Remove	No RP for Dalapon, sample in characterization
Diquat	Effluent	1/Quarter	Remove	No RP for Diquat. sample in characterization
Gamma-BHC	Effluent	1/Quarter	Remove	No RP for Gamma-BHC, sample in characterization
Total Dissolved Solids	Effluent and Receiving Water	1/Quarter	Remove	Electrical conductivity measured in the effluent.
Ammonia Nitrogen, Total (as N)	Receiving Water	1/Month	Remove	Sample during characterization

D. Whole Effluent Toxicity Testing Requirements

Aquatic toxicity testing is necessary to evaluate the aggregate toxic effect of a mixture of toxicants in the effluent on the receiving water. Acute toxicity testing is conducted over a short time period and measures mortality, while chronic toxicity testing is conducted over a short or longer period and may measure mortality, reproduction, and growth. For this permit, aquatic toxicity testing is to be performed following methods identified in the Code of Federal Regulations, title 40, part 136, or other U.S. EPA-approved methods, or included in the following U.S. EPA method manuals: Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms, Fourth Edition (EPA-821-R-02-013), and Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms, Fifth Edition (EPA-821-R-02-012).

Annual acute whole effluent toxicity testing is required to obtain acute WET data that is consistent with the Statewide Toxicity Provisions (e.g., TST results, percent effect) to determine if the discharge has a reasonable potential to cause or contribute to an excursion above the acute aquatic toxicity water quality objectives. Quarterly chronic whole effluent toxicity testing is required to demonstrate compliance with the chronic toxicity effluent limitations.

1. The discharge is subject to determination of “Pass” or “Fail” from an acute toxicity test and a chronic toxicity test using the Test of Significant Toxicity (TST) statistical t-test approach described in *National Pollutant Discharge Elimination System Test of Significant Toxicity Implementation Document* (EPA 833-R-10-003, 2010), Appendix A, Figure A-1 and Table A-1 (Chronic Freshwater and East Coast Methods) and Appendix B, Table B-1.

2. The null hypothesis (Ho) for the TST statistical approach is:

Mean discharge IWC response \leq RMD x Mean control response, where the chronic RMD = 0.75 and the acute RMD = 0.80.

A test result that rejects this null hypothesis is reported as "Pass." A test result that does not reject this null hypothesis is reported as "Fail."

3. The relative "Percent Effect" at the discharge IWC is defined and reported as:

Percent Effect = ((Mean control response – Mean discharge IWC response) / Mean control response) x 100.

This is a t-test (formally Student's t-Test), a statistical analysis comparing two sets of replicate observations, i.e., a control and IWC. The purpose of this statistical test is to determine if the means of the two sets of observations are different (i.e., if the IWC or receiving water concentration differs from the control, the test result is "Pass" or "Fail"). The Welch's t-test employed by the TST statistical approach is an adaptation of Student's t-test and is used with two samples having unequal variances.

4. **Sensitive Species Screening.** The Discharger shall perform rescreening to re-evaluate the most sensitive species if there is a significant change in the nature of the discharge. If there are no significant changes during the permit term, a rescreening must be performed prior to permit reissuance and results submitted with the Report of Waste Discharge. Species sensitivity screening for chronic toxicity shall include, at a minimum, chronic WET testing four consecutive calendar quarters using the water flea (*Ceriodaphnia dubia*), fathead minnow (*Pimephales promelas*), and green alga (*Pseudokirchneriella subcapitata*). The tests shall be performed at an IWC of no less than 11.1 percent effluent and one control. For rescreening, if the first two species sensitivity re-screening events result in no change in the most sensitive species, the Discharger may cease the species sensitive re-screening testing and the most sensitive species will remain unchanged.

The most sensitive species to be used for chronic toxicity testing was determined in accordance with the process outlined in the MRP section V.F. Based on the Discharger's last 5 years (July 2019-July 2023) of chronic toxicity data, there was one result of a "Fail" at the IWC using the TST statistical approach. The species that exhibited the highest percent effect was the water flea (*Ceriodaphnia dubia*), with a percent effect of 39.61 percent. Consequently, *Ceriodaphnia dubia* has been established as the most sensitive species for chronic WET testing.

5. **Toxicity Reduction Evaluation (TRE).** The Monitoring and Reporting Program of this Order requires chronic WET testing to demonstrate compliance with the numeric chronic toxicity effluent limitation. The Discharger is required to initiate a TRE when there is any combination of two or more toxicity MDEL or MMEL

violations within a single toxicity calendar month or within two successive toxicity calendar months. In addition, if other information indicates toxicity (e.g., results of additional monitoring, results of monitoring at a higher concentration than the IWC, fish kills, intermittent recurring toxicity), the Central Valley Water Board may require a TRE. A TRE may also be required when there is no effluent available to complete a routine monitoring test, MMET test, or MMEL compliance test.

E. Other Monitoring Requirements

1. Pyrethroid Pesticides Monitoring

On 8 June 2017, the Central Valley Water Board adopted Resolution R5-2017-0057, which adopted the Basin Plan Amendment (BPA) for the Control of Pyrethroid Pesticide Discharges. Pyrethroid pesticides and toxicity monitoring has been included in this Order in accordance with the Pyrethroids Pesticides BPA, as required for POTWs with design average dry weather flow greater than or equal to 1 million gallons per day.

2. Effluent and Receiving Water Characterization Monitoring

In accordance with section 1.3 of the SIP, periodic monitoring is required for priority pollutants for which criteria or objectives apply and for which no effluent limitations have been established. This Order requires quarterly effluent and receiving water characterization monitoring events quarterly from 1 January 2027 through 31 December 2027 for priority pollutant constituents located in Appendix A to 40 C.F.R. part 423 during the term of the permit, in order to collect data to conduct an RPA for the next permit renewal.

3. Pond Monitoring

Storage stabilization ponds and emergency storage pond monitoring is required to ensure proper operation and maintenance of ponds at the Facility. Weekly freeboard, presence/absence of liquid, odors, or nuisance conditions, and monthly monitoring and evaluation of berm condition, and reporting on discharges of any partially or untreated waste to the emergency storage pond are included in this Order. The Discharger is also required to conduct pH monitoring when the emergency storage basin is in use longer than 72 hours. Additionally, annual reporting on the inspection of the asphalt/concrete liner systems for the Facility's pond units is included in this Order to ensure that the structural integrity of the liner system is not compromised and leakage from the units is minimized prevent infiltration of waste constituents into soils in a mass or concentration that will violate groundwater limitations in section V.B. of this Order.

4. Discharge Monitoring Report-Quality Assurance (DMR-QA) Study Program

Under the authority of section 308 of the CWA (33 U.S.C. section 1318), U.S. EPA requires all dischargers under the NPDES Program to participate in the annual DMR-QA Study Program. The DMR-QA Study evaluates the analytical ability of laboratories that routinely perform or support self-monitoring analyses required by NPDES permits. There are two options to satisfy the requirements of the DMR-QA Study Program: (1) The Discharger can obtain and analyze a DMR-QA sample as part of the DMR-QA Study; or (2) Per the waiver issued by U.S.EPA to the State Water Board, the Discharger can submit the results of the most recent Water Pollution Performance Evaluation Study from their own laboratories or their contract laboratories. A Water Pollution Performance Evaluation Study is similar to the DMR-QA Study. Thus, it also evaluates a laboratory's ability to analyze wastewater samples to produce quality data that ensure the integrity of the NPDES Program. The Discharger shall submit annually the results of the DMR-QA Study or the results of the most recent Water Pollution Performance Evaluation Study to the State Water Board. The State Water Board's Quality Assurance Program Officer will send the DMR-QA Study results or the results of the most recent Water Pollution Performance Evaluation Study to U.S. EPA's DMR-QA Coordinator and Quality Assurance Manager.

VIII. PUBLIC PARTICIPATION

The Central Valley Water Board has considered the issuance of WDRs that will serve as an NPDES permit for Anderson Water Pollution Control Plant. As a step in the WDR adoption process, the Central Valley Water Board staff has developed tentative WDRs and has encouraged public participation in the WDR adoption process.

A. Notification of Interested Persons

The Central Valley Water Board notified the Discharger and interested agencies and persons of its intent to prescribe WDRs for the discharge and provided an opportunity to submit written comments and recommendations. Notification was provided through internet posting to the Central Valley Water Board's Website, direct email to identified interested parties, and posting at the Facility, the post office, and county courthouse.

The public had access to the [agenda and any changes in dates and locations](http://www.waterboards.ca.gov/centralvalley/board_info/meetings/) through the Central Valley Water Board's website (http://www.waterboards.ca.gov/centralvalley/board_info/meetings/)

B. Written Comments

Interested persons were invited to submit written comments concerning tentative WDRs as provided through the notification process. Comments were due either in

person or by mail to the Executive Office at the Central Valley Water Board at the address on the cover page of this Order.

To be fully responded to by staff and considered by the Central Valley Water Board, the written comments were due at the Central Valley Water Board office by 5:00 p.m. on **18 December 2024**.

C. Public Hearing

The Central Valley Water Board held a public hearing on the tentative WDRs during its regular Board meeting on the following date and time and at the following location:

Date: **21 February 2025**

Time: **8:30 a.m.**

Location: Online and Regional Water Quality Control Board, Central Valley Region
11020 Sun Center Dr., Suite #200
Rancho Cordova, CA 95670

Interested persons were invited to attend. At the public hearing, the Central Valley Water Board heard testimony pertinent to the discharge, WDRs, and permit. For accuracy of the record, important testimony was requested in writing.

D. Reconsideration of Waste Discharge Requirements

Any person aggrieved by this action of the Central Valley Water Board may petition the State Water board to review the action in accordance with Water Code section 13320 and CCR, title 23, sections 2050 and following. The State Water Board must receive the petition by 5:00 p.m., within 30 calendar days of the date of adoption of this Order at the following address, except that if the thirtieth day following the date of this Order falls on a Saturday, Sunday, or state holiday, the petition must be received by the State Water Board by 5:00 p.m. on the next business day:

State Water Resources Control Board
Office of Chief Counsel
P.O. Box 100, 1001 I Street
Sacramento, CA 95812-0100

Or by email at waterqualitypetitions@waterboards.ca.gov

[Instructions on how to file a petition for review](http://www.waterboards.ca.gov/public_notices/petitions/water_quality/wqpetition_instructions.shtml)

(http://www.waterboards.ca.gov/public_notices/petitions/water_quality/wqpetition_instructions.shtml) are available on the Internet.

E. Information and Copying

The Report of Waste Discharge, other supporting documents, and comments received are on file and may be inspected at the address above at any time between

8:30 a.m. and 4:45 p.m., Monday through Friday. Copying of documents may be arranged through the Central Valley Water Board by calling (530) 224-4845.

F. Register of Interested Persons

Any person interested in being placed on the mailing list for information regarding the WDRs and NPDES permit should contact the Central Valley Water Board, reference this facility, and provide a name, address, and phone number.

G. Additional Information

Requests for additional information or questions regarding this order should be directed to Marisol Gonzalez at (530) 224-4204, or Marisol.Gonzalez@waterboards.ca.gov.

ATTACHMENT G – SUMMARY OF REASONABLE POTENTIAL ANALYSIS

Constituent	Units	MEC	B	C	CMC	CCC	Water & Org	Org. Only	Basin Plan	MCL	Reasonable Potential
4,4-DDE	µg/L	0.027	<0.00018	0.00059	--	--	0.00059	0.00059	ND	--	Yes
Aluminum (total)	µg/L	12.5	39.3	200	1100	479	N/A	N/A	N/A	200	No
Ammonia (as N)	mg/L	3.98	0.14	3.07	21.5	3.07	N/A	N/A	NA	NA	Yes
Bromoform	µg/L	<0.15	<0.15	4.3	N/A	N/A	4.3	360	N/A	80	No
Chloroform	µg/L	43.5	<0.12	80	NA	NA	60	2000	N/A	80	No
Copper, Total	µg/L	10.1	9.32	4.6	5.4*	4.6*	1300	N/A	5.4*	1000	Yes
CDBM	µg/L	0.93	<0.11	0.41	N/A	N/A	0.41	34	N/A	80	Yes
Chlorpyrifos	µg/L	<0.018	<0.042	0.015	0.02	0.014	N/A	N/A	0.015	N/A	Yes, TMDL
Chloride	mg/L	48.1	2.99	250	860	230	N/A	N/A	N/A	250	No
Cyanide, Total	µg/L	14	<1.1	5.2	22	5.2	700	220000	--	150	Yes
Dalapon	µg/	1.8	<0.478	200	--	--	N/A	N/A	N/A	200	No
Diazinon	µg/L	<0.021	<0.036	0.1	0.1	0.05	N/A	N/A	0.1	N/A	Yes, TMDL
DCBM	µg/L	10.1	<0.11	0.56	N/A	N/A	0.56	46	--	80	Yes
Diquat	µg/L	<1.6	<1.6	20	N/A	N/A	N/A	N/A	N/A	20	No
Electrical Conductivity	µmhos/cm	417 (2022)	137 (2021)	900	N/A	N/A	N/A	N/A	150	900	No
gamma-BHC	µg/L	<0.002	<0.002	0.019	0.95	0.08	0.019	0.063		0.2	No
Iron, Total	µg/L	50.4	59.8	300	N/A	1000	N/A	N/A	N/A	300	No
Manganese, Tot.	µg/L	9.33	6.71	50	N/A	N/A	N/A	100	N/A	50	No
Mercury, Total	ng/L	<30	<30	12	1440	770	50	51	12	N/A	No
Nitrate plus Nitrite, Total (as N)	mg/L	15	0.07	10	N/A	N/A	10	N/A	N/A	10	Yes
Sulfate	mg/L	38.7	3.96	250	N/A	N/A	N/A	N/A	N/A	250	No

Constituent	Units	MEC	B	C	CMC	CCC	Water & Org	Org. Only	Basin Plan	MCL	Reasonable Potential
Total Dissolved Solids	mg/L	296 (2022)	91 (2021)	500	N/A	N/A	N/A	N/A	N/A	500	No
Total Trihalomethanes	µg/L	50	<0.15	80	N/A	N/A	N/A	N/A	N/A	80	No
Zinc, Total	µg/L	67.1	63.6	18	73*	73*	N/A	N/A	18*	5000	Yes

Attachment G Table Notes:

1. Date range for RPA: 1/1/2021 through 2/29/2024, unless otherwise noted. All inorganic concentrations are given as a total concentration.
2. All inorganic concentrations are given as a total concentration.
3. An ambient hardness value of 30.5 mg/L of CaCO₃ was used to calculate the hardness-dependent metals criteria for copper. An ambient hardness value of 30.5 mg/L of CaCO₃ was used to calculate the hardness-dependent metals criteria for zinc.
4. Site-specific chronic translator for copper applied: 0.69.
5. Site-specific acute translator for copper applied: 0.81.
6. Site-specific acute translator for zinc applied: 0.72.
7. Site-specific chronic translator for zinc applied: 0.59.
8. EC and TDS MEC value is a maximum annual average.
9. The CCC and CMC for aluminum was calculated using the site-specific 2018 USEPA National Ambient Water Quality Criteria.
10. Ammonia CMC (21.5 mg/L) calculated from paired effluent temperature and pH (lower of observed or permitted pH). On 8/4/2022, effluent pH was 7.0 and temperature was reported at 25.44 degrees Celsius.
11. Ammonia CCC (3.07 mg/L) calculated using 30-day paired downstream receiving water pH (7.7) and temperature (13.49 degrees Celsius) (5/20/2021).
12. Dissolved copper in the receiving water was 2.09 ug/L on same day as the reported total recoverable copper concentration of 9.32 ug/L.

13. Dissolved zinc in the receiving water was 1.7 ug/L DNQ on same day as the reported total recoverable zinc concentration of 63.6 ug/L.
14. A design ambient hardness value of 30.5 mg/L of CaCO₃ was used to calculate the hardness-dependent metals criteria for MEC > C.
15. A hardness value of 30.5 mg/L of CaCO₃ (minimum receiving water hardness) was used to calculate the hardness-dependent metals criteria for B > C.
16. The CCC and CMC for total mercury are based on the USEPA National Recommended Water Quality Criteria.
17. Mercury criteria (C) (12 ng/L) is the State Water Board Sport Fish Water Quality Objective for mercury.

Abbreviations used in this table:

MEC =	Maximum Effluent Concentration
B =	Maximum Receiving Water Concentration or lowest detection level, if non-detect
C =	Criterion used for Reasonable Potential Analysis
CMC =	Criterion Maximum Concentration (CTR or NTR)
CCC =	Criterion Continuous Concentration (CTR or NTR)
Water & Org =	Human Health Criterion for Consumption of Water & Organisms (CTR or NTR)
Org Only =	Human Health Criterion for Consumption of Organisms Only (CTR or NTR)
Basin Plan =	Numeric Site-Specific Basin Plan Water Quality Objective
MCL =	Drinking Water Standards Maximum Contaminant Level
NA =	Not Available
ND =	Non-detect

ATTACHMENT H-1 – CALCULATION OF WQBELS

HUMAN HEALTH WQBELS CALCULATIONS

Parameter	Units	Criteria	Mean Background Concentration	Effluent CV	Dilution Factor	MDEL/AMEL Multiplier	AMEL Multiplier	AMEL	MDEL	AWEL
4,4-DDE	µg/L	0.00059	<0.00018	0.6	0	2	1.5	0.00059	0.0012	--
Chlorodibromomethane	µg/L	0.41	<0.11	0.7	20	2.2	1.7	8	17	--
Dichlorobromomethane	µg/L	0.56	<0.11	0.5	43	1.9	1.49	22	42	--
Nitrate Nitrogen, Total (as N)	mg/L	10	0.05	0.5	3	1.9	1.46	40	--	65

Attachment H-1 Table Notes:

- CV was established according to section 1.4 of the SIP.

Abbreviations used in this table:

CV = Coefficient of Variation
 MDEL = Maximum Daily Effluent Limitation
 AMEL = Average Monthly Effluent Limitation
 MDEL = Maximum Daily Effluent Limitation
 AWEL = Average Weekly Effluent Limitation

ATTACHMENT H-2 – CALCULATION OF WQBELS

AQUATIC LIFE WQBELS CALCULATIONS

Parameter	Units	CMC Criteria	CCC Criteria	B	Effluent CV	CMC Dilution Factor	CCC Dilution Factor	ECA Multiplier ^{acute}	LTA ^{acute}	ECA Multiplier ^{chronic}	LTA ^{chronic}	AMEL Multiplier ⁹⁵	AWEL Multiplier	MDEL Multiplier ⁹⁹	AMEL	AWEL	MDEL
Ammonia Nitrogen, Total (as N)	mg/L	6.8	3	0.14	1.9	1.5	1.3	0.1	2	0.5	3.2	5.5	6	17	5.4	12	--
Copper, Total Recoverable	µg/L	5.4	4.6	2.09	0.2	9	12	0.6	18	0.8	18	1.2	--	1.7	22	--	31
Cyanide	µg/L	10	5.2	<1.1	0.6	2.6	9.6	0.3	25	0.5	25	1.5	2.6	3.0	40	--	77
Zinc, Total Recoverable	µg/L	18	73	7.4	0.2	10.7	1	0.6	58	0.8	102	1.2	--	1.7	70	--	98

Attachment H-2 Table Notes:

1. AMEL calculated according to section 1.4 of the SIP using a 95th percentile occurrence probability.
2. AWEL calculated according to section 1.4 of the SIP using a 98th percentile occurrence probability.
3. MDEL calculated according to section 1.4 of the SIP using a 99th percentile occurrence probability.
4. An ambient hardness value of 30.5 mg/L of CaCO₃ was used to calculate the hardness-dependent metals criteria for copper. An ambient hardness value of 30.5 mg/L of CaCO₃ was used to calculate the hardness-dependent metals criteria for zinc.
5. Ammonia CMC and CCC calculations utilized upstream receiving water pH and temperature due to use of a mixing zone in the development of ammonia effluent limitations. Ammonia CMC calculated from paired upstream receiving water temperature and pH (lower of observed or permitted pH). On 1/21/2021, upstream receiving water pH was 7.5 and temperature was reported at 9.39 degrees Celsius. Ammonia CCC calculated using 30-day paired upstream receiving water pH (7.7) and temperature (13.49 degrees Celsius) (5/20/2021).

6. Background (B) copper and zinc values are dissolved concentrations.

Abbreviations used in this table:

B =	Maximum Receiving Water Concentration or lowest detection level, if non-detect
CMC =	Criterion Maximum Concentration (CTR or NTR)
CCC =	Criterion Continuous Concentration (CTR or NTR)
CV =	Coefficient of Variation (established in accordance with section 1.4 of the SIP)
ECA	Effluent Concentration Allowance
LTA	Aquatic Life Calculations – Long-Term Average
MDEL =	Maximum Daily Effluent Limitation
AMEL =	Average Monthly Effluent Limitation
MDEL =	Maximum Daily Effluent Limitation
AWEL =	Average Weekly Effluent Limitation