



Central Valley Regional Water Quality Control Board

XX XXXX 2026

Oscar de la Cruz
Public Works Maintenance Manager
City of Galt
495 Industrial Drive
Galt, CA 95632

VIA EMAIL:
ODelacruz@cityofgalt.org
CERTIFIED MAIL
XXXX XXXX XXXX XXXX

TENTATIVE NOTICE OF APPLICABILITY (NOA); MUNICIPAL WASTEWATER DISCHARGERS THAT MEET OBJECTIVES/CRITERIA AT THE POINT OF DISCHARGE TO SURFACE WATER ORDER R5-2023-0025 (MUNICIPAL GENERAL ORDER), NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) CAG585001; CITY OF GALT, WASTEWATER TREATMENT PLANT AND RECLAMATION FACILITY, SACRAMENTO COUNTY

Our office received a Notice of Intent (NOI) dated 28 April 2025 from the City of Galt (Discharger), for discharge of tertiary treated domestic wastewater to surface water from the City of Galt, Wastewater Treatment Plant and Reclamation Facility (Facility) to the remnants of Skunk Creek, which flows into Laguna Creek approximately 3,000 feet downstream of the Facility's discharge. The *General Order for Municipal Wastewater Dischargers That Meet Objectives/Criteria at the Point of Discharge to Surface Water Order R5-2023-0025* (Municipal General Order) requires the submittal of an NOI to apply for regulatory coverage of a surface water discharge. Based on the NOI and subsequent information submitted by the Discharger, staff has determined that the NOI requirements have been fulfilled and the Facility is eligible for coverage under the Municipal General Order. This Facility's discharge is assigned Municipal General Order enrollee number R5-2023-0025-XXX and National Pollutant Discharge Elimination System (NPDES) Permit CAG585001. Please reference your Municipal General Order enrollee number, **R5-2023-0025-XXX**, in your correspondence and submitted documents.

Discharges to surface water from the Facility have been regulated by the Municipal General Order R5-2017-0085-01 through an NOA issued by the Executive Officer on 10 May 2021, Municipal General Order enrollee number R5-2017-0085-016 (NOA R5-2017-0085-016). This NOA, authorizing coverage under the 2023 Municipal General Order (R5-2023-0025), shall become effective on **1 July 2026**, and will supersede NOA R5-2017-0085-016, at which time the terms and conditions in NOA R5-2017-0085-016 will cease to be effective except for enforcement purposes. To meet the provisions contained in division 7 of the Water Code (commencing with section 13000) and regulations adopted thereunder, and the provisions of the Clean Water Act and regulations and guidelines adopted thereunder, the Discharger shall comply with the

NICHOLAS AVDIS, CHAIR | PATRICK PULUPA, EXECUTIVE OFFICER

requirements contained in the Municipal General Order and as specified in this NOA. This action in no way prevents the Central Valley Water Board from taking enforcement action for past violations of NOA R5-2017-0085-016.

The enclosed Municipal General Order is available online (https://www.waterboards.ca.gov/centralvalley/board_decisions/general_orders/r5-2023-0025_npdes.pdf) and can be requested by email or phone from the NPDES Permitting Contacts webpage (https://www.waterboards.ca.gov/centralvalley/water_issues/waste_to_surface_water/contacts/). You are urged to familiarize yourself with the entire contents of the enclosed document.

The Monitoring and Reporting Program, Attachment E to the Municipal General Order, contains the general monitoring and reporting requirements. The Discharger specific monitoring and reporting requirements are included within this NOA (R5-2023-0025-XXX) as Appendix D. **Only the monitoring and reporting requirements specifically listed in Appendix D of this NOA are applicable to this Facility.**

The discharge of treated domestic wastewater shall be in accordance with the requirements contained in the Municipal General Order, as specified in this NOA.

Table 1. Facility Information

WDID	5B340101001
CIWQS Facility Place ID	226690
Discharger	City of Galt
Name of Facility	City of Galt Wastewater Treatment Plant and Reclamation Facility
Facility Street Address	10059 Twin Cities Road
Facility City, State, Zip Code	Galt, CA 95632
Facility County	Sacramento County
Facility Contact, Title and Phone	Oscar de la Cruz, Public Works Maintenance Manager (209) 366-7260
Authorized Person to Sign and Submit Reports	Oscar de la Cruz, Public Works Maintenance Manager
Mailing Address	495 Industrial Drive, Galt, CA 95632
Billing Address	495 Industrial Drive, Galt, CA 95632
Type of Facility	Publicly Owned Treatment Works (POTW)
Major or Minor Facility	Major
Threat to Water Quality	1
Complexity	A
Pretreatment Program	No
Recycling Requirements	Yes
Facility Design Average Dry Weather Flow (ADWF)	Currently 3.0 Million Gallons Per Day (MGD), planned 4.5 MGD
Permitted ADWF	3.0 MGD, with expansion to 4.5 MGD upon Executive Officer approval
Watershed	Lower Cosumnes River – Lower Mokelumne River

Receiving Water	Laguna Creek
Receiving Water Type	Inland Surface Water
Discharge Point 001	Latitude 38° 18' 15" N, Longitude 121° 19' 56" W

I. FACILITY INFORMATION

The Discharger provides sewerage service for the City of Galt and surrounding areas and serves a population of approximately 27,000. The design average dry weather flow capacity of the Facility is 3.0 million gallons per day (MGD).

The treatment system at the Facility consists of the following:

- magnesium hydroxide addition (at an upstream lift station);
- coarse bar screening;
- grit removal;
- three oxidation ditches;
- three secondary clarifiers;
- three cloth media filters;
- three ultraviolet light disinfection channels and;
- partially treated/undisinfected secondary effluent can be discharged to onsite storage ponds and then land applied on the agricultural fields owned by the Discharger (regulated by separate Waste Discharge Requirements (WDR) Order R5-2015-0125).

Solids collection and disposal consist of the following:

- solids collected from wastewater treatment process are aerobically digested within the oxidation ditches;
- digested solids are directed to two membrane-lined storage lagoons for stabilization and thickening;
- stabilized and thickened solids are pumped to either a mechanical screw press or gravity-assisted dewatering beds;
- mechanically dewatered biosolids are further dewatered at the Facility in piles or windrows on a covered drying pad before being land-applied on the agricultural fields owned by the Discharger (regulated by separate Waste Discharge Requirements (WDR) Order R5-2015-0125); and
- dewatering filtrate from both dewatering processes is directed to either the headworks or an Auxiliary Basin for equalization prior to being directed to the headworks.

II. RECEIVING WATER BENEFICIAL USES

The Facility discharges from Discharge Point 001 to Laguna Creek, a tributary to the Cosumnes River within the Lower Cosumnes River – Lower Mokelumne River watershed. According to the Water Quality Control Plan for the Sacramento River and San Joaquin River Basins (Basin Plan) and the Tributary Rule, the following beneficial uses apply to Laguna Creek:

- Municipal and Domestic Supply (MUN)
- Agricultural Supply (AGR)
- Water Contact Recreation (REC-1)

- Non-contact Water Recreation (REC-2)
- Warm Freshwater Habitat (WARM)
- Cold Freshwater Habitat (COLD)
- Wildlife Habitat (WILD)

III. PROVISIONS AND REQUIREMENTS IMPLEMENTING STATE LAW

Provisions and requirements to implement State law only are included in the following sections of this NOA:

- Groundwater Limitations – section VII.2
- Filtration System Operating Specifications, UV Disinfection System Operating Specifications, and Pond Operating Specifications – section IX.1.C, Table 4 Special Provision 4

IV. RECEIVING WATER TOTAL MAXIMUM DAILY LOADS (TMDLS)

Table 2, below, identifies the 303(d) listings and any applicable TMDLs.

Laguna Creek is listed for Dissolved Oxygen, Indicator Bacteria, and Toxicity constituent(s) on the Clean Water Act 303(d) List of impaired water bodies. A TMDL for these constituents has not yet been established for Laguna Creek. Therefore, no additional 303(d) based effluent limitations or monitoring requirements are included in this NOA.

Laguna Creek is not listed as impaired on the 303(d) list for diazinon and chlorpyrifos. However, the Sacramento and Feather Rivers Diazinon and Chlorpyrifos Basin Plan Amendment is applicable to this discharge so effluent limitations are included in this NOA.

Table 2. 303 (d) List for Laguna Creek (tributary to Cosumnes River)

Pollutant	Potential Sources	TMDL Status
Dissolved Oxygen	Source Unknown	2027
Indicator Bacteria	Source Unknown	2027
Toxicity	Source Unknown	2029

The 303(d) listings and TMDLs have been considered in the development of this NOA.

V. DISCHARGE PROHIBITIONS

Discharge prohibitions are contained in section IV of the Municipal General Order. Only the discharge prohibitions listed below are applicable to this Facility.

- A.** The discharge of wastes, other than those described in section I.A and meeting the eligibility criteria in section I.B of the Municipal General Order, is prohibited unless the Discharger obtains coverage under another general or individual Order that regulates the discharge of such wastes. The discharge of wastes at a location or in a manner different from that described in the NOI and this NOA is prohibited.
- B.** The bypass or overflow of wastes to surface waters is prohibited, except as allowed by Federal Standard Provisions sections I.G. and I.H in Attachment D,

Standard Provisions, of the Municipal General Order.

- C. Neither the discharge nor its treatment shall create a nuisance as defined in section 13050 of the Water Code.
- D. Discharge of waste classified as ‘hazardous’, as defined in the CCR, Title 22, section 66261.1 et seq., is prohibited.
- E. **Average Dry Weather Flow.** Discharges exceeding the following average dry weather flows are prohibited. (see Municipal General Order section IV.E)
 - i. 3.0 million gallons per day (MGD), effective immediately until Executive Officer’s written approval of flow increase (Provision VIII.D).
 - ii 4.5 MGD, effective upon Executive Officer’s written approval of flow increase (Provision VIII.D).

VI. EFFLUENT LIMITATIONS

The Discharger shall maintain compliance with the following effluent limitations at Discharge Point 001. Effluent limitations are provided in the Municipal General Order. Only the effluent limitations listed below in Table 3 and items 1-5 are applicable to this Facility. Unless otherwise specified in this NOA, compliance shall be measured at Monitoring Location EFF-001, as described in the Monitoring and Reporting Program (MRP), Appendix D of this NOA.

The Discharger shall maintain compliance with the effluent limitations specified in Table 3 and items 1-6 below.

Table 3. Effluent Limitations

Parameter	Units	Average Monthly	Average Weekly
Biochemical Oxygen Demand (5-day @ 20°Celsius) (BOD ₅)	milligrams per liter (mg/L)	10	15
Total Suspended Solids (TSS)	mg/L	10	15
Ammonia Nitrogen, Total (as N)	mg/L	2.4	3.6
Nitrate plus Nitrite, Total (as N)	mg/L	10	15

- 1. **pH.** The pH shall at all times be within the range of 6.5 and 8.5.
- 2. **Percent Removal.** The average monthly percent removal of BOD₅ and TSS shall not be less than 85 percent.
- 3. **Total Coliform Organisms.** Effluent total coliform organisms shall not exceed:
 - i. 2.2 most probable number per 100 milliliters (MPN/100 mL), as a 7-day median;
 - ii. 23 MPN/100 mL, more than once in any 30-day period; and
 - iii. 240 MPN/100 mL, at any time.
- 4. **Diazinon and Chlorpyrifos.** Effluent diazinon and chlorpyrifos concentrations shall not exceed the sum of one (1.0) as identified below:

- i. Average Monthly Effluent Limitation (AMEL)
 $SAMEL = CD\ M\text{-avg}/0.079 + CC\ M\text{-avg}/0.012 \leq 1.0$
CD M-avg = average monthly diazinon effluent concentration in µg/L.
CC M-avg = average monthly chlorpyrifos effluent concentration in µg/L
- ii. Average Weekly Effluent Limitation (AWEL)
 $SAWEL = CD\ W\text{-avg}/0.14 + CC\ W\text{-avg}/0.021 \leq 1.0$
CD W-avg = average weekly diazinon effluent concentration in µg/L.
CC W-avg = average weekly chlorpyrifos effluent concentration in µg/L.

VII. RECEIVING WATER LIMITATIONS

1. Surface Water Limitations (Municipal General Order section VI.A).

The Municipal General Order includes receiving surface water limitations in Section VI.A. Based on the information provided in the NOI, only the following receiving surface water limitations listed in Municipal General Order Section VI.A are applicable to the Facility.

- Biostimulatory Substances (VI.A.3);
- Chemical Constituents (VI.A.4);
- Color (VI.A.5);
- Dissolved Oxygen (VI.A.6.a.i, ii and iv)
- Floating Material (VI.A.7);
- Oil and Grease (VI.A.8);
- pH (VI.A.9.a);
- Pesticides (VI.A.10. a and b);
- Radioactivity (VI.A.11);
- Suspended Sediments (VI.A.12);
- Settleable Substances (VI.A.13);
- Suspended Material (VI.A.14);
- Taste and Odors (VI.A.15);
- Temperature (VI.A.16.a);
- Toxicity (VI.A.17. a and c); and
- Turbidity (VI.A.18.a).

2. Groundwater Limitations (Municipal General Order section VI.B) – Not applicable

Storage of partially treated/undisinfected secondary effluent and biosolids, and the application of undisinfected secondary recycled water and biosolids to the Discharger's land application area are regulated by separate WDR Order R5-2015-0125.

VIII. MONITORING AND REPORTING

MRP requirements are contained in Appendix D of this NOA.

IX. PROVISIONS

Provisions are contained in section VII of the Municipal General Order and the

applicable provisions are referenced below:

A. Standard Provisions

Applicable to all Dischargers.

B. Monitoring and Reporting Program (MRP) Requirements

The MRP applicable to this Facility is contained in Appendix D of this NOA.

C. Special Provisions

Special Provisions are contained in section VII.C of the Municipal General Order. Only the following Special Provision sections from the Municipal General Order specified in Table 3 apply to this Facility:

Table 4: Summary of Applicable Special Provisions

Special Provision	Section Reference
1. Reopener Provisions	a. Major Modification of the General Order c. Water Effect Ratios (WERs) and Metal Translators
2. Special Studies, Technical Reports and Additional Monitoring Requirements	None
3. Best Management Practices and Pollution Prevention	b. Salinity Evaluation and Minimization Plan (SEMP) (see table note 1) c. Pyrethroid Management Plan
4. Construction, Operation and Maintenance Specifications	a.i.(a)-(c) Filtration System Operating Specifications b.i.(a). UV Disinfection System – Dose b.ii.(a) UV Disinfection System – Transmittance b.iii-vi. UV Disinfection System – General
5. Special Provisions for Municipal Facilities	None
6. Other Special Provisions	a. Title 22, or Equivalent, Disinfection Requirements

Table 4 Notes

1. Salinity Evaluation and Minimization Plan. The Discharger submitted a Salinity Evaluation and Minimization Plan in June 2011. This NOA requires that the existing Salinity Evaluation and Minimization Plan be maintained in order to ensure that adequate measures are developed and implemented by the Discharger to reduce the discharge of salinity to Laguna Creek. The Discharger shall evaluate the effectiveness of the Salinity Evaluation and Minimization Plan and provide a summary with the NOI (see Table D-10. Technical Reports, located in Appendix D, section X.D.6 for due date).

D. Facility Expansion

The Discharger has future plans to complete upgrades to the Facility that increase Facility capacity. To request an increase in permitted discharge flow, the Discharger shall submit the following to the Central Valley Water Board:

- A report certified by a registered and licensed Civil Engineer that the Facility has appropriate treatment capacity for the new design average dry weather flow rate, up to 4.5 MGD.
- A certification that the expanded facility can comply with the effluent limits and accommodate and de-water the increased sludge volume.

The permitted flow increase (see Discharge Prohibitions section V.E.ii of this NOA) shall not be effective until the Executive Officer verifies compliance and provides written approval of the flow increase.

X. COMPLIANCE DETERMINATION

The following compliance determinations, as contained and more fully described in the Municipal General Order, are applicable to this discharge (Municipal General Order section given in brackets, if applicable):

- BOD₅ and TSS Effluent Limitations (VIII.A);
- Average Dry Weather Flow Effluent Prohibition (VIII.E);
- Total Coliform Organisms Effluent Limitations (VIII.F);
- Dissolved Oxygen Receiving Water Limitation (VIII.J);
- Chronic Whole Effluent Toxicity Effluent Trigger (VIII.K);
- Chlorpyrifos and Diazinon Effluent Limitations (VIII.L);
- Period Average, Calendar Month Average, and Annual Average (VIII.O);
- Turbidity Receiving Water Limitation (VIII.P); and
- Reporting Requirements (**refer to Appendix D, section X of this NOA**).

XI. ANTI-BACKSLIDING REQUIREMENTS

Anti-backsliding requirements are specified in the Municipal General Order, section V.D.3, Attachment F (Fact Sheet). Sections 402(o) and 303(d)(4) of the Clean Water Act (CWA) and federal regulations at 40 Code of Federal Regulations (C.F.R.) section 122.44(l) restrict backsliding in NPDES permits. These anti-backsliding provisions require that effluent limitations in a reissued permit must be as stringent as those in the previous permit, with some exceptions in which limitations may be relaxed.

XII. ANTIDegradation REQUIREMENTS

Antidegradation requirements are specified in the Municipal General Order, section V.D.4, Attachment F (Fact Sheet). This NOA does not allow an increase in flow or mass of pollutants to the receiving water, and the relaxation of ammonia average monthly effluent limit (AMEL) and removal of the effluent limitations for acute toxicity and electrical conductivity are consistent with the antidegradation provisions of 40 C.F.R. 131.12 and State Water Board Resolution 68-16.

A more detailed discussion of antidegradation is provided in Appendix C of this NOA

in section II.B, Antidegradation Policies.

XIII. RATIONALE FOR LIMITATIONS AND MONITORING REQUIREMENTS

Additional rationale for limitations and monitoring requirements is included in Attachment F, section V (Rationale for Effluent Limitations and Discharge Specifications), of the Municipal General Order and Appendix C of this NOA.

XIV. ENFORCEMENT

Failure to comply with the applicable requirements of the Municipal General Order, as specified in this NOA R5-2023-0025-XXX, may result in enforcement actions, which could include civil liability (penalties). Effluent limitation violations may be subject to a Mandatory Minimum Penalty (MMP) of \$3,000 per violation. In addition, late monitoring reports may be subject to MMPs and/or discretionary penalties of up to \$1,000 per day late. If discharges do not occur during any report monitoring period, the Discharger must still submit the monitoring report indicating that no discharge occurred to avoid being subject to enforcement actions.

XV. COMMUNICATION

Until this NOA becomes effective on 1 July 2026, you will need to comply with the effluent limitations and requirements contained in your existing permit, Order R5-2017-0085. For your May and June 2026 monthly self-monitoring reports, you will need to demonstrate compliance with existing Order R5-2017-0085-01 through 30 June 2026. For your July 2026 self-monitoring report, you will need to demonstrate compliance with this NOA beginning 1 July 2026.

The Central Valley Water Board is implementing a Paperless Office system to reduce our paper use, increase efficiency, and provide a more effective way for our staff, the public, and interested parties to view documents in electronic form. Therefore, the Discharger is required to submit all self-monitoring, technical, and progress reports required by this NOA via California Integrated Water Quality System (CIWQS) submittal. In general, if any monitoring data for a monitoring location can be submitted using a computable document format (CDF) file upload, then it should be submitted as a CDF file upload, such as characterization monitoring data. However, certain parameters that cannot be uploaded to the CIWQS data tables, such as Annual Operations Reports, should be uploaded as a Portable Document Format (PDF), Microsoft Word, or Microsoft Excel file attachment. Also, please upload or enter a cover letter summarizing the content of the report to the submittal tab of the CIWQS module for each submittal.

All other documents not required to be submitted via CIWQS shall be converted to a searchable PDF and submitted by email to centralvalleysacramento@waterboards.ca.gov. Please include the following information in the body of the email:

- Attention: NPDES Compliance and Enforcement Section
- Discharger: City of Galt
- Facility: City of Galt Wastewater Treatment Plant and Reclamation Facility
- County: Sacramento County
- CIWQS Place ID: 226690

Documents that are 50 megabytes or larger must be transferred to a DVD or flash drive, and mailed to our office, attention "ECM Mailroom-NPDES".

Any person aggrieved by this action of the Central Valley Water Board may petition the State Water Board to review the action in accordance with California Water Code section 13320 and California Code of Regulations, Title 23, sections 2050 and following. The State Water Board must receive the petition by 5:00 p.m., 30 days after the date this NOA R5-2023-0025-XXX is issued, except that if the thirtieth day following the date this NOA R5-2023-0025-XXX is issued falls on a Saturday, Sunday, or state holiday, the petition must be received by the State Water Board by 5:00 p.m. on the next business day. [Links to the laws and regulations applicable to filing petitions](#) (http://www.waterboards.ca.gov/public_notices/petitions/water_quality) may be found on the Internet or will be provided upon request.

Now that your NOA has been issued, the Central Valley Water Board's Compliance and Enforcement Section will take over management of your case. Mr. Jon Rohrbough of the Compliance and Enforcement section is your point of contact for any questions regarding this NOA. If you find it necessary to make a change to your permitted operations, you will be directed to the appropriate Permitting staff. You may contact Mr. Rohrbough by phone at (916) 464-4822 or email at jon.rohrbough@waterboards.ca.gov.

Patrick Pulupa
Executive Officer

Appendices:

Appendix A – Location Map
Appendix B – Flow Schematic
Appendix C – Supplemental Fact Sheet
Appendix D – Monitoring and Reporting Program
Appendix E – Determination of WQBELs

Enclosures:

Municipal General Order R5-2023-0025 (Discharger Only [email only])

cc:


Peter Kozelka, U.S. EPA, Region IX, San Francisco (email only)
Prasad Gullapalli, U.S. EPA Region IX, San Francisco (email only)
Afrooz Farsimadan, California State Water Resources Control Board (email only)
Renan Jauregui, California State Water Resources Control Board (email only)
Jarma Bennett, California State Water Resources Control Board (email only)
Charles Hardy, West Yost Associates (email only)
Debbie Mackey, Central Valley Clean Water Association, Sacramento (email only)
Discharge Monitoring Reports, California State Water Resources Control Board (via email at dmr@waterboards.ca.gov)
Chron File (RB5S-chron@Waterboards.ca.gov)

City of Galt
City of Galt Wastewater Treatment Plant and Reclamation Facility
TENTATIVE R5-2023-0025-XXX


XX XXXX 2026

Xuan Luo, Central Valley Water Board, Rancho Cordova (email only)
Jessica Rader, Central Valley Water Board, Rancho Cordova (email only)

APPENDIX A – LOCATION MAP

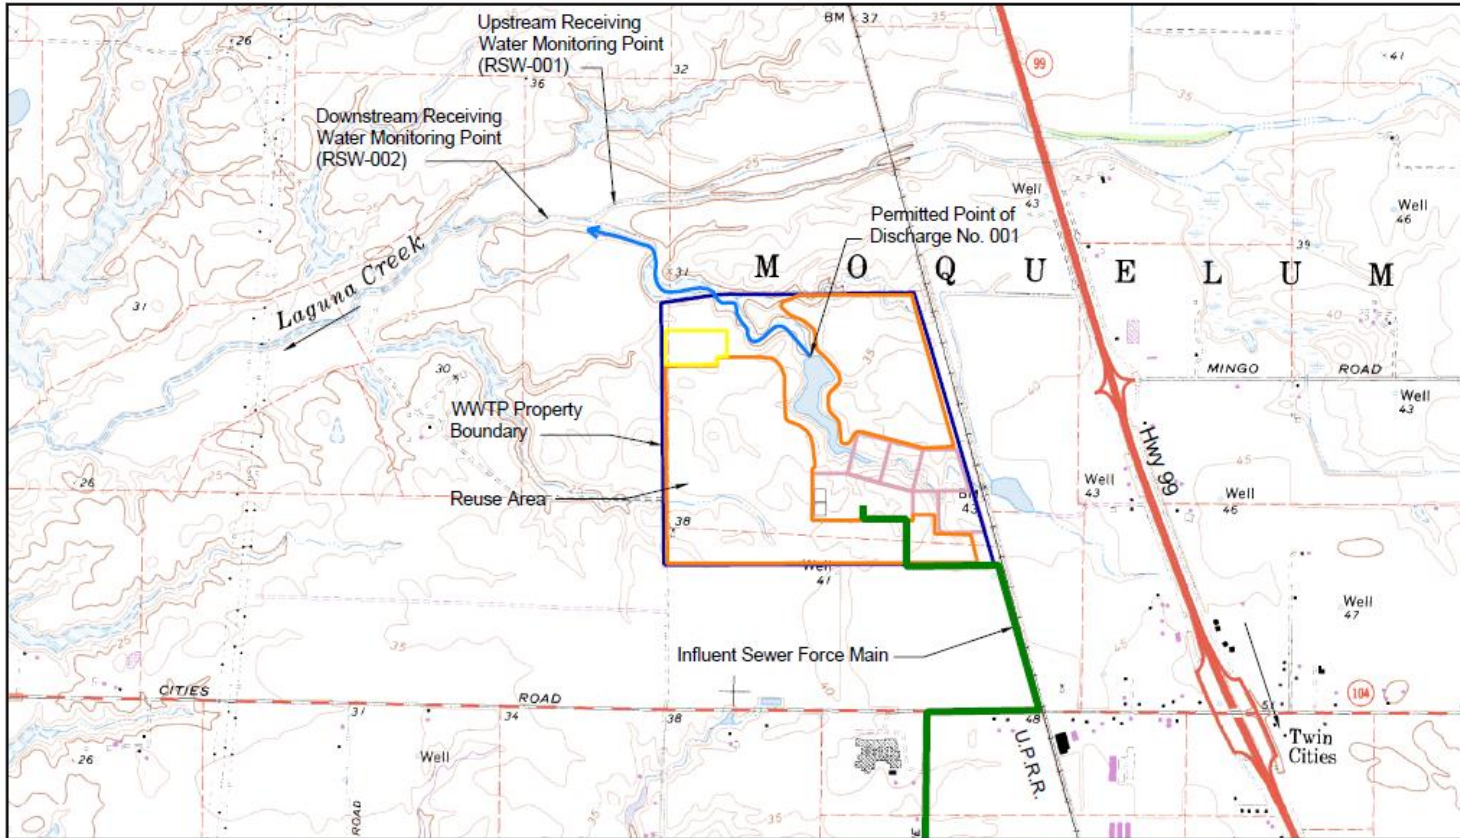

APPENDIX B – FLOW SCHEMATIC

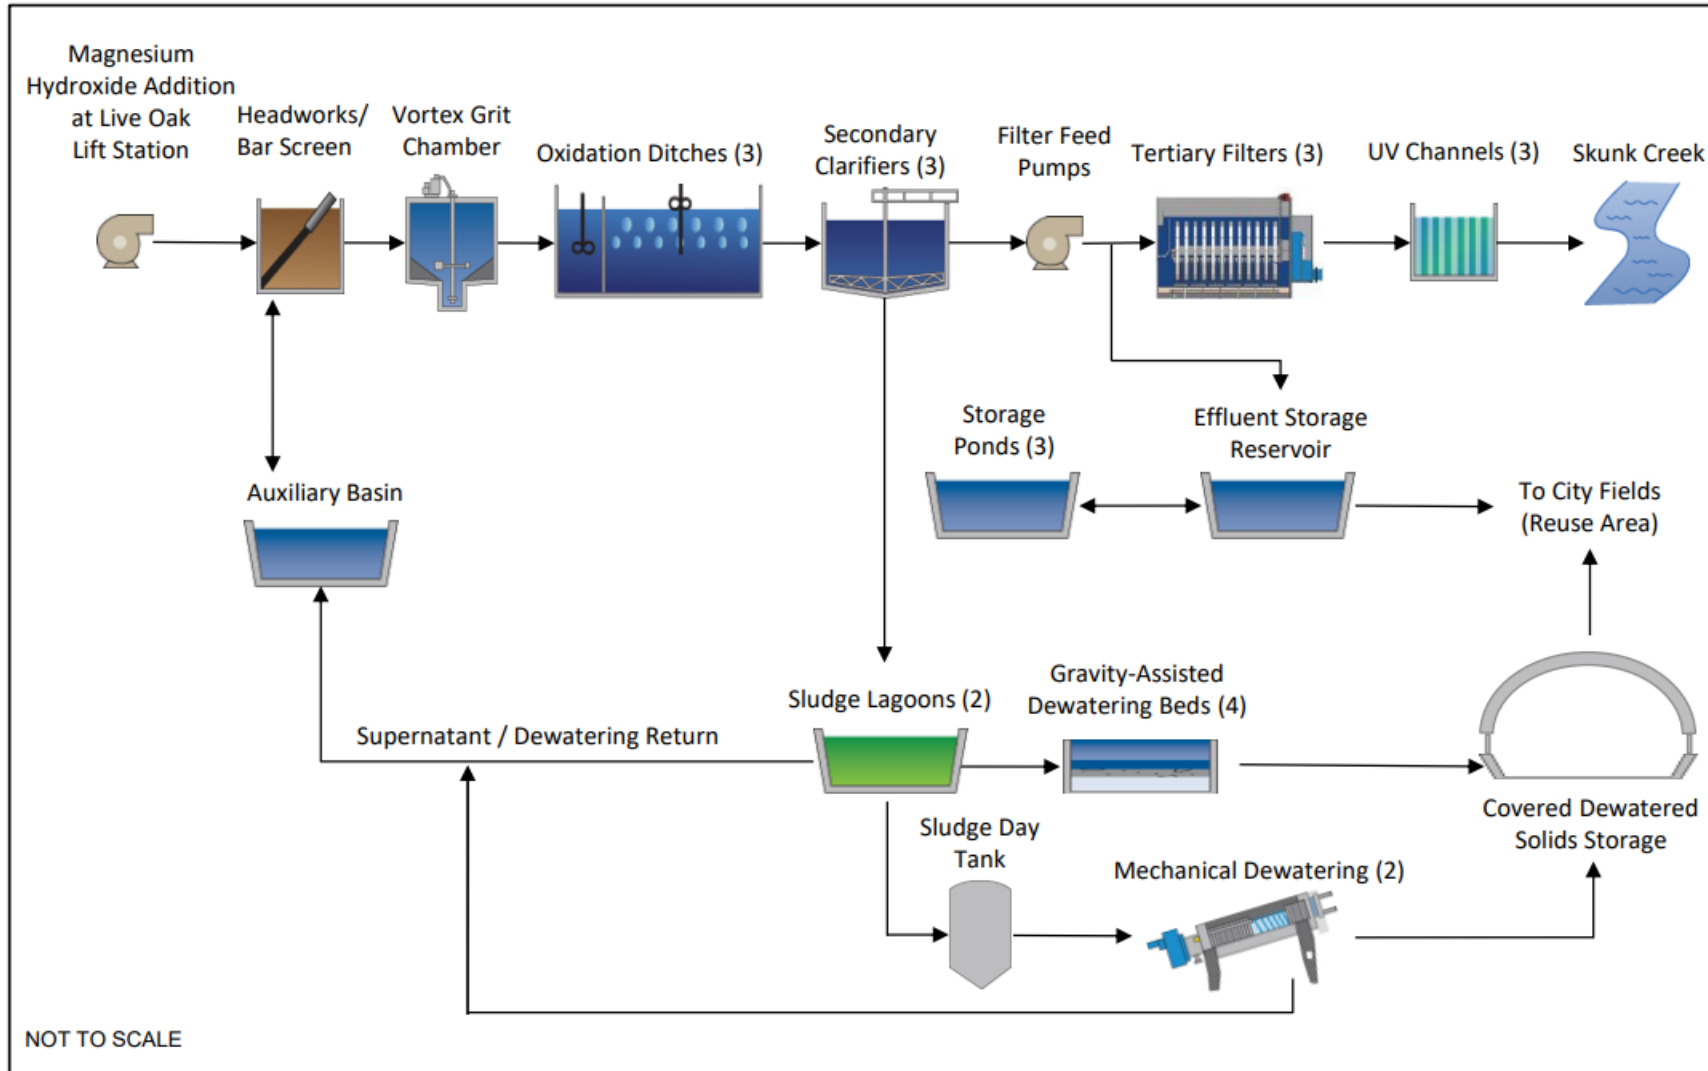

APPENDIX C – SUPPLEMENTAL FACT SHEET

I. APPLICABLE PLANS, POLICIES, AND REGULATIONS

The requirements contained in this NOA are based on the requirements and authorities described in Attachment F, section III of the Municipal General Order. In addition to the Fact Sheet contained in the Municipal General Order, the Central Valley Water Board incorporates this Supplemental Fact Sheet as findings of the Central Valley Water Board supporting the issuance of this NOA.

II. FINAL EFFLUENT LIMITATION CONSIDERATIONS

A. Satisfaction of Anti-Backsliding Requirements

The Clean Water Act specifies that a revised permit may not include effluent limitations that are less stringent than the previous permit unless a less stringent limitation is justified based on exceptions to the anti-backsliding provisions contained in CWA sections 402(o) or 303(d)(4), or, where applicable 40 Code of Federal Regulations (C.F.R.) section 122.44(l).

The effluent limitations in this NOA are at least as stringent as the effluent limitations in the Facility's previous Order R5-2017-0085-01, with the exception of effluent limitations for acute toxicity and electrical conductivity. This removal of effluent limitations is consistent with the anti-backsliding requirements of the CWA and federal regulations.

1. **CWA section 402(o)(1) and 303(d)(4).** CWA section 402(o)(1) prohibits the establishment of less stringent water quality-based effluent limits (WQBELs) "except in compliance with Section 303(d)(4)." CWA section 303(d)(4) has two parts: paragraph (A) which applies to nonattainment waters and paragraph (B) which applies to attainment waters.
 - a. For waters where standards are not attained, CWA section 303(d)(4)(A) specifies that any effluent limit based on a TMDL or other waste load allocation (WLA) may be revised only if the cumulative effect of all such revised effluent limits based on such TMDLs or WLAs will assure the attainment of such water quality standards.
 - b. For attainment waters, CWA section 303(d)(4)(B) specifies that a limitation based on a water quality standard may be relaxed where the action is consistent with the antidegradation policy.

Laguna Creek is considered an attainment water for acute toxicity, ammonia and electrical conductivity because the receiving water is not listed as impaired on the CWA section 303(d) list for these constituents. The exceptions in CWA section 303(d)(4) address both waters in attainment with water quality standards and those not in attainment, i.e. waters on the CWA section 303(d) impaired waters list (State Water Resources Control Board Order WQ-2008-0006, Berry Petroleum Company, Poso Creek/McVan Facility). As discussed below, removal of effluent limits for acute toxicity and electrical conductivity complies with federal and state antidegradation requirements. Thus, removal of these effluent limitations meets the exception in CWA section 303(d)(4)(B).

2. **CWA section 402(o)(2).** CWA section 402(o)(2) provides several exceptions to the anti-backsliding regulations. CWA 402(o)(2)(B)(i) allows a renewed, reissued, or modified permit to contain a less stringent effluent limitation for a pollutant if information is available which was not available at the time of permit issuance (other than revised regulations, guidance, or test methods) and which would have justified the application of a less stringent effluent limitation at the time of permit issuance.

Updated information that was not available at the time Order R5-2017-0085 was issued indicates that acute toxicity do not exhibit reasonable potential to cause or contribute to an exceedance of water quality objectives in the receiving water. Additionally, updated information that was not available at the time Order R5-2017-0085 was issued indicates that less stringent effluent limitations (AMEL only) for Ammonia satisfy requirements in CWA section 402(o)(2). The updated information that supports the relaxation of effluent limitations for Ammonia and the removal of the effluent limitations for acute toxicity and electrical conductivity includes the following:

- a. **Acute Toxicity.** Acute toxicity testing performed from February 2023 through February 2025 resulted in 100% survival of the test species (*Pimephales promelas*) and therefore, no acute toxicity. The discharge does not show reasonable potential to cause acute toxicity in the receiving water.
- b. **Ammonia.** The ammonia effluent limitations have been revised on updated pH and temperature data used for the calculation of the ammonia water quality criteria, resulting in a less stringent AMEL but a more stringent AWEL, and the updated data is representative of current treatment plant performance. Therefore, Central Valley Water Board staff considers this effluent data to be the most representative and reliable dataset to use to determine current Facility performance and development of WQBELs.

The AMEL for ammonia in this Order was calculated as a higher value than in the previous Order. However, the AWEL is more stringent than in the previous Order. The WQBELs in both Orders are based on the same WLA (i.e., the WLA is based on the CTR human health criterion for ammonia). The reason for the change in the AMEL and AWEL is due to a change in the variability of the effluent data for ammonia. The WQBELs, however, are equally protective of the beneficial uses. The level of treatment needed to maintain compliance with the effluent limits remains the same. Consequently, the effluent limits are not less stringent than the previous permit, and there is no backsliding.

- c. **Electrical Conductivity.** This NOA includes alternative effluent limitations for salinity by enforcing best management practices which includes ongoing participation in CV-SALTS. The Discharger is participating in the CV-SALTS's Salt Control Program Alternative Pathway. This NOA removes the effluent limitation for EC and establishes a performance-based effluent trigger for EC in accordance with the Alternative Pathway and the Bay-Delta Plan.

Thus, the relaxation of ammonia effluent limits and removal of the effluent limitations for acute toxicity and electrical conductivity is in accordance with CWA section

402(o)(2)(B)(i), which allows for the removal or relaxation of effluent limitations based on information that was not available at the time previous NOA R5-2017-0085-016 was issued.

B. Antidegradation Policies

This NOA continues to authorize an ADWF up to 4.5 MGD upon compliance with Provision VIII.D of this NOA and does not allow for a further increase in flow or mass of pollutants to the receiving water. Therefore, a complete antidegradation analysis is not necessary. This NOA requires compliance with applicable federal technology-based standards and with WQBELs where the discharge could have the reasonable potential to cause or contribute to an exceedance of water quality standards. The permitted discharge is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and the State Anti-Degradation Policy. Compliance with these requirements will result in the use of best practicable treatment or control of the discharge. The impact on existing water quality will be insignificant.

This NOA removes effluent limitations for acute toxicity and electrical conductivity. Based on Facility performance the relaxation or removal of these effluent limitations is not expected to result in an increase in pollutants concentration or loading, a decrease in the level of treatment or control, or a reduction of water quality. Implementation of this NOA will result in the best practicable treatment or control of the discharge necessary to assure that a pollution or nuisance will not occur and the highest water quality consistent with the maximum benefit to the people of the State will be maintained. Thus, the relaxation of ammonia average monthly effluent limit (AMEL) and removal of the effluent limitations for acute toxicity and electrical conductivity is consistent with the antidegradation provisions of 40 C.F.R. section 131.12 and State Water Resources Control Board (State Water Board) Resolution No. 68-16.

C. Salinity (Electrical Conductivity or EC)

Based on effluent electrical conductivity data collected from 01 January 2023 through 31 December 2025, the maximum calendar annual average electrical conductivity of the effluent was 875 $\mu\text{mhos/cm}$. The Municipal General Order includes a screening level for electrical conductivity of 1600 $\mu\text{mhos/cm}$ based on the Secondary Maximum Contaminant Level (MCL) to protect the municipal and domestic supply beneficial use. The Facility discharge does not exceed the electrical conductivity screening level; therefore, the discharge does not have reasonable potential to cause or contribute to an in-stream excursion of water quality objectives for salinity.

In accordance with the Basin Plan's Salt Control Program, the Discharger submitted a Notice of Intent on 28 April 2025 indicating participation in the Alternative Salinity Permitting Approach. Accordingly, the Municipal General Order includes a calendar annual average performance-based effluent trigger for electrical conductivity of 880 $\mu\text{mhos/cm}$ that is applicable to this Facility.

D. Whole Effluent Toxicity

The Statewide Toxicity Provisions, as approved by USEPA on 1 May 2023, establish new Reasonable Potential Analysis (RPA) requirements for both acute and chronic whole effluent toxicity. Based on the chronic toxicity testing results from February 2023

through October 2025, the effluent did not exceed 10 percent effect at the Instream Waste Concentration of 100 percent effluent for any species and no test failed the Test of Significant Toxicity. Therefore, the reasonable potential analysis determines the discharge does not have a reasonable potential to cause or contribute to an exceedance of the Statewide Toxicity Provisions for chronic toxicity. Chronic toxicity effluent limitations are not required for the discharge. It was also not warranted to maintain the Facility's acute whole effluent toxicity limitations since, per the Statewide Toxicity Provisions, a chronic aquatic toxicity test is generally protective of both chronic and acute aquatic toxicity. However, in accordance with the Statewide Toxicity Provisions, this NOA includes chronic toxicity effluent targets and associated monitoring (see Appendix D, section V.B).

III. RATIONALE FOR RECEIVING WATER LIMITATIONS

A. Surface Water

CWA section 303(a-c), requires states to adopt water quality standards, including criteria where they are necessary to protect beneficial uses. The Central Valley Water Board adopted water quality criteria as water quality objectives in the Basin Plan. The Basin Plan states that "[t]he numerical and narrative water quality objectives define the least stringent standards that the Regional Water Board will apply to regional waters in order to protect the beneficial uses." The Basin Plan includes numeric and narrative water quality objectives for various beneficial uses and water bodies. This NOA contains receiving surface water limitations based on the Basin Plan numerical and narrative water quality objectives for biostimulatory substances, color, chemical constituents, dissolved oxygen, floating material, oil and grease, pH, pesticides, radioactivity, suspended sediment, settleable substances, suspended material, tastes and odors, temperature, toxicity, and turbidity.

B. Groundwater -Not Applicable

IV. RATIONALE FOR MONITORING AND REPORTING REQUIREMENTS

CWA section 308 and 40 C.F.R. sections 122.41(h), (j)-(l), 122.44(i), and 122.48 require that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Central Valley Water Board to establish monitoring, inspection, entry, reporting, and recordkeeping requirements. The Monitoring and Reporting Program, Attachment E of the Municipal General Order establishes monitoring, reporting, and recordkeeping requirements that implement federal and state requirements. The following provides the rationale for the monitoring requirements contained in Monitoring and Reporting Program, Appendix D, of this NOA.

A. Influent Monitoring

1. Influent monitoring is required to collect data on the characteristics of the wastewater and to assess compliance with effluent limitations (e.g., BOD₅ and TSS reduction requirements). The monitoring frequencies for flow (continuous), BOD₅ (weekly), and TSS (weekly) have been retained from NOA R5-2017-0085-016.

B. Effluent Monitoring

1. Pursuant to the requirements of 40 C.F.R. section 122.44(i)(2) effluent monitoring is required for all constituents with effluent limitations. Effluent monitoring is necessary to assess compliance with effluent limitations, assess the effectiveness of the treatment process, and to assess the impacts of the discharge on the receiving stream and groundwater.
2. This NOA includes effluent monitoring for dissolved organic carbon (quarterly) to calculate site-specific freshwater aluminum criteria in accordance with the 2018 United States Environmental Protection Agency (U.S. EPA) National Ambient Water Quality Criteria (NAWQC) for aluminum in freshwater for the next permit renewal.
3. Effluent monitoring frequencies for flow (continuous), BOD₅ (once per week), TSS (once per week), ammonia (total, as nitrogen) (once per week), nitrate (total, as nitrogen) (once per month), temperature (once per week), , pH (one per week), chlorpyrifos (one per year), diazinon (one per year), and chronic toxicity (quarterly) and have been retained from NOA R5-2017-0085-016.
4. Calculations for the percent reduction between the influent and effluent for BOD₅ and TSS shall be calculated once per month. The addition of effluent nitrate plus nitrite shall be calculated once per month and reported as total nitrogen.
5. Monitoring data collected over the previous permit term for electrical conductivity indicated consistent compliance with effluent limitations. Thus, effluent monitoring has been reduced from one per week to one per month monitoring.
6. Hardness effluent monitoring has been reduced from one per month to one per quarter monitoring in order to be aligned with the dissolved organic carbon sampling.
7. Effluent monitoring for total dissolved solids (TDS) has been removed because EC effluent monitoring is used as the indicator parameter for salinity and controlling EC should ensure compliance with objectives for other salinity parameters.

C. Receiving Water Monitoring

1. Laguna Creek

- a. Receiving water monitoring is necessary to assess compliance with receiving water limitations and to assess the impacts of the discharge to Laguna Creek.
- b. This NOA includes receiving water monitoring for dissolved organic carbon (quarterly) to calculate site-specific freshwater aluminum criteria in accordance with the 2018 U.S. EPA NAWQC for aluminum in freshwater for the next permit renewal.
- c. NOA R5-2017-0085-016 required once per week receiving water monitoring for dissolved oxygen, pH, temperature and turbidity. Monitoring data collected during the term of NOA R5-2017-0085-016 indicates that the discharge has not caused significant impacts to Laguna Creek. Therefore, this NOA decreases the monitoring frequency for the above parameters to twice per month.
- d. NOA R5-2017-0085-016 required once per week receiving water monitoring for electrical conductivity and once per month monitoring for hardness and dissolved organic carbon. Monitoring data collected during the term of NOA R5-2017-0085-

016 indicates that the discharge has not caused significant impacts to Laguna Creek. Therefore, this NOA decreases the monitoring frequency for the above parameters to once per quarter.

2. Groundwater – Not Applicable

D. Whole Effluent Toxicity Testing Requirements

1. **Acute Toxicity.** A chronic toxicity test is generally protective of both chronic and acute toxicity and there were no acute toxicity failures during previous NOA R5-2017-0085-016; therefore, acute toxicity testing has been discontinued in this NOA.
2. **Chronic Toxicity.** According to the Statewide Toxicity Provisions and the Municipal General Order, the effluent discharge monitoring frequency for chronic toxicity bioassay testing (1/Quarter) has been retained from previous NOA R5-2017-0085-016. Chronic whole effluent toxicity testing is required when discharging to Laguna Creek in order to demonstrate compliance with the Statewide Toxicity Provisions.

E. Other Monitoring Requirements

1. Biosolids Monitoring – Not Applicable

2. Filtration System Monitoring

- a. Filtration system monitoring for turbidity is required for Dischargers of tertiary treated wastewater that meet the eligibility criteria in section I.B.4 of the Municipal General Order to determine compliance with the filtration system operating specifications in section VII.C.4.a of the Municipal General Order.
- b. The monitoring frequency for turbidity (continuous) is retained from previous NOA R5-2017-0085-016 to evaluate compliance the turbidity operating specifications.

3. UV Disinfection System Monitoring

- a. Monitoring frequencies for Flow(continuous), total coliform organisms (two per week), number of UV banks in operation(continuous), UV transmittance(continuous), UV dose (continuous) have been retained from previous NOA R5-2017-0085-016 to evaluate compliance with UV operating specifications.

4. Pond Monitoring – Not Applicable

6. Land Discharge Monitoring – Not Applicable

7. Title 22 Recycled Water Monitoring – Not Applicable

8. **Pyrethroid Pesticides Monitoring –** A Basin Plan Amendment and TMDL for the Control of Pyrethroid Pesticide Discharges in the Sacramento and San Joaquin River basins (Resolution R5-2017-0057) was approved by the Central Valley Water Board on 8 June 2017 and is now effective. The Pyrethroids Control Program established by Resolution R5-2017-0057 requires monitoring by domestic and municipal wastewater dischargers discharging at least 1 MGD for the concentrations of pyrethroid pesticides, total and dissolved organic carbon in the water column, and water column toxicity testing. Monitoring is required for

dischargers discharging at least 1 MGD to evaluate the potential impacts of discharges of pyrethroid pesticides to receiving waters.

9. Discharge Monitoring Report-Quality Assurance (DMR-QA) Study Program

Under the authority of section 308 of the CWA (33 U.S.C. section 1318), U.S. EPA requires all dischargers under the NPDES Program to participate in the annual DMR-QA Study Program. The DMR-QA Study evaluates the analytical ability of laboratories that routinely perform or support self-monitoring analyses required by NPDES permits. There are two options to satisfy the requirements of the DMR-QA Study Program: (1) The Discharger can obtain and analyze a DMR-QA sample as part of the DMR-QA Study; or (2) Per the waiver issued by U.S. EPA to the State Water Board, the Discharger can submit the results of the most recent Water Pollution Performance Evaluation Study from their own laboratories or their contract laboratories. A Water Pollution Performance Evaluation Study is similar to the DMR-QA Study. Thus, it also evaluates a laboratory's ability to analyze wastewater samples to produce quality data that ensure the integrity of the NPDES Program. The Discharger shall submit annually the results of the DMR-QA Study or the results of the most recent Water Pollution Performance Evaluation Study to the State Water Board. The State Water Board's Quality Assurance Program Officer will send the DMR-QA Study results or the results of the most recent Water Pollution Performance Evaluation Study to U.S. EPA's DMR-QA Coordinator and Quality Assurance Manager.

10. Recycled Water Policy Annual Reports

On 11 December 2018, the State Water Board adopted Resolution 2018-0057, which amends the Recycled Water Policy, section 3, to require wastewater and recycled water dischargers to annually report monthly volumes of influent, wastewater produced, and effluent, including treatment level and discharge type. Therefore, to incorporate monitoring and reporting required by the Recycled Water Policy, the Municipal General Order requires annual reporting of wastewater and recycled water use into Geotracker and confirmation of annual reporting to Geotracker is required by this NOA.

11. Effluent and Receiving Water Characterization Monitoring

- a. Order R5-2017-0085 included requirements for the Discharger to complete quarterly effluent characterization monitoring for one year when discharging to Laguna Creek. This NOA retains the quarterly effluent characterization monitoring for one year.
- b. Order R5-2017-0085 included requirements for the Discharger to complete quarterly upstream receiving water characterization monitoring for one year when discharging to Laguna Creek. This NOA retains the quarterly upstream receiving water characterization monitoring for one year.

V. PRETREATMENT PROVISION – NOT APPLICABLE

VI. SUMMARY OF REASONABLE POTENTIAL ANALYSIS

Abbreviations used in Table C-1:

MEC = Maximum Effluent Concentration
 B = Maximum Receiving Water Concentration
 C = Criterion used for Reasonable Potential Analysis
 CMC = Criterion Maximum Concentration
 CCC = Criterion Continuous Concentration
 Water and Org = Human Health Criterion for Consumption of Water and Organisms
 Org Only = Human Health Criterion for Consumption of Organisms Only
 Basin Plan = Numeric Site-Specific Basin Plan Water Quality Objective
 MCL = Drinking Water Standards Maximum Contaminant Level
 RP= Reasonable Potential

Table C-1: SUMMARY OF REASONABLE POTENTIAL ANALYSIS

Parameter	Units	MEC	B	C	CMC	CCC	Water and Org	Org. Only	Basin Plan	MCL	RP
Ammonia (as Nitrogen)	mg/L	0.53	0.79	2.17	3.9	2.17	--	--	--	--	Yes (see Table Note iii)
Aluminum	ug/L	57	2500	200	1400	510	--	--	--	--	No
Iron	ug/L	31	2700	300	--	--	--	--	--	300	No
Manganese. Total Recoverable	ug/L	5.4	230	50	--	--	--	--	--	50	No
pH	SU	8.11	9.2	6.5-8.5	--	--	--	--	--	--	No
Electrical Conductivity @ 25° Celsius (°C)	µmhos/cm	800	1212	1600	--	--	--	--	--	1600	No
Total Dissolved Solids	mg/L	700	280	500	--	--	--	--	--	500	No
Nitrate plus Nitrite	mg/L	7.7	0.77	10	--	--	--	--	--	10	Yes (see Table Note iii)

1. Table C-1 Notes:

- i. **CMC.** For ammonia, the CMC or criterion maximum concentration is based on the U.S. EPA National Recommended Ambient Water Quality Criteria Freshwater Aquatic Life Protection, 1-hour average.
- ii. **CCC.** For ammonia, the CCC or criterion continuous concentration is based on the U.S. EPA National Recommended Ambient Water Quality Criteria Freshwater Aquatic Life Protection, 30-day average.
- iii. Ammonia and Nitrate plus Nitrite. Reasonable potential exists due to the biological processes inherent to the treatment of domestic wastewater (see sections V.C.3.b.ii and V.C.3.b.ix in Attachment F, Fact Sheet, of the Municipal General Order).

APPENDIX D – MONITORING AND REPORTING PROGRAM

I.	GENERAL MONITORING PROVISIONS	24
II.	MONITORING LOCATIONS	25
III.	INFLUENT MONITORING REQUIREMENTS	26
	A. Monitoring Location INF-001	26
IV.	EFFLUENT MONITORING REQUIREMENTS	27
	A. Monitoring Location EFF-001	27
V.	WHOLE EFFLUENT TOXICITY (WET) TESTING REQUIREMENTS	29
	A. Acute Toxicity Testing – Not Applicable	29
	B. Chronic Toxicity Testing	29
	C. Quality Assurance and Additional Requirements.....	31
	D. WET Testing Notification Requirements.....	32
	E. WET Testing Reporting Requirements	32
	F. Most Sensitive Species Screening	32
	G. Toxicity Reduction Evaluations (TRE)	34
VI.	LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE.....	35
VII.	RECYCLING MONITORING REQUIREMENTS – NOT APPLICABLE.....	35
VIII.	RECEIVING WATER MONITORING REQUIREMENTS	35
	A. Monitoring Locations RSW-001 and RSW-002.....	35
IX.	OTHER MONITORING REQUIREMENTS	36
	A. Biosolids – Not Applicable	36
	B. Ponds – Not Applicable	36
	C. Municipal Water Supply– Not Applicable	36
	D. Filtration System and Ultraviolet Light (UV) Disinfection System.....	36
	E. Pyrethroid Pesticides Monitoring	38
	F. Effluent Characterization and Receiving Water Characterization	41
X.	REPORTING REQUIREMENTS.....	48
	A. General Monitoring and Reporting Requirements	48
	B. Self-Monitoring Reports.....	49
	C. Discharge Monitoring Reports (DMRs).....	52
	D. Other Reports	53

Tables

Table D-1.	Monitoring Station Locations	26
Table D-2.	Influent Monitoring	26
Table D-3.	Effluent Monitoring.....	27
Table D-4.	Receiving Water Monitoring Requirements	35
Table D-5.	Filtration and UV Disinfection System Monitoring Requirements.....	36
Table D-6.	Pyrethroid Pesticides Monitoring	38
Table D-7.	Pyrethroid Pesticide Partition Coefficients	40
Table D-8.	Effluent and Receiving Water Characterization Monitoring.....	42
Table D-9.	Monitoring Periods and Reporting Schedule	49
Table D-10.	Technical Reports.....	54

APPENDIX D – MONITORING AND REPORTING PROGRAM (MRP)

The Municipal General Order contains monitoring and reporting requirements in Attachment E. Some of the monitoring and reporting requirements listed in the Municipal General Order are not applicable to the Facility. The monitoring and reporting requirements applicable to the Facility are contained in this Appendix and are described herein.

The Code of Federal Regulations (40 C.F.R. § 122.48) requires that all NPDES permits specify monitoring and reporting requirements. Water Code sections 13267 and 13383 also authorize the Central Valley Water Board to require technical and monitoring reports. This MRP establishes monitoring and reporting requirements that implement state and federal regulations.

I. GENERAL MONITORING PROVISIONS

- A.** Samples and measurements taken as required herein shall be representative of the volume and nature of the monitored discharge. All samples shall be taken at the monitoring locations specified below and, unless otherwise specified, before the monitored flow joins or is diluted by any other waste stream, body of water, or substance. Monitoring locations shall not be changed without notification to and the approval of the Central Valley Water Board.
- B.** Final effluent samples shall be taken downstream of the last addition of wastes to the treatment or discharge works where a representative sample may be obtained prior to mixing with the receiving waters. Samples shall be collected at such a point and in such a manner to ensure a representative sample of the discharge.
- C.** Chemical, bacteriological, and bioassay analyses of any material required by this NOA shall be conducted by a laboratory accredited for such analyses by the State Water Resources Control Board (State Water Board), Division of Drinking Water (DDW), in accordance with the provision of Water Code section 13176. Laboratories that perform sample analyses must be identified in all monitoring reports submitted to the Central Valley Water Board. Data generated from field measurements such as, pH, dissolved oxygen, electrical conductivity (EC), turbidity, and temperature are exempt pursuant to Water Code section 13176. A manual containing the steps followed in this program for any field measurements such as, but not limited to, pH, dissolved oxygen, EC, turbidity, and temperature must be kept onsite in the treatment facility laboratory and shall be available for inspection by Central Valley Water Board staff. The Discharger must demonstrate sufficient capability (qualified and trained employees, properly calibrated and maintained field instruments, etc.) to adequately perform these field measurements. The Quality Assurance-Quality Control Program must conform to U.S. EPA guidelines or to procedures approved by the Central Valley Water Board.
- D.** Appropriate flow measurement devices and methods consistent with accepted scientific practices shall be selected and used to ensure the accuracy and reliability of measurements of the volume of monitored discharges. All monitoring

instruments and devices used by the Discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary, at least yearly, to ensure their continued accuracy. All flow measurement devices shall be calibrated at least once per year to ensure continued accuracy of the devices.

- E.** Monitoring results, including noncompliance, shall be reported at intervals and in a manner specified in this MRP.
- F.** Laboratory analytical methods shall be sufficiently sensitive in accordance with the Sufficiently Sensitive Methods Rule (SSM Rule) specified under 40 C.F.R. 122.21(e)(3) and 122.44(i)(1)(iv). A U.S. EPA-approved analytical method is sufficiently sensitive for pollutant/parameter where:
- The method minimum level (ML) is at or below the applicable water quality objective for the receiving water, or;
 - The method ML is above the applicable water quality objective for the receiving water but the amount of the pollutant/parameter in the discharge is high enough that the method detects and quantifies the level of the pollutant/parameter, or;
 - The method ML is above the applicable water quality objective for the receiving water, but the ML is the lowest of the 40 C.F.R. 136 U.S. EPA-approved analytical methods for the pollutant/parameter.
- G.** The Discharger shall ensure that the results of the Discharge Monitoring Report-Quality Assurance (DMR-QA) Study or the most recent Water Pollution Performance Evaluation Study are submitted annually, via email, to QualityAssurance@waterboards.ca.gov to the State Water Resources Control.
- H.** The Discharger shall file with the Central Valley Water Board technical reports on self-monitoring performed according to the detailed specifications contained in this MRP.
- I.** The results of all monitoring required by this MRP shall be reported to the Central Valley Water Board and shall be submitted in such a format as to allow direct comparison with the limitations and requirements of this NOA. Unless otherwise specified, discharge flows shall be reported in terms of the monthly average and the daily maximum discharge flows.

J. Multiple Discharge Points – Not Applicable

II. MONITORING LOCATIONS

The Discharger shall establish the monitoring locations listed in Table D-1 to demonstrate compliance with the effluent limitations, discharge specifications, and other requirements in this NOA.

Table D-1. Monitoring Station Locations

Discharge Point Name	Monitoring Location Name	Monitoring Location Description
--	INF-001	A location where a representative sample of the influent into the Facility can be collected.
001	EFF-001	A location where a representative sample of the effluent from the Facility can be collected after all treatment processes and prior to commingling with other waste streams or being discharged into Laguna Creek. Latitude: 38°17'56 N, Longitude: 121°19'46" W
--	RSW-001	A location approximately 380 feet upstream (east) of the confluence with Skunk Creek. Latitude: 38°18'30.22 N, Longitude: 121°20'23.37" W
--	RSW-002	A location on Laguna Creek approximately 600 feet downstream from the confluence of the remnant channel of Skunk Creek and Laguna creek.
--	FIL-001	Monitoring of the filter effluent to be measured downstream of the filters prior to the UV disinfection system.
--	UVS-001	A location where a representative sample of wastewater can be collected in the ultraviolet light (UV) disinfection system.

The North latitude and West longitude information in Table D-1 are approximate for administrative purposes.

III. INFLUENT MONITORING REQUIREMENTS

A. Monitoring Location INF-001

1. The Discharger shall monitor influent to the Facility at Monitoring Location INF-001 when discharging to Laguna Creek as specified in Table D-2 and the testing requirements described in section III.A.2 below:

Table D-2. Influent Monitoring

Parameter	Units	Sample Type	Sampling Frequency
Flow	MGD	Meter	Continuous
Biochemical Oxygen Demand (5-day @ 20°Celsius)	mg/L	24-hour Composite	1/Week
Total Suspended Solids	mg/L	24-hour Composite	1/Week

2. **Table D-2 Testing Requirements.** The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-2:
 - a. **Applicable to all parameters.** Parameters shall be analyzed using the analytical methods described in 40 C.F.R. part 136; or by methods approved by the Central Valley Water Board or the State Water Board. In addition, if requested by the Discharger, the sample type may be modified by the Executive Officer to another 40 C.F.R. part 136 allowed sample type.
 - b. **Composite Sample.** All composite samples shall be collected from a 24-hour flow proportional composite.

IV. EFFLUENT MONITORING REQUIREMENTS

A. Monitoring Location EFF-001

1. The Discharger shall monitor treated domestic wastewater at Monitoring Location EFF-001 when discharging to Laguna Creek as specified in Table D-3 and the testing requirements in section IV.A.2. If there was no discharge to receiving water during the designated monitoring period, monitoring is not required for that period. If there was no discharge, the Discharger shall state so in the monthly self-monitoring report (SMR).

Table D-3. Effluent Monitoring

Parameter	Units	Sample Type	Minimum Sampling Frequency
Flow	MGD	Meter	Continuous
Biochemical Oxygen Demand (5-day @ 20° C)	mg/L	24-hr Composite	1/Week
Biochemical Oxygen Demand (5-day @ 20° C)	percent removal	Calculate	1/Month
pH	standard units	Grab	1/Week
Total Suspended Solids	mg/L	24-hr Composite	1/Week
Total Suspended Solids	percent removal	Calculate	1/Month
Ammonia Nitrogen, Total (as N)	mg/L	Grab	1/Week
Chlorpyrifos	µg/L	Grab	1/Year
Diazinon	µg/L	Grab	1/Year
Electrical Conductivity @ 25°C	µmhos/cm	Grab	1/Month
Hardness, Total (as CaCO ₃)	mg/L	Grab	1/Quarter

Parameter	Units	Sample Type	Minimum Sampling Frequency
Dissolved Organic Carbon (DOC)	mg/L	Grab	1/Quarter
Nitrate Plus Nitrite (as N)	mg/L	Grab	1/Month
Temperature	°C	Grab	1/Week

2. **Table D-3 Testing Requirements.** The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-3:
- a. **Composite Sample.** All composite samples shall be collected from a 24-hour flow proportional composite.
 - b. **Applicable to all parameters.** Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
 - c. **Grab Sample.** A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.
 - d. **Ammonia.** Samples for pH and temperature shall be recorded at the time of ammonia sample collection.
 - e. **Field Meter.** A hand-held field meter may be used for **pH, electrical conductivity, temperature**, provided the meter utilizes a U.S. EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.
 - f. **Dissolved Organic Carbon.** Dissolved organic carbon samples shall be taken at approximately the same time and on the same date as the hardness and pH samples.
 - g. **Chlorpyrifos and Diazinon.** Chlorpyrifos and diazinon shall be sampled using U.S. EPA Method 625M, Method 8141, or equivalent GC/MS method with a lower Reporting Limit than the Basin Plan Water Quality Objectives of 0.015 µg/L and 0.1 µg/L for chlorpyrifos and diazinon, respectively.
 - h. **Temperature, pH, Hardness, and Dissolved Organic Carbon.** The effluent samples for temperature, pH, hardness, and dissolved organic carbon shall be taken approximately the same time and on the same date with the receiving water samples for these parameters.

V. WHOLE EFFLUENT TOXICITY (WET) TESTING REQUIREMENTS

A. Acute Toxicity Testing – Not Applicable

B. Chronic Toxicity Testing

The Discharger shall meet the following chronic toxicity testing requirements:

1. **Instream Waste Concentration (IWC) for Chronic Toxicity.** The chronic toxicity IWC is 100 percent effluent.
2. **Routine Monitoring Frequency.** The Discharger shall perform routine chronic toxicity testing **quarterly** when there is expected to be at least 15 days of discharge within the toxicity calendar quarter.
3. **Toxicity Calendar Month, Quarter, and Year**
 - a. **Toxicity Calendar Month.** The toxicity calendar month is defined as the period of time from a day of one month to the day before the corresponding day of the next month if the corresponding day exists, or if not to the last day of the next month. For purposes of this NOA, the toxicity calendar month **begins on the first of the month January 1, February 1, March 1, etc.** (e.g., from January 1 to January 31, from February 1 to February 28 or 29, from March 1 to March 31, etc.)
 - b. **Toxicity Calendar Quarter.** A toxicity calendar quarter is defined as **three consecutive toxicity calendar months**. For purposes of this NOA, the toxicity calendar quarters **begin on January 1, April 1, July 1, and October 1** (i.e., from January 1 to March 31, from April 1 to June 30, from July 1 to September 30, etc.).
 - c. **Toxicity Calendar Year.** A toxicity calendar year is defined as **twelve consecutive toxicity calendar months**. For purposes of this NOA, the toxicity calendar year **begins on January 1** (i.e., January 1 to December 31), in years in which there are at least 15 days of discharge in at least one calendar quarter.
4. **Chronic Toxicity Median Monthly Effluent Target (MMET) Testing.** If a routine chronic toxicity monitoring test results in a “Fail” (as defined in section V.C below) at the IWC, then a maximum of two chronic toxicity MMET tests shall be completed. The chronic toxicity MMET tests shall be initiated within the same toxicity calendar month that the routine monitoring chronic toxicity test was initiated that resulted in the “Fail” at the IWC. If the first chronic toxicity MMET test results in a “Fail” at the IWC, then the second chronic toxicity MMET test is unnecessary and is waived. When there is no effluent available to complete a follow up MMET test, the test shall not be required, and routine monitoring continues at the frequency as specified in the NOA.
5. **Additional Routine Monitoring Tests for Toxicity Reduction Evaluation (TRE) Determination.** In order to determine if a TRE is necessary, an additional routine monitoring test is required when there is one violation of the chronic toxicity MDET or MMET, but not two violations, in a single toxicity calendar month. This additional routine monitoring test is not required if the

Discharger is already conducting a TRE. This additional routine monitoring test shall be initiated within two weeks after the toxicity calendar month in which the MMET or MDET violation occurred. The toxicity calendar month of the violation and the toxicity calendar month of the additional routine monitoring shall be considered “successive toxicity calendar months” for purposes of determining whether a TRE is required. This additional routine monitoring test could result in the need to conduct MMET testing per section V.B.4 above.

6. **Sample Volumes.** Adequate sample volumes shall be collected to provide renewal water to complete the test in the event that the discharge is intermittent.
7. **Test Species.** The testing shall be conducted using the most sensitive species. The Discharger shall conduct chronic toxicity tests with the **water flea (*Ceriodaphnia dubia*)**.

The Executive Officer shall have discretion to allow the temporary use of the next appropriate species as the most sensitive species when the Discharger submits documentation, and the Executive Officer determines that the Discharger has encountered unresolvable test interference or cannot secure a reliable supply of test organisms. The “next appropriate species” is a species in Table 1 of the Statewide Toxicity Provisions in the same test method classification (e.g., chronic aquatic toxicity test methods, acute aquatic toxicity test method), in the same salinity classification (e.g., freshwater or marine), and in the same taxon as the most sensitive species. When there are no other species in Table 1 in the same taxon as the most sensitive species (e.g., freshwater chronic toxicity tests), the “next appropriate species” is the species exhibiting the highest percent effect at the IWC tested in the species sensitivity screening other than the most sensitive species.

8. **Test Methods.** The Discharger shall conduct the chronic toxicity tests on effluent samples at the IWC for the discharge in accordance with species and test methods described in Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Freshwater Organisms (EPA/821/R02/013, 2002; Table IA, 40 C.F.R. part 136).
9. **Dilution and Control Water.** Dilution water and control water shall be prepared and used as specified in the test methods manual. If dilution water and control water are different from test organism culture water, then a second control using culture water shall also be used. A receiving water control or laboratory water control may be used as the diluent.
10. **Test Failure.** If the effluent chronic toxicity test does not meet all test acceptability criteria (TAC) specified in the referenced test method in EPA/821-R-02-013, the Discharger must conduct a Replacement Test as soon as possible, as specified in subsection B.11, below.
11. **Replacement Test.** When a required toxicity test for routine monitoring or a MMET test is not completed, a new toxicity test to replace the toxicity test that

was not completed shall be initiated as soon as possible. The new toxicity test shall replace the routine monitoring or MMET test, as applicable, for the toxicity calendar month in which the toxicity test that was not completed was required to be initiated, even if the new toxicity test is initiated in a subsequent toxicity calendar month. The new toxicity test for routine monitoring or for the MMET test, as applicable, and any MMET tests required to be conducted due to the results of the new toxicity test shall be used to determine compliance with the effluent targets for the toxicity calendar month in which the toxicity test that was not completed was required to be initiated. The new toxicity test and any MMET test required to be conducted due to the results of the new toxicity test shall not be used to substitute for any other required toxicity tests.

If it is determined that any specific monitoring event was not initiated in the required time period due to circumstances outside of the Discharger's control that were not preventable with the reasonable exercise of care, the Discharger is not required to initiate the specific monitoring event in the required time period if the Discharger promptly initiates or ultimately completes a replacement test.

C. Quality Assurance and Additional Requirements

Quality assurance measures, instructions, and other recommendations and requirements are found in the test methods manual previously referenced. Additional requirements are below:

1. The discharge is subject to determination of "Pass" or "Fail" from a chronic toxicity test using the Test of Significant Toxicity (TST) statistical t-test approach described in section IV.B.1.c of the Statewide Toxicity Provisions.
2. The null hypothesis (H_0) for the TST statistical approach is:

Mean discharge IWC response \leq RMD x Mean control response, where the chronic RMD = 0.75 and the acute RMD = 0.80.

A test result that rejects this null hypothesis is reported as "Pass". A test result that does not reject this null hypothesis is reported as "Fail".

3. The relative "Percent Effect" at the discharge IWC is defined and reported as:

Percent Effect = $((\text{Mean control response} - \text{Mean discharge IWC response}) / (\text{Mean control response})) \times 100$.

This is a t-test, a statistical analysis comparing two sets of replicate observations, i.e., a control and IWC. The purpose of this statistical test is to determine if the means of the two sets of observations are different (i.e., if the IWC concentration differs from the control, the test result is "Fail"). The Welch's t-test employed by the TST statistical approach is an adaptation of Student's t-test and is used with two samples having unequal variances.

D. WET Testing Notification Requirements

The Discharger shall notify the Central Valley Water Board of test results exceeding the chronic toxicity effluent target as soon as the Discharger learns of the exceedance, but no later than 24-hours after receipt of the monitoring results.

E. WET Testing Reporting Requirements

The Discharger shall submit the full laboratory report for all toxicity testing and, if applicable, progress reports on TREs as attachments to the SMRs in CIWQS for the reporting period (e.g., monthly, quarterly, semi-annually, or annually), and shall provide the data (i.e., Pass/Fail) in the PET tool for uploading into CIWQS. The laboratory report shall include:

1. The valid toxicity test results for the TST statistical approach, reported as “Pass” or “Fail” and “Percent Effect” at the IWC for the discharge, the dates of sample collection and initiation of each toxicity test, and all results for effluent parameters monitored concurrently with the toxicity test(s);
2. The statistical analysis used in section IV.B.1.c of the Statewide Toxicity Provisions; and
3. Statistical program (e.g., TST calculator, CETIS, etc.) output results, including graphical plots, for each toxicity test.

F. Most Sensitive Species Screening

If the effluent used in the most recent species sensitivity screening is no longer representative of the current effluent, the Discharger shall perform re-screening to re-evaluate the most sensitive species. The species sensitivity screening shall be conducted as follows:

1. **Frequency of Testing for Species Sensitivity Screening.** Species sensitivity screening for chronic toxicity shall include, at a minimum, a set of chronic WET testing conducted in **each toxicity calendar quarter in which there is expected to be at least 15 days of discharge**. Species sensitivity screening for chronic toxicity shall be conducted using the water flea (*Ceriodaphnia dubia*), fathead minnow (*Pimephales promelas*), and green alga (*Pseudokirchneriella subcapitata*). The tests shall be performed at an IWC of no less than 100 percent effluent.

When there is no representative effluent available to complete tests in one of the sets in a species sensitivity screening, that set of testing shall not be required.

2. **Determination of Most Sensitive Species.** The Central Valley Water Board will determine the most sensitive species from the water flea (*Ceriodaphnia dubia*), fathead minnow (*Pimephales promelas*), and green alga (*Pseudokirchneriella subcapitata*) using the following procedure. If a single test in the species sensitivity screening testing results in a “Fail” using the TST statistical approach, then the species used in that test shall be established as the most sensitive species. If there is more than a single test that results in a “Fail”, then of the species with results of a “Fail”, the species

that exhibits the highest percent effect shall be established as the most sensitive species. If none of the tests in the species sensitivity screening results in a “Fail”, but at least one of the species exhibits a percent effect greater than 10 percent, then the single species that exhibits the highest percent effect shall be established as the most sensitive species. In all other circumstances, the Executive Officer shall have discretion to determine which single species is the most sensitive considering the test results from the species sensitivity screening.

The “next appropriate species” is a species in Table 1 of the Statewide Toxicity Provisions in the same test method classification (e.g., chronic aquatic toxicity test methods, acute aquatic toxicity test method), in the same salinity classification (e.g., freshwater or marine), and in the same taxon as the most sensitive species. When there are no other species in Table 1 in the same taxon as the most sensitive species (e.g., freshwater chronic toxicity tests), the “next appropriate species” is the species exhibiting the highest percent effect at the IWC tested in the species sensitivity screening other than the most sensitive species. The Executive Officer shall have discretion to allow the temporary use of the next appropriate species as the most sensitive species when the Discharger submits documentation and the Executive Officer determines that the Discharger has encountered unresolvable test interference or cannot secure a reliable supply of test organisms.

The most sensitive species shall be used for chronic toxicity testing for the remainder of the permit term. The Discharger may use the four most recent tests for use in determining the most sensitive species if the tests were conducted in a manner sufficient to make such determination.

If the most sensitive species cannot be determined from the species sensitivity screening discussed above, the Discharger shall rotate the test species as the most sensitive species every toxicity calendar year as follows:

- a. *Ceriodaphnia dubia* (survival and reproduction test) for the remainder of the toxicity calendar year this NOA is issued;
- b. *Pimephales promelas* (larval survival and growth test) for the entire toxicity calendar year following the toxicity calendar year this NOA is issued;
- c. *Pseudokirchneriella subcapitata* (growth test) for the entire toxicity calendar year of the second year following the toxicity calendar year this NOA is issued; and
- d. Cycling back to *Ceriodaphnia dubia* (survival and reproduction test) after *Pseudokirchneriella subcapitata* (growth test) and continuing through the same rotation as above.

If a single test exhibits toxicity, demonstrated by a test that results in a “Fail” using the TST statistical approach, then the species used in that test shall be established as the most sensitive species until the next NOA reissuance.

G. Toxicity Reduction Evaluations (TRE)

Reports for TREs shall be submitted in accordance with the schedule contained in the Discharger's approved TRE Work Plan, or as amended by the Discharger's TRE Action Plan.

1. TRE Targets

- a. **Chronic Whole Effluent Toxicity MMET.** No more than one chronic aquatic toxicity test with the most sensitive species initiated in a toxicity calendar month shall result in a "fail" at the IWC for any endpoint.
 - b. **Chronic Whole Effluent Toxicity MDET.** No chronic aquatic toxicity test with the most sensitive species shall result in a "fail" at the IWC for the sub-lethal endpoint measured in the test and a percent effect for the survival endpoint greater than or equal to 50 percent.
2. **TRE Implementation.** The Discharger is required to initiate a TRE when there is any combination of two or more chronic toxicity MDET or MMET exceedances within a single toxicity calendar month or within two successive toxicity calendar months (as defined in paragraph V.B.5 above). If other information indicates toxicity (e.g., results of additional monitoring, results of monitoring at a higher concentration than the IWC, fish kills, or intermittent recurring toxicity), the Central Valley Water Board may require a TRE. A TRE may also be required when there is no effluent available to complete a routine monitoring test or MMET test.
- a. **Preparation and Implementation of Detailed TRE Action Plan.** The Discharger shall conduct TREs in accordance with an approved TRE Work Plan. Within 30 days of the test result that triggered the TRE, the Discharger shall submit to the Executive Officer a TRE Action Plan per the Discharger's approved TRE Work Plan. The TRE Action Plan shall include the following information, and comply with additional conditions set by the Executive Officer:
 - i. Specific actions the Discharger will take to investigate and identify the cause(s) of toxicity, including a TRE WET monitoring schedule;
 - ii. Specific actions the Discharger will take to mitigate the impact of the discharge and prevent the recurrence of toxicity; and
 - iii. A schedule for these actions, progress reports, and the final report.
 - b. The Central Valley Water Board recognizes that toxicity may be episodic and identification of causes and reduction of sources of toxicity may not be successful in all cases. The TRE may be ended at any stage if monitoring finds there is no longer toxicity.

VI. LAND DISCHARGE MONITORING REQUIREMENTS – NOT APPLICABLE

VII. RECYCLING MONITORING REQUIREMENTS – NOT APPLICABLE

VIII. RECEIVING WATER MONITORING REQUIREMENTS

A. Monitoring Locations RSW-001 and RSW-002

1. The Discharger shall monitor Laguna Creek at Monitoring Locations RSW-001 and RSW-002 when discharging to Laguna Creek as specified in Table D-4 and the testing requirements in section VIII.A.2. If there was no discharge to receiving water during the designated monitoring period, monitoring is not required during that period. If there is no upstream flow in the receiving water during the designated monitoring period, monitoring is not required at RSW-001 during that period. Whenever monitoring is not required, the Discharger shall state so in the monthly SMR.

Table D-4. Receiving Water Monitoring Requirements

Parameter	Units	Sample Type	Minimum Sampling Frequency
pH	standard units	Grab	2/Month
Dissolved Oxygen	mg/L	Grab	2/Month
Electrical Conductivity @ 25°C	µmhos/cm	Grab	1/Quarter
Hardness, Total (as CaCO ₃)	mg/L	Grab	1/Quarter
Temperature	°F	Grab	2/Month
Turbidity	NTU	Grab	2/Month
Dissolved Organic Carbon (DOC)	mg/L	Grab	1/Quarter

2. Table D-4 Testing Requirements. The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-4:
 - a. **Applicable to all parameters.** Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
 - b. **Grab Sample.** A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.

- c. **Field Meter.** A hand-held field meter may be used for pH, electrical conductivity, temperature, dissolved oxygen and turbidity, provided the meter utilizes a U.S. EPA-approved algorithm/method and is calibrated and maintained in accordance with the manufacturer's instructions. A calibration and maintenance log for each meter used for monitoring required by this Monitoring and Reporting Program shall be maintained at the Facility.
 - d. **Temperature, pH, Hardness, Dissolved Oxygen, and Dissolved Organic Carbon.** The effluent samples for temperature, pH, hardness, dissolved oxygen, and dissolved organic carbon shall be taken approximately the same time and on the same date with the receiving water samples for these parameters.
3. In conducting the receiving water sampling required by section VIII.A.1 above, a log shall be kept of the receiving water conditions throughout the reach bounded by Monitoring Locations RSW-001 and RSW-002. Attention shall be given to the presence or absence of:
- a. Floating or suspended matter;
 - b. Discoloration;
 - c. Bottom deposits;
 - d. Aquatic life;
 - e. Visible films, sheens, or coatings;
 - f. Fungi, slimes, or objectionable growths; and
 - g. Potential nuisance conditions.
- Notes on receiving water conditions shall be summarized in the monitoring report.

IX. OTHER MONITORING REQUIREMENTS

A. Biosolids – Not Applicable

B. Ponds – Not Applicable

C. Municipal Water Supply– Not Applicable

D. Filtration System and Ultraviolet Light (UV) Disinfection System

1. Monitoring Location FIL-001 and UVS-001

- a. The Discharger shall monitor the filtration system and UV disinfection system at Monitoring Locations FIL-001 and UVS-001 when discharging to Laguna Creek as specified in Table D-5 subsequent testing requirements.

Table D-5. Filtration and UV Disinfection System Monitoring Requirements

Parameter	Units	Sample Type	Monitoring Location	Sampling Frequency
Flow	MGD	Meter	UVS-001	Continuous
Turbidity	NTU	Meter	FIL-001	Continuous

Parameter	Units	Sample Type	Monitoring Location	Sampling Frequency
Flow	MGD	Meter	UVS-001	Continuous
Number of UV banks in operation	Number	Observation	--	Continuous
UV Transmittance	Percent	Meter	UVS-001	Continuous
UV Dose	mJ/cm ²	Calculate	--	Continuous
Total Coliform Organisms	MPN/100 mL	Grab	UVS-001	2/Week

2. Table D-5 Testing Requirements. The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-5:
 - a. Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. part 136 or by methods that have been approved by the Central Valley Water Board or the State Water Board.
 - b. For continuous analyzers, the Discharger shall report documented routine meter maintenance activities including date, time of day, and duration, in which the analyzer(s) is not in operation. If analyzer(s) fail to provide continuous monitoring for more than two hours and influent and/or effluent from the disinfection process is not diverted for retreatment, the Discharger shall obtain and report hourly manual and/or grab sample results.
 - c. Report daily average and maximum turbidity.
 - d. The Discharger shall not decrease power settings or reduce the number of UV lamp banks in operation while the continuous analyzers are out of service and water is being disinfected.
 - e. Report daily minimum number of UV banks in operation.
 - f. Report daily minimum hourly average UV transmittance. The minimum hourly average transmittance shall consist of lowest average transmittance recorded over an hour of a day when flow is being discharged. If the system does not operate for an entire hour interval on a given day or if effluent flow is not discharged for an entire hour, the transmittance will be averaged based on the actual operation time when discharges are occurring.
 - g. Report daily minimum hourly average UV dose. The minimum hourly average dose shall consist of lowest hourly average dose provided in any channel that had at least one bank of lamps operating during the hour interval. For channels that did not operate for the entire hour interval or when effluent flow is not discharged for the entire hour, the dose will be averaged based on the actual operation time when discharges occurred.

E. Pyrethroid Pesticides Monitoring

1. Monitoring Locations EFF-001 and RSW-002

- a. **Water Column Chemistry Monitoring Requirements.** The Discharger shall conduct effluent and receiving water baseline monitoring in accordance with Table D-6 as specified in this NOA. When discharging to Laguna Creek, **quarterly monitoring shall be conducted for one year between 1 July 2027 and 30 June 2028**, in the same quarters as the Effluent and Receiving Water Characterization Monitoring (section IX.F). The Discharger shall also submit a minimum of one quality assurance/quality control (QA/QC) sample during the year to be analyzed for the constituents listed in Table D-6.

The monitoring shall be conducted in the effluent at monitoring location EFF-001 and in the downstream receiving water at monitoring location RSW-002, and the results of such monitoring shall be submitted to the Central Valley Water Board with the quarterly self-monitoring reports. The Discharger shall use Environmental Laboratory Accreditation Program (ELAP)-accredited laboratories and methods validated by the Central Valley Water Board staff for pyrethroid pesticides water column chemistry monitoring. A current list of ELAP-approved laboratories and points of contact can be found on the Central Valley Water Board's Pyrethroid Pesticides TMDL and Basin Plan Amendment Webpage (https://www.waterboards.ca.gov/centralvalley/water_issues/tmdl/central_valley_projects/central_valley_pesticides/pyrethroid_tmdl_bpa/index.html).

Monitoring can either be conducted by the Discharger or can be done as part of a group monitoring effort. If the Discharger chooses to participate in a group monitoring effort, the timing and the other study requirements of the monitoring can be modified by the Executive Officer.

Table D-6. Pyrethroid Pesticides Monitoring

Parameter	CAS Number	Sample Units	Sample Type	Analytical Method	Reporting Level
Total Bifenthrin	82657-04-3	ng/L	Grab	See table note 1	1.3
Total Cyfluthrin	68359-37-5	ng/L	Grab	See table note 1	1.3
Total Cypermethrin	52315-07-8	ng/L	Grab	See table note 1	1.7
Total Esfenvalerate	51630-58-1	ng/L	Grab	See table note 1	3.3
Total Lambda-cyhalothrin	91465-08-6	ng/L	Grab	See table note 1	1.2
Total Permethrin	52645-53-1	ng/L	Grab	See table note 1	10

Parameter	CAS Number	Sample Units	Sample Type	Analytical Method	Reporting Level
Freely Dissolved Bifenthrin	82657-04-3	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Cyfluthrin	68359-37-5	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Cypermethrin	52315-07-8	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Esfenvalerate	51630-58-1	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Lambda-cyhalothrin	91465-08-6	ng/L	Calculated	Calculated from total concentration	--
Freely Dissolved Permethrin	52645-53-1	ng/L	Calculated	Calculated from total concentration	--
Dissolved Organic Carbon (DOC)	--	mg/L	Grab	--	--
Total Organic Carbon (TOC)	--	mg/L	Grab	--	--

Table D-6 Requirements:

1. The Discharger shall use ELAP-accredited laboratories and methods validated by Central Valley Water Board staff for pyrethroid pesticides water column chemistry monitoring. A current list of ELAP-approved laboratories and points of contact can be found on the Central Valley Water Board’s Pyrethroid Pesticides TMDL and Basin Plan Amendment Webpage:
 (https://www.waterboards.ca.gov/centralvalley/water_issues/tmdl/central_valley_projects/central_valley_pesticides/pyrethroid_tmdl_bpa/index.html).

The freely dissolved concentration of each quantified pyrethroid pesticide in a sample may be directly measured or estimated using partition coefficients. Methods for direct measurement must be approved by the Executive Officer before they are used to determine the freely dissolved pyrethroid concentrations that are used for determining exceedances of the pyrethroid pesticides numeric triggers in Table 4-2 of the Basin Plan.

To estimate the freely dissolved concentration of a pyrethroid pesticide with partition coefficients, the following equation shall be used:

$$C_{dissolved} = \frac{C_{total}}{1 + (K_{OC} \times [POC]) + (K_{DOC} \times [DOC])}$$

Where:

$C_{dissolved}$ = concentration of an individual pyrethroid pesticide that is in the freely dissolved phase (ng/L),

C_{total} = total concentration of an individual pyrethroid pesticide in water (ng/L),

K_{OC} = organic carbon-water partition coefficient for the individual pyrethroid pesticide (L/kg),

[POC] = concentration of particulate organic carbon in the water sample (kg/L), which can be calculated as [POC]=[TOC]-[DOC],

[TOC] = total organic carbon in the sample (kg/L).

K_{DOC} = dissolved organic carbon-water partition coefficient (L/kg),

[DOC] = concentration of dissolved organic carbon in the sample (kg/L).

Site-specific or alternative study-based partition coefficients approved by the Executive Officer may be used for K_{OC} and K_{DOC} in the above equation. If site-specific or alternative study-based partition coefficients are not available or have not been approved, the following partition coefficients (Table D-7 below) shall be used for K_{OC} and K_{DOC} in the above equation:

Table D-7. Pyrethroid Pesticide Partition Coefficients

Pyrethroid Pesticide	Receiving water K_{OC} , (L/kg)	Receiving water K_{DOC} , (L/kg)	Effluent K_{OC} , (L/kg)	Effluent K_{DOC} , (L/kg)
Bifenthrin	4,228,000	1,737,127	15,848,932	800,000
Cyfluthrin	3,870,000	2,432,071	3,870,000	2,432,071
Cypermethrin	3,105,000	762,765	6,309,573	200,000
Esfenvalerate	7,220,000	1,733,158	7,220,000	1,733,158
Lambda-cyhalothrin	2,056,000	952,809	7,126,428	200,000
Permethrin	6,075,000	957,703	10,000,000	200,000

- b. **Water Column Toxicity Monitoring Requirements.** When discharging to the receiving water, the Discharger shall monitor the acute toxicity to *Hyalella azteca* of the downstream receiving water using U.S. EPA method EPA-821-R-02-012 (*Methods for Measuring the Acute Toxicity of Effluents and Receiving Waters to Freshwater and Marine Organisms*, Fifth Edition, USEPA, October 2002, or most recent edition).

Except as specified in this NOA, water column toxicity testing shall follow the measurement quality objectives provided in the Surface Water Ambient Monitoring Program Quality Assurance Program Plan (SWRCB, 2018). When feasible, the Discharger shall use the Southern California Coastal Water Research Project (SCCWRP) guidance (Schiff and Greenstein, 2016) on test organism age and size for *Hyalella azteca*. Consistent with U.S. EPA Method

EPA-821-R-02-012 and ELAP accreditation, *Hyalella azteca* water column toxicity testing for baseline monitoring shall be performed at 20 degrees Celsius.

When discharging to Laguna Creek, the receiving water, **Water Column Toxicity Monitoring shall be conducted quarterly for one year between 1 July 2027 and 30 June 2028**, in the same quarters as the Effluent and Receiving Water Characterization Monitoring and the Pyrethroid Pesticides Water Column Chemistry Monitoring. Downstream receiving water monitoring shall be conducted at monitoring location RSW-002 when discharging to the receiving water and the results of such monitoring shall be submitted to the Central Valley Water Board with the quarterly self-monitoring reports. Monitoring can either be conducted by the Discharger or can be done as part of a group monitoring effort. If the Discharger chooses to participate in a group monitoring effort, the timing of the monitoring can be modified by the Executive Officer.

- c. **Exceedance of Numeric Triggers.** If the Pyrethroid Pesticides Water Column Chemistry Monitoring results at Monitoring Location EFF-001 identifies an exceedance of any pyrethroid pesticides numeric trigger, the Discharger shall notify the Central Valley Water Board in writing of the exceedance and the Discharger's intent to submit a Pyrethroid Management Plan. Monitoring results should be reviewed quarterly, and the Discharger shall notify the Central Valley Water Board of any exceedances of the Pyrethroid numeric triggers as soon as possible. The Pyrethroid Management Plan, as outlined in section VII.C.3.c of the 2023 Municipal General Order, shall be submitted to the Central Valley Water Board within one year from the date that an exceedance is identified by either the Discharger or Central Valley Water Board staff. Pyrethroid concentrations at Monitoring Location EFF-001 that exceed the acute and/or chronic pyrethroid numeric triggers, as outlined in Table 4-2 of the Basin Plan, constitute an exceedance of a numeric trigger. In the absence of a pyrethroid numeric trigger exceedance, observed toxicity in the water column does not constitute a violation of the pyrethroid conditional prohibition.

Identification of an exceedance provides the information that the Pyrethroid Pesticides Water Column Chemistry Monitoring was designed to collect, per Chapter V of the Basin Plan; therefore, once an exceedance is identified, the Discharger may cease conducting subsequent Pyrethroid Pesticides Water Column Chemistry Monitoring.

F. Effluent Characterization and Receiving Water Characterization

The Discharger shall monitor the effluent at Monitoring Location EFF-001 and receiving water at Monitoring Location RSW-001 for the constituents listed in Table D-8, as described in this section.

1. Monitoring Frequency

- a. **Effluent Sampling.** Samples shall be collected from the effluent (Monitoring Location EFF-001) quarterly between **1 July 2027 and 30**

June 2028. If there was no discharge to Laguna Creek during the designated quarter, monitoring is not required for that quarter and the Discharger shall so state in the quarterly SMR.

- b. **Receiving Water Sampling.** Samples shall be collected from the upstream receiving water (Monitoring Location RSW-001) quarterly between **1 July 2027 and 30 June 2028.** If there was no discharge to Laguna Creek during the designated quarter, monitoring is not required for that quarter, and the Discharger shall so state in the quarterly SMR.

All sampling shall be analyzed for the constituents listed in Table D-8, below. The results of such monitoring shall be submitted to the Central Valley Water Board with the quarterly SMRs. Each individual monitoring event shall provide representative sample results for the effluent.

2. **Sample Type.** Effluent samples shall be taken as described in Table D-8, below and the testing requirements in section IX.E.5, below.
3. **Analytical Methods Report Certification.** Prior to beginning the Effluent and Receiving Water Characterization monitoring, the Discharger shall provide a certification acknowledging the scheduled start date of the Effluent and Receiving Water Characterization monitoring and confirming that samples will be collected and analyzed as described in the previously submitted Analytical Methods Report. If there are changes to the previously submitted Analytical Methods Report, the Discharger shall outline those changes. A one-page certification form will be provided by the Central Valley Water Board staff with this NOA that the Discharger can use to satisfy this requirement. The certification form shall be submitted electronically via CIWQS in accordance with the reporting requirements in Table D-10, Technical Reports.

**Table D-8. Effluent and Receiving Water Characterization Monitoring
 VOLATILE ORGANICS**

CTR Number	Volatile Organic Parameters	CAS Number	Units	Effluent Sample Type
25	2-Chloroethyl vinyl Ether	110-75-8	µg/L	Grab
17	Acrolein	107-02-8	µg/L	Grab
18	Acrylonitrile	107-13-1	µg/L	Grab
19	Benzene	71-43-2	µg/L	Grab
20	Bromoform	75-25-2	µg/L	Grab
21	Carbon Tetrachloride	56-23-5	µg/L	Grab
22	Chlorobenzene	108-90-7	µg/L	Grab
24	Chloroethane	75-00-3	µg/L	Grab
26	Chloroform	67-66-3	µg/L	Grab
35	Methyl Chloride	74-87-3	µg/L	Grab
23	Dibromochloromethane	124-48-1	µg/L	Grab
27	Dichlorobromomethane	75-27-4	µg/L	Grab
36	Methylene Chloride	75-09-2	µg/L	Grab
33	Ethylbenzene	100-41-4	µg/L	Grab
89	Hexachlorobutadiene	87-68-3	µg/L	Grab

CTR Number	Volatile Organic Parameters	CAS Number	Units	Effluent Sample Type
34	Methyl Bromide (Bromomethane)	74-83-9	µg/L	Grab
94	Naphthalene	91-20-3	µg/L	Grab
38	Tetrachloroethylene (PCE)	127-18-4	µg/L	Grab
39	Toluene	108-88-3	µg/L	Grab
40	trans-1,2-Dichloroethylene	156-60-5	µg/L	Grab
43	Trichloroethylene (TCE)	79-01-6	µg/L	Grab
44	Vinyl Chloride	75-01-4	µg/L	Grab
21	Methyl-tert-butyl ether (MTBE)	1634-04-4	µg/L	Grab
41	1,1,1-Trichloroethane	71-55-6	µg/L	Grab
42	1,1,2-Trichloroethane	79-00-5	µg/L	Grab
28	1,1-Dichloroethane	75-34-3	µg/L	Grab
30	1,1-Dichloroethylene (DCE)	75-35-4	µg/L	Grab
31	1,2-Dichloropropane	78-87-5	µg/L	Grab
32	1,3-Dichloropropylene	542-75-6	µg/L	Grab
37	1,1,2,2-Tetrachloroethane	79-34-5	µg/L	Grab
101	1,2,4-Trichlorobenzene	120-82-1	µg/L	Grab
29	1,2-Dichloroethane	107-06-2	µg/L	Grab
75	1,2-Dichlorobenzene	95-50-1	µg/L	Grab
76	1,3-Dichlorobenzene	541-73-1	µg/L	Grab
77	1,4-Dichlorobenzene	106-46-7	µg/L	Grab

SEMI-VOLATILE ORGANICS

CTR Number	Semi-Organic Volatile Parameters	CAS Number	Units	Effluent Sample Type
60	Benzo(a)Anthracene	56-55-3	µg/L	Grab
85	1,2-Diphenylhydrazine	122-66-7	µg/L	Grab
45	2-Chlorophenol	95-57-8	µg/L	Grab
46	2,4-Dichlorophenol	120-83-2	µg/L	Grab
47	2,4-Dimethylphenol	105-67-9	µg/L	Grab
49	2,4-Dinitrophenol	51-28-5	µg/L	Grab
82	2,4-Dinitrotoluene	121-14-2	µg/L	Grab
55	2,4,6-Trichlorophenol	88-06-2	µg/L	Grab
83	2,6-Dinitrotoluene	606-20-2	µg/L	Grab
50	2-Nitrophenol	88-75-5	µg/L	Grab
71	2-Chloronaphthalene	91-58-7	µg/L	Grab
78	3,3-Dichlorobenzidine	91-94-1	µg/L	Grab
62	Benzo(b)Fluoranthene	205-99-2	µg/L	Grab
52	4-Chloro-3-methylphenol	59-50-7	µg/L	Grab
48	2-Methyl-4,6-Dinitrophenol	534-52-1	µg/L	Grab
51	4-Nitrophenol	100-02-7	µg/L	Grab
69	4-Bromophenyl Phenyl Ether	101-55-3	µg/L	Grab

CTR Number	Semi-Organic Volatile Parameters	CAS Number	Units	Effluent Sample Type
72	4-Chlorophenyl Phenyl Ether	7005-72-3	µg/L	Grab
56	Acenaphthene	83-32-9	µg/L	Grab
57	Acenaphthylene	208-96-8	µg/L	Grab
58	Anthracene	120-12-7	µg/L	Grab
59	Benzidine	92-87-5	µg/L	Grab
61	Benzo(a)Pyrene	50-32-8	µg/L	Grab
63	Benzo(ghi)Perylene	191-24-2	µg/L	Grab
64	Benzo(k)Fluoranthene	207-08-9	µg/L	Grab
65	Bis (2-Chloroethoxy) Methane	111-91-1	µg/L	Grab
66	Bis (2-Chloroethyl) Ether	111-44-4	µg/L	Grab
67	Bis (2-Chloroisopropyl) Ether	108-60-1	µg/L	Grab
68	Bis(2-Ethylhexyl) Phthalate	117-81-7	µg/L	Grab
70	Butylbenzyl Phthalate	85-68-7	µg/L	Grab
73	Chrysene	218-01-9	µg/L	Grab
81	Di-n-butyl Phthalate	84-74-2	µg/L	Grab
84	Di-n-Octyl Phthalate	117-84-0	µg/L	Grab
74	Dibenzo(a,h)anthracene	53-70-3	µg/L	Grab
79	Diethyl Phthalate	84-66-2	µg/L	Grab
80	Dimethyl Phthalate	131-11-3	µg/L	Grab
86	Fluoranthene	206-44-0	µg/L	Grab
87	Fluorene	86-73-7	µg/L	Grab
88	Hexachlorobenzene	118-74-1	µg/L	Grab
90	Hexachlorocyclopentadiene	77-47-4	µg/L	Grab
91	Hexachloroethane	67-72-1	µg/L	Grab
92	Indeno(1,2,3-cd) Pyrene	193-39-5	µg/L	Grab
93	Isophorone	78-59-1	µg/L	Grab
98	N-Nitrosodiphenylamine	86-30-6	µg/L	Grab
96	N-Nitrosodimethylamine	62-75-9	µg/L	Grab
97	N-Nitrosodi-n-Propylamine	621-64-7	µg/L	Grab
95	Nitrobenzene	98-95-3	µg/L	Grab
53	Pentachlorophenol (PCP)	87-86-5	µg/L	Grab
99	Phenanthrene	85-01-8	µg/L	Grab
54	Phenol	108-95-2	µg/L	Grab
100	Pyrene	129-00-0	µg/L	Grab

INORGANICS

CTR Number	Inorganic Parameters	CAS Number	Units	Effluent Sample Type
NL	Aluminum	7429-90-5	µg/L	24-hour Composite
1	Antimony, Total	7440-36-0	µg/L	24-hour Composite
2	Arsenic, Total	7440-38-2	µg/L	24-hour Composite
15	Asbestos	1332-21-4	µg/L	24-hour Composite
3	Beryllium, Total	7440-41-7	µg/L	24-hour Composite

CTR Number	Inorganic Parameters	CAS Number	Units	Effluent Sample Type
4	Cadmium, Total	7440-43-9	µg/L	24-hour Composite
5a	Chromium, Total	7440-47-3	µg/L	24-hour Composite
6	Copper, Total	7440-50-8	µg/L	24-hour Composite
14	Iron, Total	7439-89-6	µg/L	24-hour Composite
7	Lead, Total	7439-92-1	µg/L	24-hour Composite
8	Mercury, Total	7439-97-6	µg/L	Grab
NL	Mercury, Methyl	22967-92-6	µg/L	Grab
NL	Manganese, Total	7439-96-5	µg/L	24-hour Composite
9	Nickel, Total	7440-02-0	µg/L	24-hour Composite
10	Selenium, Total	7782-49-2	µg/L	24-hour Composite
11	Silver, Total	7440-22-4	µg/L	24-hour Composite
12	Thallium, Total	7440-28-0	µg/L	24-hour Composite
13	Zinc, Total	7440-66-6	µg/L	24-hour Composite

NON-METALS/MINERALS

CTR Number	Non-Metal/Mineral Parameters	CAS Number	Units	Effluent Sample Type
NL	Boron	7440-42-8	µg/L	24-hour Composite
NL	Chloride	16887-00-6	mg/L	24-hour Composite
14	Cyanide, Total (as CN)	57-12-5	µg/L	Grab
NL	Sulfate	14808-79-8	mg/L	24-hour Composite
NL	Sulfide (as S)	5651-88-7	mg/L	24-hour Composite

PESTICIDES/PCBs/DIOXINS

CTR Number	Pesticide/PCB/Dioxin Parameters	CAS Number	Units	Effluent Sample Type
110	4,4-DDD	72-54-8	µg/L	24-hour Composite
109	4,4-DDE	72-55-9	µg/L	24-hour Composite
108	4,4-DDT	50-29-3	µg/L	24-hour Composite
112	alpha-Endosulfan	959-98-8	µg/L	24-hour Composite
103	alpha-BHC (Benzene hexachloride)	319-84-6	µg/L	24-hour Composite
102	Aldrin	309-00-2	µg/L	24-hour Composite
113	beta-Endosulfan	33213-65-9	µg/L	24-hour Composite
104	beta-BHC (Benzene hexachloride)	319-85-7	µg/L	24-hour Composite
107	Chlordane	57-74-9	µg/L	24-hour Composite

CTR Number	Pesticide/PCB/Dioxin Parameters	CAS Number	Units	Effluent Sample Type
106	delta-BHC (Benzene hexachloride)	319-86-8	µg/L	24-hour Composite
111	Dieldrin	60-57-1	µg/L	24-hour Composite
114	Endosulfan Sulfate	1031-07-8	µg/L	24-hour Composite
115	Endrin	72-20-8	µg/L	24-hour Composite
116	Endrin Aldehyde	7421-93-4	µg/L	24-hour Composite
117	Heptachlor	76-44-8	µg/L	24-hour Composite
118	Heptachlor Epoxide	1024-57-3	µg/L	24-hour Composite
105	gamma-BHC (Benzene hexachloride or Lindane)	58-89-9	µg/L	24-hour Composite
119	Polychlorinated Biphenyl (PCB) 1016	12674-11-2	µg/L	24-hour Composite
120	PCB 1221	11104-28-2	µg/L	24-hour Composite
121	PCB 1232	11141-16-5	µg/L	24-hour Composite
122	PCB 1242	53469-21-9	µg/L	24-hour Composite
123	PCB 1248	12672-29-6	µg/L	24-hour Composite
124	PCB 1254	11097-69-1	µg/L	24-hour Composite
125	PCB 1260	11096-82-5	µg/L	24-hour Composite
126	Toxaphene	8001-35-2	µg/L	24-hour Composite
16	2,3,7,8-TCDD (Dioxin)	1746-01-6	mg/L	24-hour Composite

CONVENTIONAL PARAMETERS

CTR Number	Conventional Parameters	CAS Number	Units	Effluent Sample Type
NL	pH	--	SU	Grab
NL	Temperature	--	°C	Grab

NON-CONVENTIONAL PARAMETERS

CTR Number	Nonconventional Parameters	CAS Number	Units	Effluent Sample Type
NL	Foaming Agents (MBAS)	MBAS	mg/L	24-hour Composite
NL	Hardness (as CaCO ₃)	471-34-1	mg/L	Grab
NL	Specific Conductance (Electrical Conductivity or EC)	EC	µmhos /cm	24-hour Composite
NL	Total Dissolved Solids (TDS)	TDS	mg/L	24-hour Composite
NL	Dissolved Organic Carbon (DOC)	DOC	mg/L	24-hour Composite

NUTRIENTS

CTR Number	Nutrient Parameters	CAS Number	Units	Effluent Sample Type
NL	Ammonia (as N)	7664-41-7	mg/L	24-hour Composite
NL	Nitrate (as N)	14797-55-8	mg/L	24-hour Composite
NL	Nitrite (as N)	14797-65-0	mg/L	24-hour Composite
NL	Phosphorus, Total (as P)	7723-14-0	mg/L	24-hour Composite

5. **Table D-8 Testing Requirements.** The Discharger shall comply with the following testing requirements when monitoring for the parameters described in Table D-8:
- a. **Applicable to All Parameters.** Pollutants shall be analyzed using the analytical methods described in 40 C.F.R. Part 136 or by methods approved by the Central Valley Water Board or the State Water Board.
 - b. **Grab Sample.** A grab sample is defined as an individual discrete sample collected over a period of time not exceeding 15 minutes. It can be taken manually, using a pump, scoop, vacuum, or other suitable device.
 - c. **Composite Sample.** All composite samples shall be collected from a 24-hour flow proportional composite.
 - d. **Redundant Sampling.** The Discharger is not required to conduct effluent monitoring for constituents that have already been sampled in a given month, as required in Table D-8, except for dissolved organic carbon, hardness, pH, and temperature, which shall be conducted concurrently with the characterization sampling.
 - e. **Concurrent Sampling.** The Discharger is not required to conduct effluent monitoring for constituents that have already been sampled in a given month, as required in Table D-8, except for hardness, pH, and temperature, which shall be conducted concurrently with the effluent sampling.
 - f. **Sample Type.** All receiving water samples shall be taken as grab samples. Effluent samples shall be taken as described in Table D-8.

- g. **Bis (2-ethylhexyl) phthalate.** In order to verify if bis (2-ethylhexyl) phthalate is truly present in the effluent discharge, the Discharger shall take steps to assure that sample containers, sampling apparatus, and analytical equipment are not sources of the detected contaminant.
- h. **Total Mercury and Methylmercury.** Samples for total mercury and methylmercury shall be taken using clean hands/dirty hands procedures, as described in U.S. EPA method 1669: Sampling Ambient Water for Trace Metals at EPA Water Quality Criteria Levels, for collection of equipment blanks (section 9.4.4.2), and shall be analyzed by U.S. EPA method 1630/1631 (Revision E) with a reporting limit of 0.05 ng/L for methylmercury and 0.5 nanograms per liter (ng/L) for total mercury.
- i. **TCDD-Dioxin Congener Equivalents** shall include all 17 of the 2,3,7,8 TCDD dioxin congeners as listed in section 3 of the SIP.
- j. **Ammonia (as N).** Sampling is only required in the upstream receiving water.
- k. **Chlorpyrifos and Diazinon** shall be sampled once in the effluent only using U.S. EPA Method 625M, Method 8141, or equivalent GC/MS method with a lower reporting limit (RL) than the Basin Plan Water Quality Objectives of 0.015 µg/L and 0.1 µg/L for chlorpyrifos and diazinon, respectively.
- l. **Aluminum.** Aluminum can be tested by using either total or acid-soluble (inductively coupled plasma/atomic emission spectrometry or inductively coupled plasma/mass spectrometry) analysis methods, as supported by U.S. EPA's Ambient Water Quality Criteria for Aluminum document (EPA 440/5-86-008), or other methods that exclude aluminum silicate particles as approved by the Executive Officer for comparison with the 2018 U.S. EPA NAWQC for protection of freshwater aquatic life criterion aquatic life criteria. For comparison to the Secondary MCL, aluminum samples may be passed through a 1.5-micron filter.
- m. **Iron and Manganese.** Iron and manganese samples may be passed through a 1.5-micron filter for comparison with the Secondary MCL.
- n. **Other Constituents of Concern.** Monitoring for parameters under the "Other Constituents of Concern" is only required if the discharge is within the legal boundaries of the Sacramento- San Joaquin Delta, or as specified in the Notice of Applicability.

X. REPORTING REQUIREMENTS

A. General Monitoring and Reporting Requirements

1. The Discharger shall comply with all Standard Provisions (Attachment D of the Municipal General Order) related to monitoring, reporting, and recordkeeping. Upon written request of the Central Valley Water Board, the Discharger shall submit a summary monitoring report. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year(s)

2. Upon written request of the Central Valley Water Board, the Discharger shall submit a summary monitoring report. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous year(s).
3. **Compliance Time Schedules - Not Applicable.**
4. The Discharger shall report to the Central Valley Water Board any toxic chemical release data it reports to the State Emergency Response Commission within 15 days of reporting the data to the Commission pursuant to section 313 of the "Emergency Planning and Community Right to Know Act" of 1986.
5. Monitoring frequencies may be adjusted by the Executive Officer to a less frequent basis if a Discharger makes a request and the request is backed by statistical trends of monitoring data submitted.

B. Self-Monitoring Reports

1. The Discharger shall electronically submit SMRs using the State Water Board's California Integrated Water Quality System (CIWQS) Program website (www.waterboards.ca.gov/ciwqs/index.html). The CIWQS website will provide additional information for SMR submittal in the event there will be a planned service interruption for electronic submittal.
2. The Discharger shall report in the SMR the results for all monitoring specified in this MRP under sections III through IX. The Discharger shall submit monthly SMRs including the results of all required monitoring using U.S. EPA-approved test methods or other test methods specified in this MRP. SMRs are to include all new monitoring results obtained since the last SMR was submitted. If the Discharger monitors any pollutant more frequently than required by this MRP, the results of this monitoring shall be included in the calculations and reporting of the data submitted in the SMR.
3. Monitoring periods and reporting for all required monitoring shall begin on 1 July 2027 and be completed according to the following:

Table D-9. Monitoring Periods and Reporting Schedule

Sampling Frequency	Monitoring Period	SMR Due Date
Continuous	All	Submit with monthly SMR
1/Day	(Midnight through 11:59 PM) or any 24-hour period that reasonably represents a calendar day for purposes of sampling.	Submit with monthly SMR
1/Week	Sunday through Saturday	Submit with monthly SMR
2/Week	Sunday through Saturday	Submit with monthly SMR

Sampling Frequency	Monitoring Period	SMR Due Date
1/Month	1st day of calendar month through last day of calendar month	First day of second calendar month following month of sampling
1/Quarter	1 January through 31 March; 1 April through 30 June; 1 July through 30 September; 1 October through 31 December	1 May; 1 August; 1 November; 1 February of following year (respectively)
1/Year	1 January through 31 December	1 February of following year

4. **Reporting Protocols.** The Discharger shall report with each sample result the applicable Reporting Level (RL) and the current laboratory’s Method Detection Limit (MDL), as determined by the procedure in 40 C.F.R. part 136.

The Discharger shall report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:

- a. Sample results greater than or equal to the RL shall be reported as measured by the laboratory (i.e., the measured chemical concentration in the sample).
- b. Sample results less than the RL, but greater than or equal to the laboratory’s MDL, shall be reported as “Detected, but Not Quantified,” or DNQ. The estimated chemical concentration of the sample shall also be reported.

For the purposes of data collection, the laboratory shall write the estimated chemical concentration next to DNQ. The laboratory may, if such information is available, include numerical estimates of the data quality for the reported result. Numerical estimates of data quality may be percent accuracy (\pm a percentage of the reported value), numerical ranges (low to high), or any other means considered appropriate by the laboratory.

- c. Sample results less than the laboratory’s MDL shall be reported as “Not Detected,” or ND.
- d. Dischargers are to instruct laboratories to establish calibration standards so that the ML value (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the Discharger to use analytical data derived from extrapolation beyond the lowest point of the calibration curve.

5. **Multiple Sample Data.** When determining compliance with an AMEL, AWEL, or maximum daily effluent limitation (MDEL) for priority pollutants and more

- than one sample result is available, the Discharger shall compute the arithmetic mean unless the data set contains one or more reported determinations of “Detected, but Not Quantified” (DNQ) or “Not Detected” (ND). In those cases, the Discharger shall compute the median in place of the arithmetic mean in accordance with the following procedure:
- a. The data set shall be ranked from low to high, ranking the reported ND determinations lowest, DNQ determinations next, followed by quantified values (if any). The order of the individual ND or DNQ determinations is unimportant.
 - b. The median value of the data set shall be determined. If the data set has an odd number of data points, then the median is the middle value. If the data set has an even number of data points, then the median is the average of the two values around the middle unless one or both of the points are ND or DNQ, in which case the median value shall be the lower of the two data points where DNQ is lower than a value and ND is lower than DNQ.
6. The Discharger shall submit SMRs in accordance with the following requirements:
- a. The Discharger shall arrange all reported data in a tabular format. The data shall be summarized to clearly illustrate whether the facility is operating in compliance with interim and/or final effluent limitations. The Discharger is not required to duplicate the submittal of data that is entered in a tabular format within CIWQS. When electronic submittal of data are required and CIWQS does not provide for entry into a tabular format within the system, the Discharger shall electronically submit the data in a tabular format as an attachment.
 - b. The Discharger shall attach a cover letter to the SMR. The information contained in the cover letter shall clearly identify violations of the waste discharge requirements; discuss corrective actions taken or planned; and the proposed time schedule for corrective actions. Identified violations must include a description of the requirement that was violated and a description of the violation. The cover letter must be uploaded directly into CIWQS and violations must be entered into CIWQS under the Violations tab for the reporting period in which the violation occurred in addition to them being identified in the cover letter.
 - c. The Discharger shall attach final laboratory reports for all contracted, commercial laboratories, including quality assurance/quality control information, with all its SMRs for which sample analyses were performed. Bench sheets are not required but should be available upon request by Regional Board staff.
7. The Discharger shall submit in the SMRs calculations and reports in accordance with the following requirements.

- a. **Calendar Annual Average Limitations** – For Dischargers subject to effluent limitations specified as “calendar annual average” (e.g., electrical conductivity), the Discharger shall report the calendar annual average in the December SMR. The annual average shall be calculated as the average of the samples gathered for the calendar year.
- b. **Mass Loading Limitations – Not Applicable**
- c. **Removal Efficiency (BOD₅ and TSS).** – The Discharger shall calculate and report the percent removal of BOD₅ and TSS in the SMRs. The percent removal shall be calculated as specified in section VIII.A of the Limitations and Discharge Requirements in the Municipal General Order.
- d. **Total Coliform Organisms Effluent Limitations.** The Discharger shall calculate and report the 7-day median of total coliform organisms for the effluent. The 7-day median of total coliform organisms shall be calculated as specified in section VIII.F of the Limitations and Discharge Requirements in the Municipal General Order.
- e. **Dissolved Oxygen Receiving Water Limitations.** The Discharger shall report monthly in the SMR the dissolved oxygen concentrations in the receiving water (Monitoring Locations RSW-001 and RSW 002).
- f. **Turbidity Receiving Water Limitations.** The Discharger shall calculate and report the turbidity increase in the receiving water applicable to the natural turbidity condition specified in section VI.A.18.a, of the Limitations and Discharge Requirements in the Municipal General Order.
- g. **Temperature Effluent Limitation – Not Applicable.**
- h. **Temperature Receiving Water Limitations.** The Discharger shall calculate and report the temperature increase in the receiving water based on the difference in temperature at Monitoring Locations RSW-001 and RSW-002.
- i. **Chlorpyrifos and Diazinon Effluent Limitations** –Each Discharger subject to effluent limitations for diazinon and chlorpyrifos in section V.A.1.c.xii of the Municipal General Order shall calculate and report the value of S_{AMEL} and S_{AWEL} for the effluent, using the equation in section V.A.1.c.xii and consistent with the Compliance Determination Language in section VIII.L of the Limitations and Discharge Requirements in the Municipal General Order.
- j. **Total Calendar Annual Mass Loading Mercury Effluent Limitations – Not Applicable.**

C. Discharge Monitoring Reports (DMRs)

1. The Discharger shall electronically submit DMRs together with SMRs using Electronic Self-Monitoring Reports module eSMR 2.5 or any upgraded version. Electronic submittal of DMRs will be in addition to electronic submittal of SMRs. Information about electronic submittal of DMRs is provided by the

Discharge Monitoring Report website:
(www.waterboards.ca.gov/water_issues/programs/discharge_monitoring/).

D. Other Reports

1. **Special Study Reports.** Special study reports required by section VIII.C, Provisions, in this NOA shall be submitted in accordance with the reporting requirements in Table D-10, Technical Reports, below.
2. **Analytical Methods Report.** The Discharger shall complete and submit an Analytical Methods Report, electronically via CIWQS submittal, by the due date specified in Table D-8 below. The Analytical Methods Report shall include the following for each constituent listed in tables D-2, D-3, D-4, D-5 and D-6 of this NOA: 1) applicable water quality objective, 2) reporting level (RL), 3) method detection limit (MDL), and 4) analytical method. The analytical methods shall be sufficiently sensitive with RLs consistent with the SSM Rule (see Attachment E, section I.F of the Municipal General Order), and with the Minimum Levels (MLs) in the SIP, Appendix 4. The “Reporting Level or RL” is synonymous with the “Method Minimum Level” described in the SSM Rule. If an RL is greater than the applicable water quality objective for a constituent, the Discharger shall explain how the proposed analytical method complies with the SSM Rule. Central Valley Water Board staff will provide a tool with this NOA to assist the Discharger in completing this requirement. The tool will include the constituents and associated applicable water quality objectives to be included in the Analytical Methods Report.
3. **Annual Operations Report.** The Discharger shall submit in accordance with the reporting requirements in Table D-10, Technical Reports, a written report containing the following:
 - a. The names, certificate grades, and general responsibilities of all persons employed at the Facility.
 - b. The names and telephone numbers of persons to contact regarding the plant for emergency and routine situations.
 - c. A statement certifying when the flow meter(s) and other monitoring instruments and devices were last calibrated, including identification of who performed the calibration.
 - d. A statement certifying whether the current operation and maintenance manual, and contingency plan, reflect the wastewater treatment plant as currently constructed and operated, and the dates when these documents were last revised and last reviewed for adequacy.
 - e. The Discharger may also be requested to submit an annual report to the Central Valley Water Board with both tabular and graphical summaries of the monitoring data obtained during the previous year. Any such request shall be made in writing. The report shall discuss the compliance record. If violations have occurred, the report shall also discuss the corrective actions taken and planned to bring the discharge into full compliance with the waste discharge requirements.

4. Annual Pretreatment Reporting Requirements. Not Applicable

5. Recycled Water Policy Annual Reports. In accordance with section 3 of the Water Quality Control Policy for Recycled Water (Recycled Water Policy) and as specified in this NOA, the Discharger shall electronically submit an annual report of monthly data to the State Water Board by 30 April annually covering the previous calendar year using the State Water Board’s GeoTracker website (<https://geotracker.waterboards.ca.gov/>). Information regarding creating an account and using the GeoTracker – Electronic Submittal of Information (ESI) system can be found on the State Water Board’s website for Electronic Submittal of Information (https://www.waterboards.ca.gov/ust/electronic_submittal/index.html).

The annual report to GeoTracker must include volumetric reporting of the items listed in section 3.2 of the Recycled Water Policy (https://www.waterboards.ca.gov/board_decisions/adopted_orders/resolutions/2018/121118_7_final_amendment_oal.pdf). A PDF of the upload confirmation from GeoTracker for the Recycled Water Policy Annual Report shall be uploaded into CIWQS to demonstrate compliance with this reporting requirement.

6. Technical Report Submittals. The Municipal General Order, as specified in this NOA, includes requirements to submit various reports and documents that may include, a Notice of Intent, special study technical reports, progress reports, and other reports identified in the MRP (hereafter referred to collectively as “technical reports”). The Technical Reports Table D-10 below summarizes the technical reports that are applicable to this discharge and required by this NOA, and the due dates for each submittal. All technical reports shall be submitted electronically via CIWQS submittal. Technical reports should be uploaded as a PDF, Microsoft Word, or Microsoft Excel file attachment.

Table D-10. Technical Reports

Report #	Technical Report	Due Date	CIWQS Report Name
1	Notice of Intent	31 May 2030	NOI
2	Analytical Methods Report	1 September 2026	MRP X.D.2
3	Analytical Methods Report Certification	1 March 2027	MRP IX.E.4
4	Annual Operations Report #1	30 January 2027	MRP X.D.3
5	Annual Operations Report #2	30 January 2028	MRP X.D.3
6	Annual Operations Report #3	30 January 2029	MRP X.D.3
7	Annual Operations Report #4	30 January 2030	MRP X.D.3

Report #	Technical Report	Due Date	CIWQS Report Name
8	Annual Operations Report #5	30 January 2031	MRP X.D.3
9	Recycled Water Policy Annual Report Submittal Confirmation #1	30 April 2027	MRP X.D.5
10	Recycled Water Policy Annual Report Submittal Confirmation #2	30 April 2028	MRP X.D.5
11	Recycled Water Policy Annual Report Submittal Confirmation #3	30 April 2029	MRP X.D.5
12	Recycled Water Policy Annual Report Submittal Confirmation #4	30 April 2030	MRP X.D.5
13	Recycled Water Policy Annual Report Submittal Confirmation #5	30 April 2031	MRP X.D.5
14	Update on Effectiveness of Salinity Evaluation and Minimization Plan	31 May 2030	NOI_VIII.1.C
15	Pyrethroid Management Plan (if necessary)	One year from the date an exceedance is identified	MGO VII.C.3.c

APPENDIX E – DETERMINATION OF WATER QUALITY-BASED EFFLUENT LIMITATIONS (WQBELS)

The Central Valley Water Board determined water quality-based effluent limitations (WQBELs) as described in the Municipal General Order, section V.C.4 of the Fact Sheet (Attachment F), using the effluent limits tables included in the Municipal General Order, section V.A.1 of the Limitations and Discharge Requirements. For parameters with both human health and aquatic life objectives/criteria, the final effluent limitations in this NOA are based on the lower of the effluent limitations based on the aquatic life objectives/criteria and human health objectives/criteria.

Abbreviations and Notes:

1. CV = Coefficient of Variation (established in accordance with section 1.4 of the SIP)
2. MDEL = Maximum Daily Effluent Limitation
3. AMEL = Average Monthly Effluent Limitation
4. MDEL = Maximum Daily Effluent Limitation
5. AWEL = Average Weekly Effluent Limitation
6. CMC = Criterion Maximum Concentration
7. CCC = Criterion Continuous Concentration
8. Coefficient of Variation (CV) calculated using effluent sample data for the parameter listed.
9. Effluent Limit Table as indicated and contained in section V, Effluent Limitations and Discharge Specifications, of the Municipal General Order. Specific table listed is used to determine the appropriate AMEL, AWEL, or MDEL.

Table E-1. Human Health WQBELs Calculations

Parameter	Units	Criteria	CV	Effluent Limit Table in Municipal General Order	AMEL	AWEL
Nitrate Plus Nitrite (as N)	mg/L	10	0.4	20B	10	15

Table E-2. Aquatic Life WQBELs Calculations

Parameter	Units	CMC	CCC	CV	Effluent Limit Table in Municipal General Order	AMEL	AWEL
Ammonia, Total (as N)	mg/L	3.9	2.17	0.39	19B	2.4	3.6