

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 81-59

WASTE DISCHARGE REQUIREMENTS
FOR
BOB'S PLAYA RIVIERA
North Shore of Salton Sea - Imperial County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. Bob Granillo, (hereinafter also referred to as the discharger), 10-565 Hwy 111, North Shore, CA 92254, submitted a Report of Waste Discharge, dated April 2, 1981.
2. The discharger is discharging an average of about 3,600 gallons-per-day of domestic sewage from a travel trailer park consisting of 20 travel trailer spaces, two restrooms, a house, and laundry facilities. An additional 180 travel trailer spaces are to be constructed in phases which would produce a total discharge of 30,000 gallons-per-day. The wastewater is to be discharged into a wet well and pumped to lined oxidation basins located about 100 feet west of Highway 111 in the NE 1/4 of the NW 1/4 of Section 4, T9S, R11E, SBB&M. Final disposal would be by evaporation. Upon installation of the basins, the existing septic tank/leach field system would be abandoned due to the rising water line of the Salton Sea.
3. The discharge from this travel trailer park has been subject to waste discharge requirements adopted in Board Order No. 78-48.
4. The Water Quality Control Plan for the West Colorado River Basin was adopted by the Board on April 10, 1975. The Basin Plan contains water quality objectives for the Imperial Hydrologic Unit.
5. Shallow groundwaters at the discharge location are saline and are not beneficially used.
6. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.
7. The Board in a public meeting heard and considered all comments pertaining to the discharge.

*Replaced by
87-0411*

*Replaced
87-44*

8. The Imperial County Planning Department has certified Negative Declaration EA 776-78 (filing date April 26, 1978) for the proposed expansion of this park. The Regional Board has reviewed this Negative Declaration. The below waste discharge requirements are designed to assure against any significant adverse effects on water quality.

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications


1. Neither the treatment nor the discharge of wastewater shall create a pollution or a nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic sewage shall be discharged into the sewage disposal system described in Finding No. 2 (above).
3. A minimum depth of freeboard of at least two feet shall be maintained in the basins.
4. Treated or untreated sludge, or similar solid waste materials, shall be discharged in such manner that these materials shall not enter the Salton Sea or any channel which drains to the Sea.
5. Adequate measures shall be taken to assure that unauthorized persons and animal pets are effectively excluded from contact with the discharge.
6. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
7. There shall be no surface flow of wastewater away from the discharge facilities.
8. There shall be no discharge, bypass, or flow of treated or untreated sewage to the Salton Sea, or to any channel which drains to the Sea.
9. Disposal by ponding shall be conducted in such manner that there shall be no stranded or exposed sewage solids.


B. Provisions

1. Prior to any modifications in this facility which could result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report thereon to the Board.

2. Upon request from this Board's Executive Officer, the discharger shall furnish technical and/or monitoring reports on the treatment and discharge of waste.
3. In the event of any change in control or ownership of land or waste disposal facilities owned or controlled by the discharger, the discharger shall:
 - a. Notify the Board of such change; and
 - b. Notify the succeeding owner or operator by letter of the existence of this Order, a copy of which shall be filed with this Board.
4. This Order supersedes Board Order No. 78-48.

I, Arthur Swajian, Executive Officer, do hereby certify the foregoing is a full, true, and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on May 20, 1981.

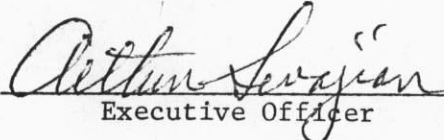
Executive Officer

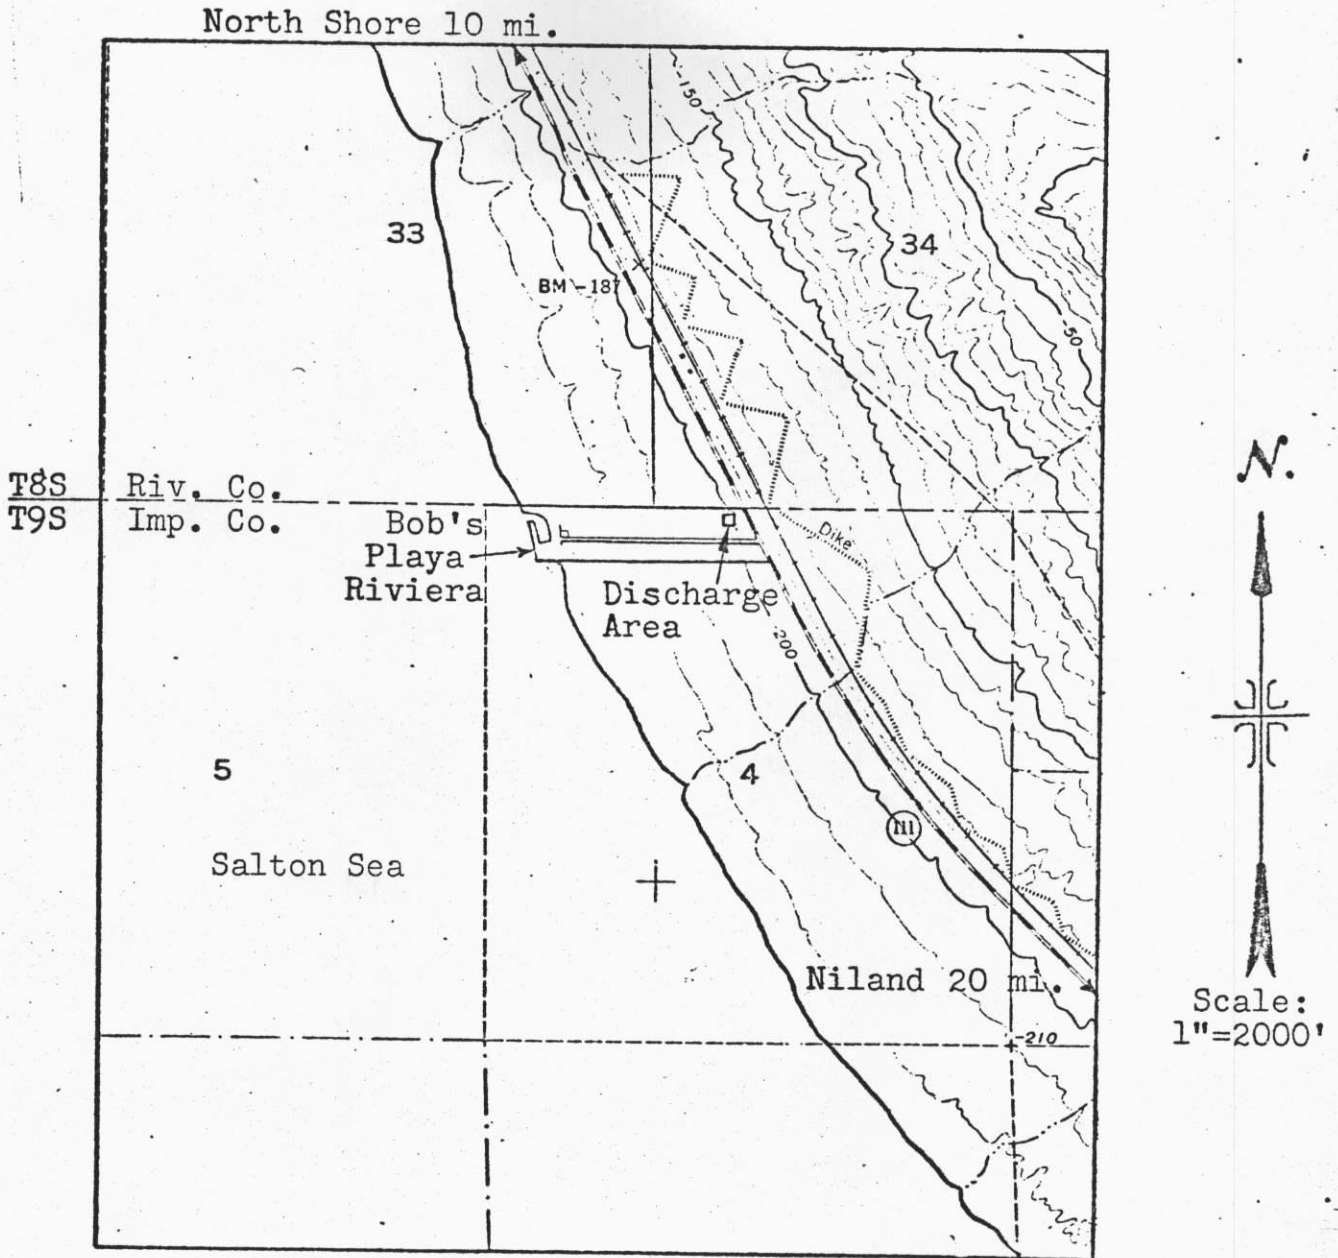

SITE MAP

BOB'S PLAYA RIVIERA
North Shore of Salton Sea - Imperial County
NE 1/4, NW 1/4 of Section 4, T9S, R11E, SBB&M
U.S.G.S. Durmid 7.5 min. Topographic Map