

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

ORDER NO. 89-053

WASTE DISCHARGE REQUIREMENTS
FOR
COUNTY OF RIVERSIDE
McINTYRE PARK
South of Blythe - Riverside County

The California Regional Water Quality Control Board, Colorado River Basin Region, finds that:

1. County of Riverside, Parks Department (hereinafter referred to as the discharger), Route 2, P. O. Box 179D, Blythe, California 92225, supplied the updated information on the discharge of waste on April 20, 1989.
2. The discharger is discharging a maximum of 8,000 gallons-per-day of domestic wastewater from a campground consisting of 5 mobile home spaces, 140 recreational vehicle spaces, 60 camp sites without hookups and 4 restrooms. The wastewater from this park is discharged into septic tank/leach field disposal systems which are located in the SW $\frac{1}{4}$ of the SW $\frac{1}{4}$ of Section 34, T7S, R23E, SBB&M.
3. The discharger is reserving an area of sufficient size for possible future 100 percent replacement of the leach fields.
4. This discharge has been subject to waste discharge requirements adopted in Board Order No. 84-075.
5. The Water Quality Control Plan for the Colorado River Basin Region of California was adopted by the Regional Board on November 14, 1984.
6. There are no domestic wells within 200 feet of the discharge facilities described in Finding No. 2.
7. The wastewater disposal facilities are more than 200 feet away from the regulated levee design flood level of the Colorado River.
8. The discharge is located in the Colorado Hydrologic Unit. The beneficial uses of surface waters and ground waters of the Colorado Hydrologic Unit are:
 - a. Municipal supply
 - b. Industrial supply
 - c. Agricultural supply

*revised
by Bd ord # 97-121
9/24/97
& replaced by 97-50037*

9. The Board has notified the discharger and interested agencies and persons of its intent to update waste discharge requirements for the discharge.
10. The Board in a public meeting heard and considered all comments pertaining to the existing discharge.
11. In accordance with Section 15301, Chapter 3, Title 14, of the California Code of Regulations, the issuance of these waste discharge requirements, which govern the operation of an existing facility involving negligible or no expansion of use beyond that previously existing, is exempt from the provisions of the California Environmental Quality Act (Public Resources Code, Section 21000 et seq.).

IT IS HEREBY ORDERED, the discharger shall comply with the following:

A. Discharge Specifications

1. Neither the treatment nor the discharge of wastewater shall create pollution or nuisance as defined in Division 7 of the California Water Code.
2. No wastewater other than domestic wastewater shall be discharged into the sewage disposal system described in Finding No. 2 (above).
3. Wastewater discharged subsurface shall be retained underground with no surfacing.
4. Adequate measures shall be taken to assure that flood or surface drainage waters do not erode or otherwise render portions of the discharge facilities inoperable.
5. Treated or untreated sludge or similar solid waste materials shall be disposed only at locations approved by the Regional Board.
6. There shall be no discharge of wastewater within 200 feet of the regulated levee design flood level of the Colorado River.
7. Septic tank cleanings shall be discharged only by a duly authorized service.


B. Provisions

1. The discharger shall comply with "Monitoring and Reporting Program No. 89-053", and future revisions thereto, as specified by the Executive Officer.
2. Prior to any modifications in this facility which would result in material change in the quality or quantity of wastewater discharged, or any material change in location of discharge, the discharger shall report in writing to the Regional Board.

3. In the event of any change in operation, or in control or ownership of land or waste disposal facilities owned or controlled by the discharger, the discharger shall:
 - a. Notify this Board of such change; and
 - b. Transmit a copy of this Order to the succeeding owner or operator, and file a copy of the transmittal letter with this Board.

IT IS FURTHER ORDERED THAT: Board Order No. 84-075 be superseded by this Order.

I, Phil Gruenberg, Executive Officer, do hereby certify the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Colorado River Basin Region, on June 28, 1989.


Executive Officer

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
COLORADO RIVER BASIN REGION

MONITORING AND REPORTING PROGRAM NO. 89-053
FOR
COUNTY OF RIVERSIDE
McINTYRE PARK
South of Blythe - Riverside County

Location of Discharge: SW $\frac{1}{4}$ of the SW $\frac{1}{4}$ of Section 34, T7S, R23E, SBB&M

MONITORING

The discharger shall submit an annual status report on the following:

1. Number of mobile home and RV spaces and restrooms presently connected to the sewerage system.
2. List any proposed changes in the sewage disposal facilities during the upcoming year.
3. Explain any surfacing of wastewater or other failures to the system during the preceding year.

REPORTING

1. Annual reports shall be submitted to the Regional Board by January 15th of each year to:

California Regional Water Quality Control Board
Colorado River Basin Region
73-271 Highway 111, Suite 21
Palm Desert, CA 92260

2. Report immediately any surfacing of wastewater or other failures of the system by telephone and follow-up letter.


ORDERED BY:


Executive Officer

June 28, 1989

Date

CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD - 7

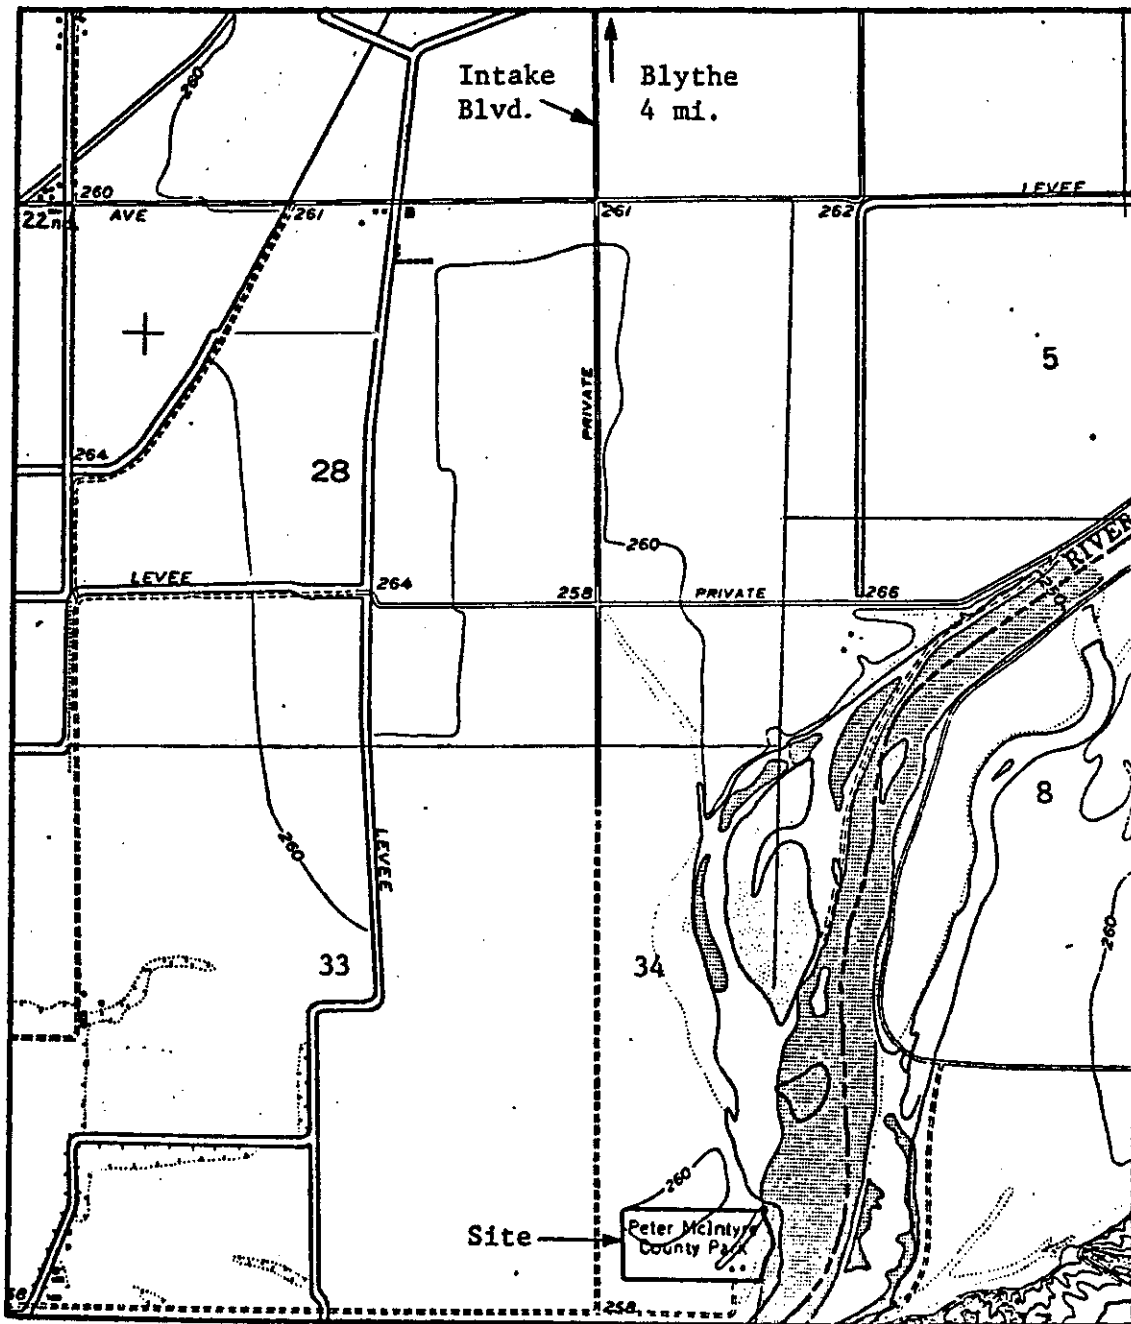

SITE MAP

COUNTY OF RIVERSIDE
MCINTYRE PARK
South of Blythe - Riverside County
SW $\frac{1}{4}$ of SW $\frac{1}{4}$ of Section 34, T7S, R23E, SBB&M
USGS Blythe, CA - Ariz. 7.5 min. Topographic Map

Order No. 89-053