



California Regional Water Quality Control Board

Los Angeles Region



Linda S. Adams
Cal/EPA Secretary

Recipient of the 2001 Environmental Leadership Award from Keep California Beautiful
320 W. 4th Street, Suite 200, Los Angeles, CA 90013
Phone (213) 576-6600 FAX (213) 576-6640 - Internet Address: <http://www.waterboards.ca.gov/losangeles>

Arnold Schwarzenegger
Governor

October 20, 2008

Mr. David Ghirardelli
Western/Pearson-Challinor, L.P.
5655 Lindero Canyon Road, Suite 301
Westlake Village, CA 91362

Dear Mr. Ghirardelli:

GENERAL WASTE DISCHARGE REQUIREMENTS (ORDER NO. 93-010) FOR SPECIFIED DISCHARGES TO GROUNDWATER – WESTERN/PEARSON-CHALLINOR PROJECT, CITY OF CAMARILLO, CALIFORNIA (CI-9453, File No. 08-130)

We have completed our review of your application, which includes the August 26, 2008, Report of Waste Discharge (ROWD) submitted by Pure Effect Incorporated on behalf of Western/Pearson-Challinor, L.P. (hereafter the Discharger) for discharge of groundwater produced during the construction of the Western/Pearson-Challinor Project.

The project consists of building a major roadway and installing associated wet and dry utilities on approximately 90 acres located off the 101 Freeway and Las Posas Road in Camarillo, California (Figure 1). The property is currently undeveloped land that was used in general as agriculture land for crops. The surface gently slopes to the southwest at about 0.007 feet/foot. The road to be built is an extension of Ventura Boulevard and will extend 3,600 linear feet and runs along the Home Depot Center to Bajo Agua Road. The utility trenches that will be excavated are for the placement of infrastructure and utilities. The wet utility pipe will be for a sanitary sewer and will run from Bajo Agua Road to behind Home Depot with the deepest point of nine feet. The dry utility pipes will be approximately 300 feet long and will cross Ventura Boulevard at three different points. The dry utilities pipes will be for Verizon, Time Warner, and Edison. The deepest dry utility crossing will be approximately 12 feet deep at two locations. Other utilities being installed include street lighting, street signals, water, and storm drain utilities.

The construction dewatering will start at the eastern end of the property and progress with the extension of the roadway. A total of 104 dewatering wells will be placed along the extension of the road which will be activated as the road progresses to depress groundwater at areas where the excavation is occurring (Figure 2). Each dewatering well will be 30 feet deep, and will flow between three to four gallons per minute depending on the location of the well. The estimated total flow rate of the dewatering is 400 gallons per minute because the Discharger is planning to run only 50 to 60 wells at any one time. The dewatering activity is estimated to last approximately six months.

California Environmental Protection Agency

*** The energy challenge facing California is real. Every California needs to take immediate action to reduce energy consumption***
For a list of simple ways to reduce demand and cut your energy costs, see the tips at: <http://www.swrdb.ca.gov/news/echalleng.html>



Our mission is to preserve and enhance the quality of California's water resources for the benefit of present and future generations.

The pumped groundwater will be discharged first to a 21,000-gallon tank for primary settling, then it will be pumped to a sand filter tank and filter system before the treated groundwater is discharged through a sprinkler system and/or water trucks for dust control/dust suppression (Figure 3).

The Water Quality Control Plan, Los Angeles Region, has established groundwater quality objectives for the Oxnard Plain, Confined Aquifer. The water quality objectives are 1,200 milligram per liter (mg/L) for total dissolved solids (TDS), 600 mg/L for sulfate, 150 mg/L for chloride, and 1.0 mg/L for boron.

Groundwater samples collected at boring GW1 on June 13, 2008 indicated that the total TDS is 2,620 mg/L, sulfate 1,600 mg/L, chloride 170 mg/L, boron 1.72 mg/L, and nitrate 45 mg/L.

Waste Discharge Requirement (E.6.) of Board Order No 93-010 states: "Wastewater discharged to groundwater shall maintain the existing water quality, even if that existing water quality exceeds established objectives. A determination shall be made by the Executive Officer as to the applicability of water quality standards with regard to the "Statement of Policy with Respect to Maintaining High Quality of Water in California", with each discharge, on a site – specific basis".

Based on the results of site specific groundwater samples collected from boring GW1, it is expected that the proposed discharge will exceed the water quality objectives for TDS, sulfate, chloride, and boron at the subject area. The exceedance of water quality objectives is attributed to the water quality of the Confined Aquifer exceeding water quality objectives for naturally occurring TDS, sulfate, chloride and boron. During the dewatering activity the Discharger will not be using groundwater in any activity that will result in the addition or incorporation of new pollutants. Groundwater will be pretreated to remove settleable and suspended solids and discharges will be controlled through sprinkler system irrigation or for dust control activities. The groundwater will be discharged over the same aquifer where naturally occurring TDS, sulfate, chloride and boron exceed water quality objectives. Therefore, the discharge is not considered to be a threat to existing water quality, will not threaten existing beneficial uses of the local groundwater, and will be returned to the same formation from which it is withdrawn.

The discharge of groundwater to surface waters under a National Pollutant Discharge Elimination System permit is not possible because the Discharger will not be able to meet effluent limits for surface discharge. In addition, there is no sanitary sewer available in close proximity to the site. Finally, this is considered to be a short term duration discharge that will last for approximately six months.

Therefore, based in the information provided and information gathered during the site inspection on September 17, 2008, Regional Board Executive Officer has determined that the proposed discharge meets the conditions specified in Order No. 93-010, "General Waste

California Environmental Protection Agency

**** The energy challenge facing California is real. Every California needs to take immediate action to reduce energy consumption***
For a list of simple ways to reduce demand and cut your energy costs, see the tips at: <http://www.swrdb.ca.gov/news/echalleng.html>*



Our mission is to preserve and enhance the quality of California's water resources for the benefit of present and future generations.

Mr. David Ghirardelli
Western/Pearson-Challinor, L.P.

- 3 -

October 20, 2008
CI-9453

Discharge Requirements for Specified Discharges to Groundwater in Santa Clara River and Los Angeles River Basins" adopted by this Board on January 25, 1993.

Enclosed are your Waste Discharge Requirements consisting of Regional Board Order No. 93-010, and Monitoring and Reporting program No. CI-9453. The Monitoring and Reporting Program requires you to implement the monitoring program on the effective date of this Order. All monitoring reports should be sent to the Regional Board, ATTN: Information Technology Unit. When submitting monitoring and technical reports to the Regional Board per these requirements, please include a reference to "Compliance File No. CI-9453", which will assure that the reports are directed to the appropriate file and staff. Do not combine other reports with your monitoring reports. Submit each type of report as a separate document.

We are sending Board Order No. 93-010 only to the applicant. A copy of the Order will be furnished to anyone who requests it.

If you have any questions regarding this matter, please contact Project Manager, Mr. Orlando H. Gonzalez at (213) 620-2267 or Unit Chief, Dr. Rebecca Chou at (213) 620-6156.

Sincerely,

fw David A. Baharowski, CEO
Tracy J. Egoscue
Executive Officer


Enclosures:

1. General WDR Board Order No. 93-010
2. Monitoring and Reporting Program No. CI-9453
3. Priority Pollutants list

cc: Mr. Kurt Souza, Cal. DHS, Region 5 - So Cal. Branch, Drinking Water Field Operation
Mr. Jeffrey L. Stone, Cal. DPH, Division of Drinking Water and Environmental Management, Recycled Water Unit
Mr. Ronald C. Coons, Director, Ventura County Public Works Agency
Mr. James Evans, Ventura County Environmental Health Division, Liquid Waste
Ms. Melinda Talent, Ventura County Environmental Health Division, Land Use Unit
Mr. Keith Duval, Ventura County Air Pollution Control District
Mr. Rob Roshanian, Development Service Manager, City of Oxnard
Mr. Michael E. Slaby, Pricipal, Pure Efect, Inc.

California Environmental Protection Agency

*** The energy challenge facing California is real. Every California needs to take immediate action to reduce energy consumption***
For a list of simple ways to reduce demand and cut your energy costs, see the tips at: <http://www.swrdb.ca.gov/news/echalleng.html>



Our mission is to preserve and enhance the quality of California's water resources for the benefit of present and future generations.

Western/Pearson-Challinor, L.P. Camarillo Project. Camarillo, California, United States

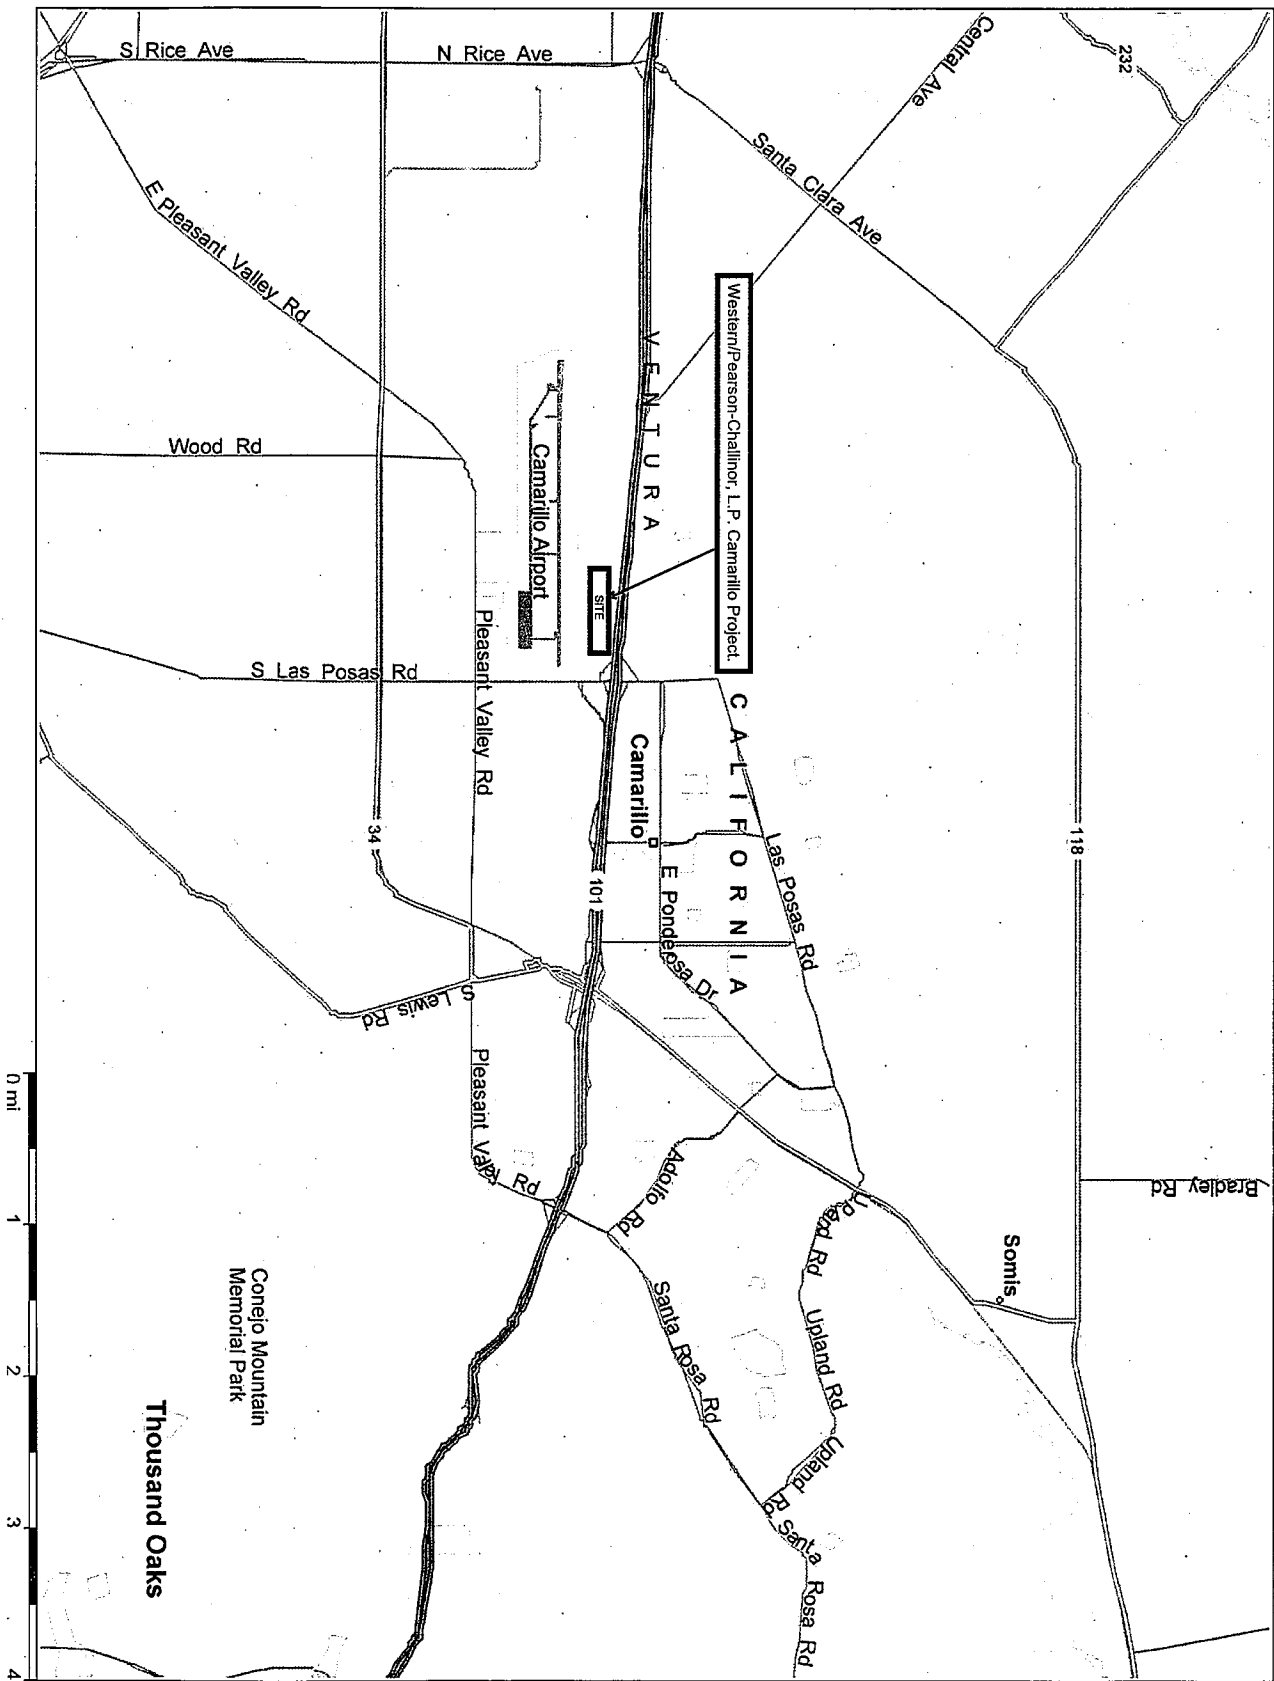


Figure 1


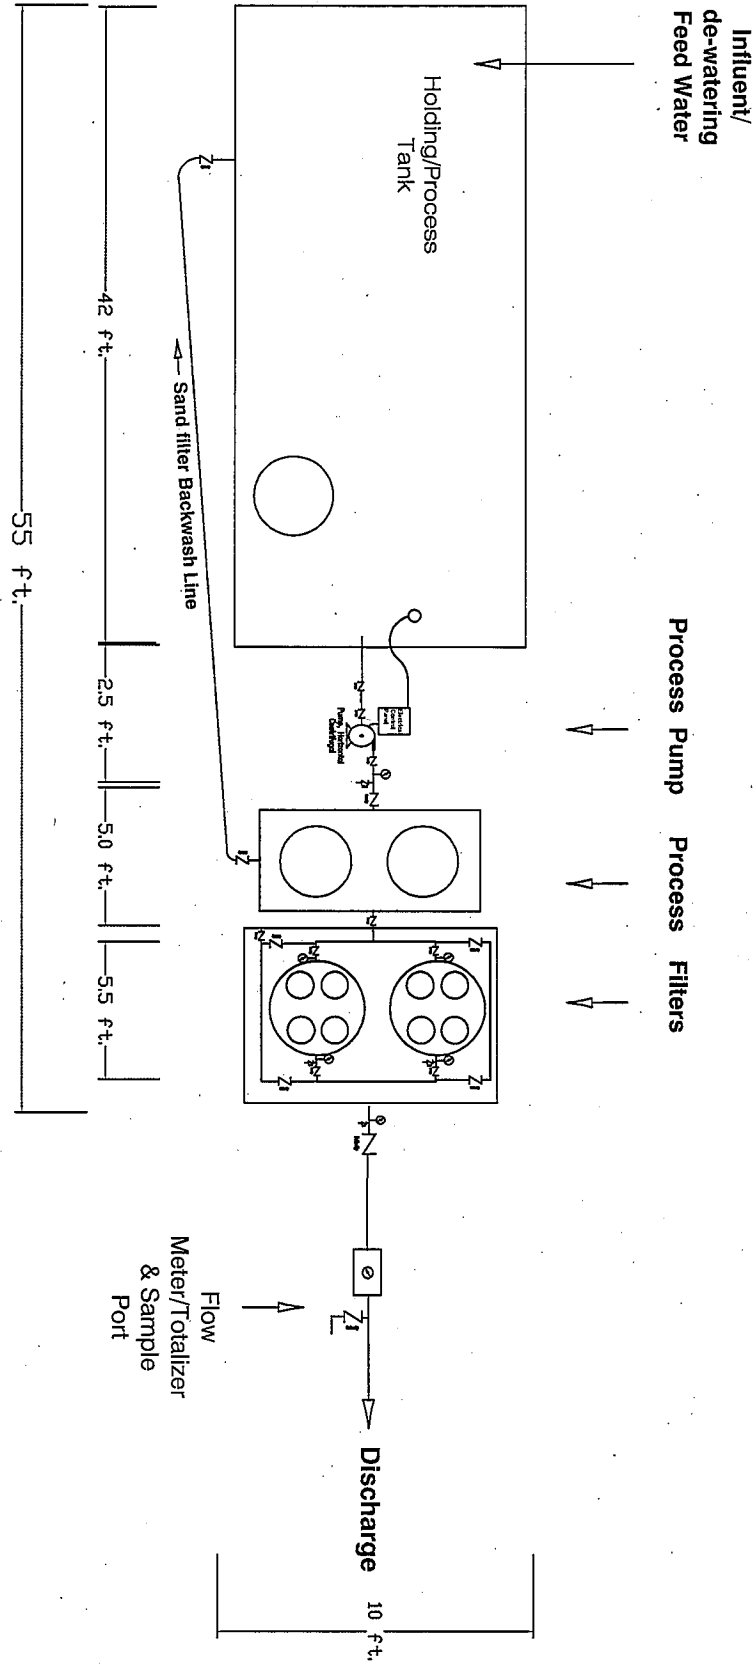


Figure 3



611 West Palm Ave.
Orange, CA 92868
(714) 639-7873
Fax: (714) 639-8530
www.pureeffect.com

ENGINEERED SOLUTIONS FOR OUR ENVIRONMENT

Western/
Pearson
Challinor, L.P.
Camarillo
Project

Dewatering Water Treatment System Configuration

DATE: 8-01-2008
Design Flow Rate
450 gpm

NOT TO SCALE

Legal Notice: This information is the property of Pure Effect, Inc., confidential and privileged, not for discussion or distribution to others outside your company, or used for reference or bidding purposes by others, without "written" authorization from Pure Effect, Inc. Please contact Pure Effect, Inc. to request "written" authorization (714) 639-7873.

Drawn by:
M. Slaby MES

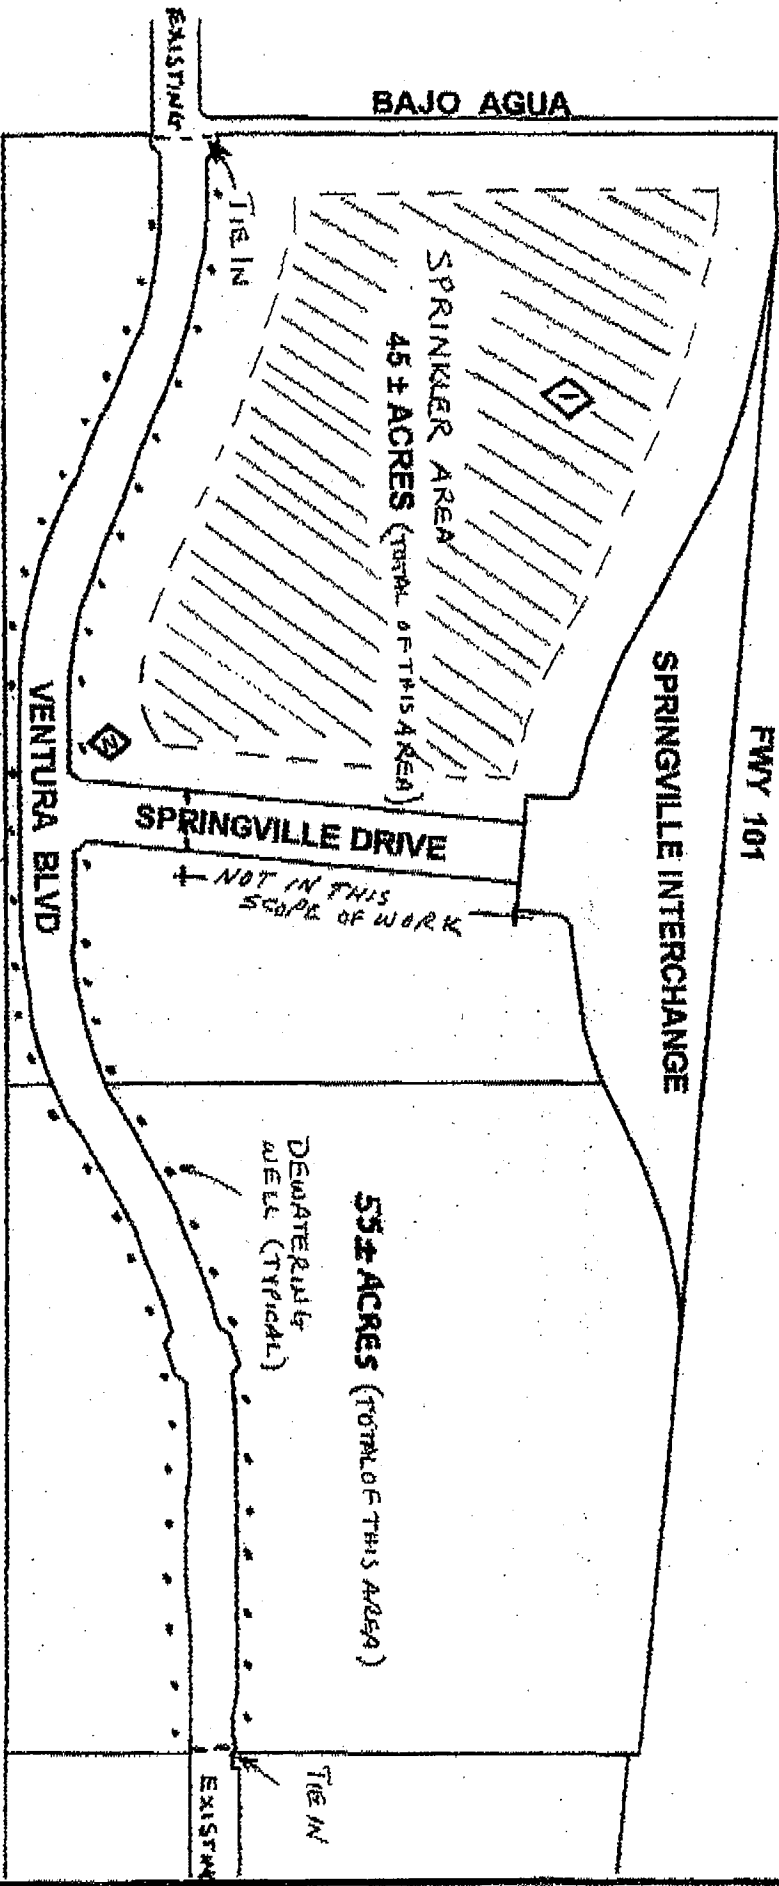


Figure 2

LOCATION MAP

VENTURA BLVD. EXTENSION
NOT TO SCALE

592 W. VENTURA BLVD., CAMARILLO, CA.

State of California
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LOS ANGELES REGION

AMENDED MONITORING AND REPORTING PROGRAM NO. CI-9453
for
WESTERN/PEARSON-CHALLINOR, L.P.

Enrollment under Regional Board Order No. 93-010 (Series No. 034)
(FILE NO. 08-130)

I. REPORTING REQUIREMENTS

- A. The Discharger shall implement this monitoring program from the effective date of this enrollment (October 20, 2008) under Regional Board order No. 93-010. The first monitoring report under this monitoring program is due by November 15, 2008. Monitoring reports shall be submitted monthly and must be received by the Regional Board by the fifteenth day of the second month following the sampling period. If there is no discharge, the report shall so state. Monitoring reports must be addressed to the Regional Board, Attention: Information Technology Unit.
- B. By January 30 of each year, the Discharger shall submit an annual summary report to the Regional Board. The report shall contain both tabular and graphical summaries of the monitoring data obtained during the previous calendar year. In addition, the discharger shall discuss the compliance record and the corrective actions taken or planned, which may be needed to bring the discharge into full compliance with waste discharge requirements.
- C. Laboratory analysis – all chemical analysis shall be conducted at a laboratory certified for such analyses by the California Department of Health Services Environmental Laboratory Accreditation Program (ELAP). A copy of the laboratory certification shall be provided each time that a new and/or renewal certification is obtained from ELAP.
- D. The method limits (MLs) employed for effluent analyses shall be lower than the permit limits established for a given parameter, unless the discharger can demonstrate that a particular ML is not attainable and obtains approval for a higher ML from the Executive Officer. At least once a year, the discharger shall submit a list of the analytical methods employed for each test and the associated laboratory Quality Assurance/Quality Control (QA/QC) procedures.
- E. Water/wastewater samples must be analyzed within allowable holding time limits as specified in 40 CFR Part 136.3. QA/QC samples must be run on the same dates as the Discharger samples are analyzed. The Discharger shall make available for inspection and/or submit the QA/QC documentation upon request by Regional Board staff.

Proper chain of custody procedures must be followed and a copy of the chain of custody documentation shall be submitted with the report.

October 20, 2008

- F. Each monitoring report must affirm in writing that "All analyses were conducted at a laboratory certified for such analyses by the California Department of Health Services, and in accordance with current United States Environmental Protection Agency (USEPA) guideline procedures or as specified in this Monitoring Program."
- G. For every item where the requirements are not met, the Discharger shall submit a statement of the cause(s), and actions undertaken or proposed which will bring the discharge into full compliance with waste discharge requirements at the earliest possible time, including a timetable for implementation of those actions.
- H. The Discharger shall maintain all sampling and analytical results, including strip charts; date; exact place, and time of sampling; dates analyses were performed; analyst's name; analytical techniques used; and results of all analyses. Such records shall be retained for a minimum of three years. This period of retention shall be extended during the course of any unresolved litigation regarding this discharge, or when requested by the Regional Board.
- I. In reporting the monitoring data, the Discharger shall arrange the data in tabular form so that the date, the constituents, and the concentrations are readily discernible. The data shall be summarized to demonstrate compliance with the requirements and, where applicable, shall include results of receiving water observations.
- J. Any mitigation/remedial activity including any pre-discharge treatment conducted at the site must be reported in the monthly monitoring report.

II. WATER QUALITY MONITORING REQUIREMENTS

- A. Maintenance Reporting: The Discharger shall submit a monthly operation and maintenance report for the facility including the disposal system of the wastewater. The information to be contained in the report shall include, at a minimum, the following:
 - 1. The name and address of the person or company responsible for the operation and maintenance of the facility;
 - 2. Type of maintenance (preventive or corrective action performed);
 - 3. Frequency of maintenance, if preventive;
 - 4. Estimated amount of water used for compaction and for dust control;
 - 5. Description of any change in the dewatering approach, if changed;
 - 6. Verification that there is no runoff from the pumping and discharge systems to surface waters; and
 - 7. Maintenance records for the pumping, discharge, and wastewater disposal system.

- B. Effluent Monitoring: Sampling stations shall be located where representative samples of that discharge ground water from dewatering area can be obtained. The following shall constitute the effluent monitoring program:

<u>Constituent</u> ^[1]	<u>Unit</u> ^[2]	<u>Type of</u> ^[3] <u>Sample</u>	<u>Minimum</u> <u>Frequency</u> <u>of Analysis</u>
Total flow	gal/day	N/A	Daily
pH	pH Units	grab	monthly
Total dissolved solids	mg/L	grab	monthly
Total Nitrogen ^[4]	mg/L	grab	monthly
Nitrate-nitrogen ^[4]	mg/L	grab	monthly
Nitrite-nitrogen ^[4]	mg/L	grab	monthly
Oil and grease	mg/L	grab	monthly
Total Nitrogen ^[4]	mg/L	grab	monthly
Sulfate	mg/L	grab	monthly
Chloride	mg/L	grab	monthly
Boron	mg/L	grab	monthly
BOD5 20°C	mg/L	grab	monthly
Suspended solids	mg/L	grab	monthly
Turbidity	NTU	grab	monthly
Total and Fecal coliform	MPN/100mL	grab	monthly
Enterococcus	MPN/100mL	grab	monthly
Phosphate	mg/l	grab	monthly
Priority pollutants ^[5]	mg/L	grab	Twice ^[6]

^[1] If any constituent exceeds the baseline water quality data, then the frequency of analyses shall increase to weekly until at least three test results have been obtained and there is no more exceeding constituent, after which the frequency of analyses shall revert to monthly.

^[2] MPN/100mL: Most Probable Number per milliliter; mg/L: milligram per liter

^[3] Samples shall be obtained at the outlet of the treatment system.

^[4] Nitrate + nitrite + ammonia + organic nitrogen as nitrogen

^[5] Priority Pollutants are listed in Attachment A;

^[6] Two effluent samples shall be collected and analyzed during the dewatering operation. One sample shall be collected during the first day of dewatering and the other shall be collected by the last day of the dewatering activities.

III. MONITORING FREQUENCY

Monitoring frequencies may be adjusted to a less frequent basis and/or parameters dropped by the Executive Officer if the Discharger makes a request which is supported by statistical trends of monitoring data.

IV. CERTIFICATION STATEMENT

Each report shall contain the following completed declaration:

"I certify under penalty of law that this document, including all attachments and supplemental information, was prepared under my direction or supervision in

accordance with a system designed to assure that qualified personnel properly gathered and evaluated the information submitted. Based on my inquiry of the person or persons who manage the system, or those persons directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of a fine and imprisonment.

Executed on the _____ day of _____ at _____

_____ (Signature)

_____ (Title)

These records and reports are public documents and shall be made available for inspection during normal business hours at the office of the California Regional Water Quality Control Board, Los Angeles Region.

Ordered by

David A. Barbanks, CEO
fn Tracy J. Egoscue
Executive Officer

Date: October 20, 2008

ATTACHMENT A

PRIORITY POLLUTANTS

Metals

Antimony
Arsenic
Beryllium
Cadmium
Chromium
Copper
Lead
Mercury
Nickel
Selenium
Silver
Thallium
Zinc

Miscellaneous

Cyanide
Asbestos (only if specifically required)

Pesticides & PCBs

Aldrin
Chlordane
Dieldrin
4,4'-DDT
4,4'-DDE
4,4'-DDD
Alpha-endosulfan
Beta-endosulfan
Endosulfan sulfate
Endrin
Endrin aldehyde
Heptachlor
Heptachlor epoxide
Alpha-BHC
Beta-BHC
Gamma-BHC
Delta-BHC
Toxaphene
PCB 1016
PCB 1221
PCB 1232
PCB 1242
PCB 1248
PCB 1254
PCB 1260

Base/Neutral Extractibles

Acenaphthene
Benzidine
1,2,4-trichlorobenzene
Hexachlorobenzene
Hexachloroethane
Bis(2-chloroethyl) ether
2-chloronaphthalene
1,2-dichlorobenzene
1,3-dichlorobenzene
1,4-dichlorobenzene
3,3'-dichlorobenzidine
2,4-dinitrotoluene
2,6-dinitrotoluene
1,2-diphenylhydrazine
Fluoranthene
4-chlorophenyl phenyl ether
4-bromophenyl phenyl ether
Bis(2-chloroisopropyl) ether
Bis(2-chloroethoxy) methane
Hexachlorobutadiene
Hexachlorocyclopentadiene
Isophorone
Naphthalene
Nitrobenzene
N-nitrosodimethylamine
N-nitrosodi-n-propylamine
N-nitrosodiphenylamine
Bis (2-ethylhexyl) phthalate
Butyl benzyl phthalate
Di-n-butyl phthalate
Di-n-octyl phthalate
Diethyl phthalate
Dimethyl phthalate
Benzo(a) anthracene
Benzo(a) pyrene
Benzo(b) fluoranthene
Benzo(k) fluoranthene
Chrysene
Acenaphthylene
Anthracene
1,12-benzoperylene
Fluorene
Phenanthrene
1,2,5,6-dibenzanthracene
Indeno (1,2,3-cd) pyrene
Pyrene
TCDD

Acid Extractibles

2,4,6-trichlorophenol
P-chloro-m-cresol
2-chlorophenol
2,4-dichlorophenol
2,4-dimethylphenol
2-nitrophenol
4-nitrophenol
2,4-dinitrophenol
4,6-dinitro-o-cresol
Pentachlorophenol
Phenol

Volatile Organics

Acrolein
Acrylonitrile
Benzene
Carbon tetrachloride
Chlorobenzene
1,2-dichloroethane
1,1,1-trichloroethane
1,1-dichloroethane
1,1,2-trichloroethane
1,1,2,2-tetrachloroethane
Chloroethane
Chloroform
1,1-dichloroethylene
1,2-trans-dichloroethylene
1,2-dichloropropane
1,3-dichloropropylene
Ethylbenzene
Methylene chloride
Methyl chloride
Methyl bromide
Bromoform
Dichlorobromomethane
Chlorodibromomethane
Tetrachloroethylene
Toluene
Trichloroethylene
Vinyl chloride
2-chloroethyl vinyl ether
Xylene

STANDARD PROVISIONS
APPLICABLE TO WASTE DISCHARGE REQUIREMENTS

1. DUTY TO COMPLY

The discharger must comply with all conditions of these waste discharge requirements. A responsible party has been designated in the Order for this project, and is legally bound to maintain the monitoring program and permit. Violations may result in enforcement actions, including Regional Board orders or court orders requiring corrective action or imposing civil monetary liability, or in modification or revocation of these waste discharge requirements by the Regional Board. [CWC Section 13261, 13263, 13265, 13268, 13300, 13301, 13304, 13340, 13350]

2. GENERAL PROHIBITION

Neither the treatment nor the discharge of waste shall create a pollution, contamination or nuisance, as defined by Section 13050 of the California Water Code (CWC). [H&SC Section 5411, CWC Section 13263]

3. AVAILABILITY

A copy of these waste discharge requirements shall be maintained at the discharge facility and be available at all times to operating personnel. [CWC Section 13263]

4. CHANGE IN OWNERSHIP

The discharger must notify the Executive Officer, in writing at least 30 days in advance of any proposed transfer of this Order's responsibility and coverage to a new discharger containing a specific date for the transfer of this Order's responsibility and coverage between the current discharger and the new discharger. This agreement shall include an acknowledgement that the existing discharger is liable for violations up to the transfer date and that the new discharger is liable from the transfer date on. [CWC Sections 13267 and 13263]

5. CHANGE IN DISCHARGE

In the event of a material change in the character, location, or volume of a discharge, the discharger shall file with this Regional Board a new Report of Waste Discharge. [CWC Section 13260(c)]. A material change includes, but is not limited to, the following:

- (a) Addition of a major industrial waste discharge to a discharge of essentially domestic sewage, or the addition of a new process or product by an industrial facility resulting in a change in the character of the Waste.

November 7, 1990
WDR

Standard Provisions Applicable to
Waste Discharge Requirements

- (b) Significant change in disposal method, e.g., change from a land disposal to a direct discharge to water, or change in the method of treatment which would significantly alter the characteristics of the waste.
- (c) Significant change in the disposal area, e.g., moving the discharge to another drainage area, to a different water body, or to a disposal area significantly removed from the original area potentially causing different water quality or nuisance problems.
- (d) Increase in flow beyond that specified in the waste discharge requirements.
- (e) Increase in the area or depth to be used for solid waste disposal beyond that specified in the waste discharge requirements. [CCR Title 23 Section 2210]

6. REVISION

These waste discharge requirements are subject to review and revision by the Regional Board. [CCR Section 13263]

7. TERMINATION

Where the discharger becomes aware that it failed to submit any relevant facts in a Report of Waste Discharge or submitted incorrect information in a Report of Waste Discharge or in any report to the Regional Board, it shall promptly submit such facts or information. [CWC Sections 13260 and 13267]

8. VESTED RIGHTS

This Order does not convey any property rights of any sort or any exclusive privileges. The requirements prescribed herein do not authorize the commission of any act causing injury to persons or property, do not protect the discharger from his liability under Federal, State or local laws, nor do they create a vested right for the discharger to continue the waste discharge. [CWC Section 13263(g)]

9. SEVERABILITY

Provisions of these waste discharge requirements are severable. If any provision of these requirements are found invalid, the remainder of the requirements shall not be affected. [CWC Section 921]

Standard Provisions Applicable to
Waste Discharge Requirements

10. OPERATION AND MAINTENANCE

The discharger shall, at all times, properly operate and maintain all facilities and systems of treatment and control (and related appurtenances) which are installed or used by the discharger to achieve compliance with conditions of this Order. Proper operation and maintenance includes effective performance, adequate funding, adequate operator staffing and training, and adequate laboratory and process controls including appropriate quality assurance procedures. This provision requires the operation of backup or auxiliary facilities or similar systems only when necessary to achieve compliance with the conditions of this Order. [CWC Section 13263(f)]

11. HAZARDOUS RELEASES

Except for a discharge which is in compliance with these waste discharge requirements, any person who, without regard to intent or negligence, causes or permits any hazardous substance or sewage to be discharged in or on any waters of the State, or discharged or deposited where it is, or probably will be, discharged in or on any waters of the State, shall, as soon as (a) that person has knowledge of the discharge, (b) notification is possible, and (c) notification can be provided without substantially impeding cleanup or other emergency measures, immediately notify the Office of Emergency Services of the discharge in accordance with the spill reporting provision of the State toxic disaster contingency plan adopted pursuant to Article 3.7 (commencing with Section 8574.7) of Chapter 7 of Division 1 of Title 2 of the Government Code, and immediately notify the State Board or the appropriate Regional Board of the discharge. This provision does not require reporting of any discharge of less than a reportable quantity as provided for under subdivisions (f) and (g) of Section 13271 of the Water Code unless the discharger is in violation of a prohibition in the applicable Water Quality Control plan. [CWC Section 1327(a)]

12. PETROLEUM RELEASES

Except for a discharge which is in compliance with these waste discharge requirements, any person who without regard to intent or negligence, causes or permits any oil or petroleum product to be discharged in or on any waters of the State, or discharged or deposited where it is, or probably will be, discharged in or on any waters of the State, shall, as soon as (a) such person has knowledge of the discharge, (b) notification is possible, and (c) notification can be provided without substantially impeding cleanup or other emergency measures, immediately notify the Office of Emergency Services of the discharge in accordance with the spill reporting provision of the State oil spill contingency plan adopted pursuant to Article 3.5 (commencing with Section 8574.1) of Chapter 7 of Division 1 of Title 2 of the Government Code. This provision does not require reporting of any discharge of less than 42 gallons unless the discharge is also required to be reported pursuant to Section 311 of the Clean Water Act or the discharge is in violation of a prohibition in the applicable Water Quality Control Plan. [CWC Section 13272]

Standard Provisions Applicable to
Waste Discharge Requirements

13. ENTRY AND INSPECTION

The discharger shall allow the Regional Board, or an authorized representative upon the presentation of credentials and other documents as may be required by law, to:

- (a) Enter upon the discharger's premises where a regulated facility or activity is located or conducted, or where records must be kept under the conditions of this Order;
- (b) Have access to and copy, at reasonable times, any records that must be kept under the conditions of this Order;
- (c) Inspect at reasonable times any facilities, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order; and
- (d) Sample or monitor at reasonable times, for the purposes of assuring compliance with this Order, or as otherwise authorized by the California Water Code, any substances or parameters at any location. [CWC Section 13267]

14. MONITORING PROGRAM AND DEVICES

The discharger shall furnish, under penalty of perjury, technical monitoring program reports; such reports shall be submitted in accordance with specifications prepared by the Executive Officer, which specifications are subject to periodic revisions as may be warranted. [CWC Section 13267]

All monitoring instruments and devices used by the discharger to fulfill the prescribed monitoring program shall be properly maintained and calibrated as necessary to ensure their continued accuracy. All flow measurement devices shall be calibrated at least once per year, or more frequently, to ensure continued accuracy of the devices. Annually, the discharger shall submit to the Executive Office a written statement, signed by a registered professional engineer, certifying that all flow measurement devices have been calibrated and will reliably achieve the accuracy required.

Unless otherwise permitted by the Regional Board Executive officer, all analyses shall be conducted at a laboratory certified for such analyses by the State Department of Health Services. The Regional Board Executive Officer may allow use of an uncertified laboratory under exceptional circumstances, such as when the closest laboratory to the monitoring location is outside the State boundaries and therefore not subject to certification. All analyses shall be required to be conducted in accordance with the latest edition of "Guidelines Establishing Test Procedures for Analysis of Pollutants" [40CFR Part 136] promulgated by the U.S. Environmental Protection Agency. [CCR Title 23, Section 2230]

Standard Provisions Applicable to
Waste Discharge Requirements

15. TREATMENT FAILURE

In an enforcement action, it shall not be a defense for the discharger that it would have been necessary to halt or to reduce the permitted activity in order to maintain compliance with this Order. Upon reduction, loss, or failure of the treatment facility, the discharger shall, to the extent necessary to maintain compliance with this Order, control production or all discharges, or both, until the facility is restored or an alternative method of treatment is provided. This provision applies, for example, when the primary source of power of the treatment facility fails, is reduced, or is lost. [CWC Section 13263(f)]

16. DISCHARGE TO NAVIGABLE WATERS

Any person discharging or proposing to discharge to navigable waters from a point source (except for discharge of dredged or fill material subject to Section 404 of the Clean Water Act and discharge subject to a general NPDES permit) must file an NPDES permit application with the Regional Board. [CCR Title 2 Section 22357]

17. ENDANGERMENT TO HEALTH AND ENVIRONMENT

The discharger shall report any noncompliance which may endanger health or the environment. Any such information shall be provided verbally to the Executive Officer within 24 hours from the time the discharger becomes aware of the circumstances. A written submission shall also be provided within five days of the time the discharger becomes aware of the circumstances. The written submission shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times, and if the noncompliance has not been corrected; the anticipated time it is expected to continue and steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance. The Executive officer, or an authorized representative, may waive the written report on a case-by-case basis if the oral report has been received within 24 hours. The following occurrence(s) must be reported to the Executive Office within 24 hours:

- (a) Any bypass from any portion of the treatment facility.
- (b) Any discharge of treated or untreated wastewater resulting from sewer line breaks, obstruction, surcharge or any other circumstances.
- (c) Any treatment plan upset which causes the effluent limitation of this Order to be exceeded. [CWC Sections 13263 and 13267]

18. MAINTENANCE OF RECORDS

The discharger shall retain records of all monitoring information including all calibration and maintenance records, all original strip chart recordings for continuous monitoring instrumentation, copies of all reports required by this Order, and record of all data used

Standard Provisions Applicable to
Waste Discharge Requirements

to complete the application for this Order. Records shall be maintained for a minimum of three years from the date of the sample, measurement, report, or application. This period may be extended during the course of any unresolved litigation regarding this discharge or when requested by the Regional Board Executive Officer.

Records of monitoring information shall include:

- (a) The date, exact place, and time of sampling or measurement;
 - (b) The individual(s) who performed the sampling or measurement;
 - (c) The date(s) analyses were performed;
 - (d) The individual(s) who performed the analyses;
 - (e) The analytical techniques or method used; and
 - (f) The results of such analyses.
19. (a) All application reports or information to be submitted to the Executive Office shall be signed and certified as follows:
- (1) For a corporation – by a principal executive officer or at least the level of vice president.
 - (2) For a partnership or sole proprietorship – by a general partner or the proprietor, respectively.
 - (3) For a municipality, state, federal, or other public agency – by either a principal executive officer or ranking elected official.
- (b) A duly authorized representative of a person designated in paragraph (a) of this provision may sign documents if:
- (1) The authorization is made in writing by a person described in paragraph (a) of this provision.
 - (2) The authorization specifies either an individual or position having responsibility for the overall operation of the regulated facility or activity; and
 - (3) The written authorization is submitted to the Executive Officer.

Any person signing a document under this Section shall make the following certification:

Standard Provisions Applicable to
Waste Discharge Requirements

"I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment. [CWC Sections 13263, 13267, and 13268]"

20. OPERATOR CERTIFICATION

Supervisors and operators of municipal wastewater treatment plants and privately owned facilities regulated by the PUC, used in the treatment or reclamation of sewage and industrial waste shall possess a certificate of appropriate grade in accordance with Title 23, California Code of Regulations Section 3680. State Boards may accept experience in lieu of qualification training. In lieu of a properly certified wastewater treatment plant operator, the State Board may approve use of a water treatment plant operator of appropriate grade certified by the State Department of Health Services where reclamation is involved.

Each plan shall be operated and maintained in accordance with the operation and maintenance manual prepared by the municipality through the Clean Water Grant Program [CWC Title 23, Section 2233(d)]

ADDITIONAL PROVISIONS APPLICABLE TO
PUBLICLY OWNED TREATMENT WORKS' ADEQUATE CAPACITY

21. Whenever a publicly owned wastewater treatment plant will reach capacity within four years the discharger shall notify the Regional Board. A copy of such notification shall be sent to appropriate local elected officials, local permitting agencies and the press. The discharger must demonstrate that adequate steps are being taken to address the capacity problem. The discharger shall submit a technical report to the Regional Board showing flow volumes will be prevented from exceeding capacity, or how capacity will be increased, within 120 days after providing notification to the Regional Board, or within 120 days after receipt of notification from the Regional Board, of a finding that the treatment plant will reach capacity within four years. The time for filing the required technical report may be extended by the Regional Board. An extension of 30 days may be granted by the Executive Officer, and longer extensions may be granted by the Regional Board itself. [CCR Title 23, Section 2232]

State of California
CALIFORNIA REGIONAL WATER QUALITY CONTROL BOARD
LOS ANGELES REGION

ORDER NO. 93-010

GENERAL WASTE DISCHARGE REQUIREMENTS
FOR SPECIFIED DISCHARGES TO GROUNDWATER
IN
SANTA CLARA RIVER AND LOS ANGELES RIVER BASINS
File No. 92-60

The California Regional Water Quality Control Board, Los Angeles Region (hereinafter Regional Board), finds:

1. The California Water Code, Section 13260 of Chapter 4, Article 4, requires that any person discharging wastes, or proposing to discharge wastes, which could affect the quality of the waters of the State, shall file a Report of Waste Discharge with the Regional Board. The Regional Board will then prescribe requirements as to the nature of the proposed or existing discharge.
2. A number of activities carried on within the Region result in the discharge of water that, because of its characteristics, results in little or no pollution when discharged to groundwater. Examples of these activities include:
 - a) hydrostatic testing of tanks, pipes, and storage vessels;
 - b) construction dewatering;
 - c) dust control application;
 - d) water irrigation storage systems;
 - e) subterranean seepage dewatering;
 - f) well development and test pumping;
 - g) aquifer testing; and
 - h) monitoring well construction.

The following discharges are specifically excluded from this list: water produced from seawater extraction or wastewater treatment, reclaimed water, and water to be injected directly into an aquifer.

3. The water discharged from these activities results in discharges of relatively "clean" wastewater, containing few pollutants. For the purposes of this Order, "wastewater" is defined as high quality wastewater, produced as a result of the above-listed specified activities, and other similar activities. It is of a quality acceptable for use under State Department of Health Services standards and the Regional Board's Water Quality Control Plan.
4. These discharges occur in a manner where they will likely, through recharge or percolation, enter the groundwater and may therefore, be considered a waste discharge which could affect the quality of the waters of the State, and for which a Report of Waste Discharge must be filed under Water Code Section 13260.

January 6, 1993

5. Each month, this Regional Board receives a large number of requests to discharge water from the activities listed in Finding 2 above, and for other similar activities. For each such request, staff must determine the absence or presence of significant pollutants in the discharge, the regulatory limits for the pollutants, and the potential impact of the discharge on the waters of the State, and then prepare individual Waste Discharge Requirements.
6. It is anticipated that the large number of such requests will continue to be filed, and far exceed the capacity of staff to review applications and prepare individual Waste Discharge Requirements to bring to the Board for consideration, in a timely manner. These circumstances create the need for an expedited system for processing the numerous requests for discharge to groundwater.
7. The adoption of General Waste Discharge Requirements will:
 - a) simplify the application process for the Discharger,
 - b) expedite the issuance of Waste Discharge Requirements and decrease the regulatory burden on the regulated community,
 - c) free up Board staff for higher priority work, and
 - d) reduce the Board's time involved by enabling the Executive Officer to notify the Discharger, in appropriate cases, of the applicability of these general requirements adopted by the Regional Board.

These General Waste Discharge Requirements would benefit the public, the Board, and Board staff by accelerating the review process without loss of regulatory jurisdiction or oversight.

8. The beneficial uses of groundwater in the Los Angeles River and Santa Clara River Basins may include municipal and domestic supply, agricultural supply, industrial service and process supply, and freshwater replenishment.
9. The Board adopted revised Water Quality Control Plans for the Santa Clara River Basin and Los Angeles River Basin on October 22, 1990, and June 3, 1991, respectively. These Water Quality Control Plans contain water quality objectives for groundwater within the Basins. The requirements contained in this Order, as they are met, will be in conformance with the goals of these Water Quality Control Plans.
10. The State Water Resources Control Board adopted Resolution 68-16, "Statement of Policy With Respect to Maintaining High Quality of Waters in California", on October 28, 1968. This Policy states that wherever the existing quality of water is better than the quality established as objectives or adopted policies, such existing quality shall be maintained.

11. The issuance of General Waste Discharge Requirements for the discharges subject to these general requirements is exempt from the provisions of Chapter 3 (commencing with Section 21100) of Division 13 of the Public Resources Code pursuant to one or more of the following:

- a) The lead agency has prepared an Environmental Impact Report or a negative declaration based on findings pursuant to California Code of Regulations (CCR), Title 14, Chapter 3, Section 15070, which show that there will be no significant impact on water quality.
- b) The replacement or reconstruction of existing structures will have substantially the same purpose and capacity as the structure replaced as defined in CCR, Title 14, Section 15302.
- c) The construction of new structures or the conversion of existing small structures will have only minor modifications in the exterior of the structure as defined in CCR, Title 14, Section 15303.
- d) The activity will cause only minor alterations to land as defined in CCR, Title 14, Section 15304.
- e) Minor alterations in land use will not result in any changes in land use or density as defined in CCR, Title 14, Section 15305.

12. These General Waste Discharge Requirements are not intended to alter or supersede existing restrictions or conditions imposed by other government agencies.

The Board has notified interested agencies and concerned persons of its intent to adopt General Waste Discharge Requirements for specified discharges to groundwater, and has provided them with an opportunity to submit their written views and recommendations.

The Board, in a public meeting, heard and considered all comments pertaining to the tentative requirements.

IT IS HEREBY ORDERED that the Dischargers authorized under this order shall comply with the following:

A. ELIGIBILITY

1. The General Waste Discharge Requirements, contained in this Order, will regulate discharges to groundwater from: hydrostatic testing of tanks, pipes and storage vessels; construction dewatering; dust control application; water irrigation storage systems; subterranean seepage dewatering; well development and test pumping; aquifer testing; monitoring well construction; and other similar discharges, in accordance with the California Code of Regulations.

To qualify for coverage under this Order, the Discharger may be required to:

- a) submit specific hydrogeological site studies summarizing the following: regional and local hydrogeology, a site plan designating structures and operations, descriptions and details of representative water supply and monitoring wells, and water conveyance systems, soil engineering analyses of representative earth materials including site lithology, permeability, infiltration data, and any potential adverse impacts on groundwater.
 - b) demonstrate that the discharge meets the criteria set forth herein, and that specified discharges to groundwater will not adversely impact the overall quality of the regional and local groundwater basin(s), and is in accordance with the appropriate Basin Plan Water Quality Objectives, State Department of Health Services (DHS) Primary and Secondary Drinking Water Standards, and all water quality standards associated with Priority Pollutants.
 - c) demonstrate that disinfectants, if used, will not adversely impact water quality in the groundwater basin(s).
2. The discharge must not adversely impact the overall quality of the regional and local groundwater basins, must not adversely affect beneficial uses, and must have water quality characteristics in accordance with Basin Plan Water Quality Objectives, State Department of Health Services' (DHS) Primary and Secondary Drinking Water Standards, and all water quality standards associated with Priority Pollutants.

B. APPLICABILITY

1. This Order will serve as General Waste Discharge Requirements for specified discharges to groundwater.
2. Upon receipt of the Report of Waste Discharge describing such discharge, the Executive Officer shall determine, as applicable, if such discharge,

- a) involves wastewater at limits lower than, or equal to, the acceptable levels of the Basin Plan Water Quality Objectives, the State DHS Primary and Secondary Drinking Water Standards, and all water quality standards associated with Priority Pollutants,
- b) will be completed within a time frame stated by the Discharger and approved by the Executive Officer,
- c) has been adequately characterized by hydrogeologic assessment,
- d) is not a threat to water quality,
- e) does not cause the degradation of groundwater, and
- f) does not threaten or impair any designated beneficial uses of such waters.

3. In the event the Executive Officer so finds, he shall notify the Discharger, in writing, that the proposed wastewater discharge to groundwater is subject to this Order. Appropriate cases may also be brought to the Board for adoption of individual requirements when the Executive Officer deems it desirable or necessary.

4. Should individual Waste Discharge Requirements with more specific requirements be issued to a Discharger, the applicability of these general requirements to the individual will be automatically terminated on the effective date of the individual Waste Discharge Requirements.

C. REPORT OF WASTE DISCHARGE

1. Deadline for Submission

All Dischargers shall file a Report of Waste Discharge at least 120 days before start of the discharge. The Executive Officer will determine the applicability of General Waste Discharge Requirements.

2. Failure to Submit a Report of Waste Discharge

Dischargers who fail to file a Report of Waste Discharge under Section 13260 of the California Water Code are guilty of a misdemeanor and may be liable civilly in accordance with Section 13261(b) of the California Water Code.

D. PROHIBITION

1. Discharge of wastewater is prohibited, except as specified in the Report of Waste Discharge.

E. WASTE DISCHARGE REQUIREMENTS

IT IS HEREBY ORDERED that the Discharger shall comply with the following:

1. Only those types of discharges specifically listed in the Report of Waste Discharge are authorized to be discharged by the General Waste Discharge Requirements.
2. Wastewater shall be analyzed, prior to discharge, to determine if it contains constituents in excess of the appropriate Basin Plan Water Quality Objectives, as listed in Tables 1 and 2 of Attachment "A".

Hydrologic and groundwater basin boundaries are included in Figures 1 and 2 of Attachment "A".

3. Wastewater shall be analyzed, prior to discharge, to determine that it does not contain constituents in excess of the Maximum Contaminant Levels (MCL) as listed in the State DHS Primary and Secondary Drinking Water Standards in Attachment "B".
4. Wastewater shall be analyzed, prior to discharge, to determine the concentrations of the chemical constituents listed in the Priority Pollutants exhibited in Attachment "B".
5. Wastewater which contains any constituent in excess of the MCL's, the Drinking Water Standards, or the Priority Pollutant standards, listed herein, shall not be discharged to groundwater.
6. Wastewater discharged to groundwater shall maintain the existing water quality, even if that existing water quality exceeds established objectives. A determination shall be made by the Executive Officer as to the applicability of water quality standards with regard to the "Statement of Policy With Respect to Maintaining High Quality of Waters in California", with each discharge, on a site-specific basis.
7. Neither the treatment nor discharge of wastewater shall cause a condition of pollution or nuisance.

8. The pH of wastewater discharged to groundwater, under this Order, shall at all times be within the range of 6.0 and 9.0 pH units.
9. Wastewater to be discharged to groundwater, under this Order, shall be retained on the areas of use, and shall not be allowed to escape as surface flow, except as provided in a National Pollutant Discharge Elimination System (NPDES) permit uniquely applicable to the specified discharge. For the purpose of this requirement, however, minor amounts of irrigation return water from peripheral areas shall not be considered a violation of this Order.
10. Wastewater discharged to groundwater shall be discharged at the site in accordance with these requirements, and only on property owned or controlled by the Discharger.
11. Wastewater which does not meet each of the foregoing requirements shall be held in impervious containers, and if transferred elsewhere, the final discharge shall be at a legal point of disposal, and in accordance with the provisions of Division 7.5 of the California Water Code. For the purpose of these requirements, a legal point of disposal is defined as one for which Waste Discharge Requirements have been established by a California Regional Water Quality Control Board, and which is in full compliance therewith.
12. Wastewater discharged to groundwater shall not contain any substance in concentrations toxic to human, animal, plant, or aquatic life.
13. Wastewater discharged to groundwater shall not impart tastes, odors, color, foaming, or other objectionable characteristics to the receiving groundwater.
14. Neither disposal nor handling of wastes shall cause a condition of pollution or nuisance or problems due to breeding of mosquitos, gnats, midges, flies or other pests.
15. The temperature of discharged wastewater shall not exceed 100°F.

F. PROVISIONS

1. A copy of this Order shall be maintained at the discharge facility and shall be available at all times to operating personnel.

2. In the event the Discharger is unable to comply with any of the conditions of this Order due to:
 - (a) Breakdown of equipment,
 - (b) Accidents caused by human error or negligence,
 - (c) Other causes such as acts of nature,
 - (d) Facility operations,the Discharger must notify this Board, by telephone, within 24 hours of the incident, and confirm it in writing within one week of the telephone notification.
3. In accordance with Section 13260(c) of the California Water Code, the Discharger shall file a report with this Regional Board of any material change or proposed change in the character, location and/or volume of the discharge.
4. In accordance with Section 13267(b) of the California Water Code, the Discharger shall furnish, under penalty of perjury, technical monitoring program reports; such reports shall be submitted in accordance with specifications prepared by the Executive Officer.
5. The Regional Board and other authorized representatives shall be allowed:
 - (a) Entry upon premises where a regulated facility or activity is located or conducted, or where records are kept under the conditions of this Order;
 - (b) Access to copy any records that are kept under the conditions of this Order;
 - (c) To inspect any facility, equipment (including monitoring and control equipment), practices, or operations regulated or required under this Order; and
 - (d) To photograph, sample, and monitor for the purpose of assuring compliance with this Order, or as otherwise authorized by the California Water Code.
6. In accordance with Section 13263(e) of the California Water Code, these Waste Discharge Requirements are subject to periodic review and revision by this Regional Board.
7. These requirements, prescribed herein, do not authorize the commission of any act, by the Discharger, which causes injury to the property of another, do not protect the Discharger from his/her liabilities under Federal, State, or local laws, and do not guarantee the Discharger a capacity right in the receiving groundwater.

8. If hazardous or toxic materials or hydrocarbons are stored at the facility and the facility is not monitored at all times, a 24-hour emergency response telephone number shall be prominently posted where it can be easily discerned.

G. MONITORING REQUIREMENTS

1. The Executive Officer may prescribe a Monitoring and Reporting Program for each authorized Discharger; applicable parameters limited in the discharge shall be monitored as specified by the Executive Officer in the Monitoring and Reporting Program.
2. The Discharger shall retain records of all monitoring information and data used to complete the Report of Waste Discharge for at least three years from the date of sampling, measurement, report, or application. The retention period shall be extended during the course of any unresolved litigation regarding the discharge, or when requested by the Regional Board.
3. The Discharger shall maintain all sampling, measurement and analytical results, including: the date, exact place, and time of sampling or measurement; the individual(s) who performed the sampling or measurement; the date(s) analyses were performed; analysts' names; and analytical techniques or methods used.
4. Representative samples of the discharge shall be taken prior to discharging to the groundwater.
5. All chemical and bacteriological analyses shall be conducted at a laboratory certified for such analyses by the State of California Department of Health Services. The laboratory performing the analyses must follow all applicable QA/QC protocols.
6. The Discharger shall calibrate and perform maintenance procedures on all monitoring instruments and equipment to insure accuracy of measurements, or shall insure that both activities will be conducted.

H. REPORTING REQUIREMENTS

1. The Discharger shall file with the Regional Board (Attention: Technical Support Unit) technical reports on self-monitoring work performed according to the Monitoring and Reporting Program specified by the Executive Officer, and submit other reports as requested by the Regional Board.


2. In reporting the monitoring data, the Discharger shall arrange the data in tabular forms such that the date, constituents, and concentrations are readily discernable. The data shall be summarized to demonstrate compliance with Waste Discharge Requirements.
3. All records and reports submitted to the Regional Board are public documents and will be made available for inspection by the public during normal business hours at the Regional Board office located at 101 Centre Plaza Drive in Monterey Park.
4. For every item where the requirements are not met, the Discharger shall submit a statement of the actions undertaken, or proposed, which will bring the discharge into full compliance with requirements at the earliest time, and submit a timetable for correction.
5. Each monitoring report must affirm in writing that:
"All analyses were conducted at a laboratory certified for such analyses by the State of California Department of Health Services, and in accordance with current EPA guideline procedures or as specified in this Monitoring Program."
6. Each report shall contain the following completed declaration:
"I declare under penalty of law that I have personally examined, and am familiar with, the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate, and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment. [CWC Sections 13263, 13267, and 13268]"
7. In the event that wastes, associated with the discharge under this Order, are transported to a different disposal site, the following shall be reported in the monitoring report: type and quantity of wastes; name and address of hauler (or method of transport if other than by hauling); and, location of the final point(s) of disposal.
8. In the event of any changes of subject land ownership or subject waste discharge facility currently owned or controlled by the Discharger, the Discharger shall notify the succeeding owner or operator of the existence of this Order in writing. A copy of the document shall be signed by the new owner accepting responsibility for this Order and shall be forwarded to this Regional Board.

9. The Discharger shall notify this Regional Board, within 24 hours, by telephone, of any adverse condition resulting from this discharge, and such notification shall be affirmed in writing within seven calendar days.

I. EXPIRATION DATE AND CONTINUATION OF EXPIRED GENERAL WASTE DISCHARGE REQUIREMENTS

It is the Board's intent to review this Order within five (5) years of its adoption.

I, Robert P. Ghirelli, Executive Officer, do hereby certify that the foregoing is a full, true and correct copy of an Order adopted by the California Regional Water Quality Control Board, Los Angeles Region, on January 25, 1993.



ROBERT P. GHIRELLI, D.Env.
Executive Officer

Attachment "A"

Groundwater Water Quality Objectives
Santa Clara River (4A)
Los Angeles River (4B)

Hydrologic Boundaries, CRWQCB-LA
Fig 1, Principal Surface Waters
Fig 2, Principal Ground Waters

Water Quality Objectives for Ground Waters Santa Clara River Basin (4A)				
Area	Objective in mg/L			
	TDS	Sulfate	Chloride	Boron
	None Specified (n/s)			
Rincon Creek Hydrologic Unit ^a				
Ventura River Hydrologic Unit				
Ojai Hydrologic Area (HA)				
Upper Ojai Hydrologic Subarea (HSA)	1,000	300	200	1.0
West of Sulphur Mtn Rd	700	50	100	1.0
East of Sulphur Mtn Rd				
Ojai HSA ^b				
West of San Antonio-Senior Cyn Creek	1,000	300	200	0.5
East of San Antonio-Senior Cyn Creek	700	200	50	0.5
Upper Ventura River HA				
San Antonio Creek Area	1,000	300	100	1.0
Remainder of ground water basin	800	300	100	0.5
Lower Ventura River HA ^c				
Santa Clara-Calleguas Hydrologic Unit				
Upper Santa Clara HA	600	150	100	1.0
Acton HSA				
Eastern HSA	800	150	150	1.0
Above Bouquet Cyn ^d	900	300	150	1.0
Above Castaic Creek to Bouquet Cyn ^e	1,300	800	100	0.5
South Fork of Santa Clara River Area	700	150	100	0.5
Placerita Cyn Area	1,500	700	150	1.0
Castaic Creek to Blue Cut ^f	400	50	30	0.5
Bouquet HSA	700	150	100	0.5
Mint Cyn HSA	600	100	100	0.5
Sierra Pelona HSA				
Piru HA				
Santa Felicia HSA (Piru Subarea)	2,500	1,200	200	1.5
East of Piru Creek ^g	1,200	600	100	1.5
West of Piru Creek ^h	1,100	400	200	2.0
Upper Piru HSA	500	150	50	1.0
Hungry Valley HSA	1,000	300	20	2.0
Stauffer HSA				
Sespe HA				
Fillmore HSA	2,000	800	100	1.0
Pole Creek Fan underlying				
City of Fillmore	1,500	800	100	1.1
South Side of Santa Clara River	1,000	400	50	0.7
Remainder of ground water basin	900	350	30	2.0
Topa Topa HSA (Sespe Subarea)				
Santa Paula HA				
Santa Paula HSA	1,200	600	100	1.0
East of Peck Rd	2,000	800	110	1.0
West of Peck Rd	700	250	100	0.5
Sisar HSA				
Oxnard Plain HA				
Oxnard HSA	1,200	600	150	1.5
Oxnard Forebay	1,200	600	150	1.5
Deep aquifers underlying				
pressure area	3,000	1,000	500	n/s
Semiperched aquifer ⁱ				

<u>Water Quality Objectives for Ground Waters</u>				
<u>Santa Clara River Basin (4A)</u>				
<u>Area</u>	<u>Objective in mg/L</u>			
	<u>TDS</u>	<u>Sulfate</u>	<u>Chloride</u>	<u>Boron</u>
Oxnard Plain HA (continued from previous page)				
Pleasant Valley HSA				
Fox Cyn Aquifer	1,200	600	150	1.0
Grimes Cyn Aquifer	1,200	600	150	1.0
Upper Aquifer ^l	None Specified			
Calleguas-Conejo HA				
West Las Posas HSA	900	350	150	1.0
East Las Posas HSA ^k				
NW of Grimes Cyn Rd, L.A. Avenue and Somis Rd	700	300	100	0.5
East of Grimes Cyn Rd and Hitch Blvd	2,500	1,200	400	3.0
South of L.A. Ave between Somis Rd and Hitch Blvd	1,500	700	250	1.0
Isolated basin near Grimes Cyn Rd and Broadway Rd	250	30	30	0.2
Arroyo Santa Rosa HSA	900	300	150	1.0
Conejo Valley HSA	800	250	150	1.0
Tierra Rejada Valley HSA	700	250	100	0.5
Gillibrand HSA	900	350	50	1.0
Simi Valley HSA				
Deep aquifers	1,200	600	150	1.0
Shallow aquifer ^l	None Specified			
Thousand Oaks HSA	1,400	700	150	1.0

.....Endnotes

- a. Upper aquifers are of very poor quality and not used for domestic, agricultural, or industrial water supply in any significant quantity. Water quality in shallow aquifers shall be maintained at existing levels in accordance with "Resolution 68-16". This is to be accomplished on case-by-case basis as part of the requirements imposed upon dischargers to the shallow aquifers.
- b. Excludes aquifer in Bouquet Canyon and tributaries.
- c. Shallow alluvial aquifer is of very poor quality and not used. Water quality in shallow aquifer shall be maintained at existing levels in accordance with "Resolution 68-16". This is to be accomplished on a case-by-case basis as part of the requirements imposed upon dischargers to the shallow aquifer.
- d. See endnote b.
- e. Includes aquifer in Bouquet Canyon and tributaries but excludes aquifer in Castaic Creek and the South Fork of Santa Clara River and tributaries.
- f. Includes aquifer in Castaic Creek and tributaries.
- g. Includes aquifer in Piru Creek and tributaries.
- h. Excludes aquifer in Piru Creek and tributaries.
- i. Semiperched aquifer is generally of poor quality, but locally may be used for agricultural and domestic purposes in northwestern parts of the Oxnard Plain. Where shallow well or drainage ditch waters clearly exceed these objectives, requirements should be set on a case-by-case basis according to "Resolution 68-16".
- j. See endnote a.
- k. Some isolated wells along Los Angeles Avenue in the Arroyo Las Posas flood plain have higher mineral level. Requirements for these areas should be set on a case-by-case basis according to "Resolution 68-16".
- l. See endnote a.

Water Quality Objectives for Ground Waters Los Angeles River Basin (4B)				
Area	Objective in mg/L			
	TDS	Sulfate	Chloride	Boro
Malibu Hydrologic Unit				
Topanga Hydrologic Area (HA)	2,000	500	500	2.0
Malibu Creek Hydrologic Subarea (HSA)	2,000	500	500	2.0
Las Virgenes HSA	2,000	500	500	2.0
Lindero Canyon HSA	2,000	500	500	2.0
Triunfo Canyon HSA	2,000	500	500	2.0
Russell Valley HSA	1,500	500	250	1.0
Sherwood HSA	1,000	250	250	1.0
Point Dume HA	1,000	250	250	1.0
Camarillo HA	1,000	250	250	1.0
Los Angeles-San Gabriel River Hydrologic Unit				
Coastal Plain HA				
West Coast Basin	800	250	250	1.5
Santa Monica Basin	1,000	250	250	0.5
Hollywood Basin	750	100	100	1.0
Central Basin	700	250	250	1.0
San Fernando HA				
Sylmar Basin	600	150	100	0.5
Eagle Rock Basin	800	150	100	0.5
Verdugo Basin	600	150	100	0.5
San Fernando Basin-Overall	800	300	100	1.5
Narrows Area ^a	900	300	150	1.5
Foothill Wells Area ^b	400	100	50	1.0
Headworks Area ^c	700	300	100	1.5
North Hollywood-Burbank Area ^d	600	250	100	1.5
Raymond HA				
Monk Hill HSA	450	100	100	0.5
Pasadena HSA	450	100	100	0.5
Santa Anita HSA	450	100	100	0.5
San Gabriel Valley HA				
Puente Basin ^e	1,000	300	150	1.0
Main San Gabriel Basin-Overall	550	150	100	1.0
Westerly Portion ^f	450	100	100	0.5
Easterly Portion ^g	600	100	100	0.5
Spadra Hydro HA				
Spadra HSA	550	200	120	1.0
Pomona HSA	300	100	50	0.5
Live Oak HSA	450	150	100	0.5
Anaheim HA	1,000	250	250	1.0
San Pedro Channel Island Hydrologic Unit				
Santa Catalina HA	1,000	250	250	1.0
San Clemente Island HA	no significant sources			
Santa Barbara Island HA	no significant sources			
Santa Ana River Hydrologic Unit				
Middle Santa Ana River HA	220	50	50	0.5

.....Endnotes


- a. Narrows Area is defined as that area of the San Fernando Basin adjacent to the Los Angeles River lying east of Verdugo Wash.
- b. Foothill Wells is the main extraction area in the Sunland-Tujunga Area.
- c. Headworks Area is that area lying adjacent to the Los Angeles River upstream of the confluence with Verdugo Wash encompassing in general the City of Los Angeles' Headworks, Crystal Springs, and Verdugo wells and the City of Glendale's wells among others.
- d. The North Hollywood-Burbank Area refers to the principal extraction area which includes the City of Burbank's wells, and the City of Los Angeles, North Hollywood, Ervin, and Whitnall wells among others.
- e. The Puente Basin lies adjacent to San Jose Creek upstream of the Puente Narrows. The Puente Basin and the Puente Narrows are described in the Judgment of the Upper San Gabriel Valley Municipal Water District versus City of Alhambra et al No.92412B.
- f. The westerly portion of the Main San Gabriel Basin which lies west of Walnut Creek, Big Dalton Wash, and Little Dalton Wash.
- g. The easterly portion of the Main San Gabriel Basin which lies east of Walnut Creek, Big Dalton Wash, and Little Dalton Wash but does not include the Puente Basin.

REGION 4 INDEX

100	100	100	100
101	101	101	101
102	102	102	102
103	103	103	103
104	104	104	104
105	105	105	105
106	106	106	106
107	107	107	107
108	108	108	108
109	109	109	109
110	110	110	110
111	111	111	111
112	112	112	112
113	113	113	113
114	114	114	114
115	115	115	115
116	116	116	116
117	117	117	117
118	118	118	118
119	119	119	119
120	120	120	120



121	121	121	121
122	122	122	122
123	123	123	123
124	124	124	124
125	125	125	125
126	126	126	126
127	127	127	127
128	128	128	128
129	129	129	129
130	130	130	130
131	131	131	131
132	132	132	132
133	133	133	133
134	134	134	134
135	135	135	135
136	136	136	136
137	137	137	137
138	138	138	138
139	139	139	139
140	140	140	140

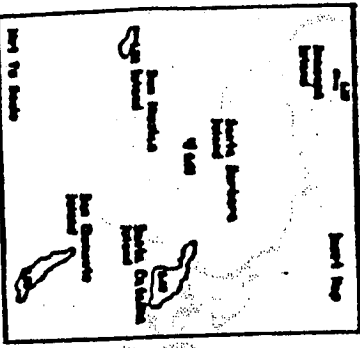

LEGEND

- REGIONAL BOUNDARY
- STATE BOUNDARY
- COUNTY BOUNDARY
- COUNTY LINE (with boundary and)
- HYDROLOGIC AREA BOUNDARY (dashed)
- HYDROLOGIC SUBAREA BOUNDARY (dotted)
- FRESHWATER/SAV


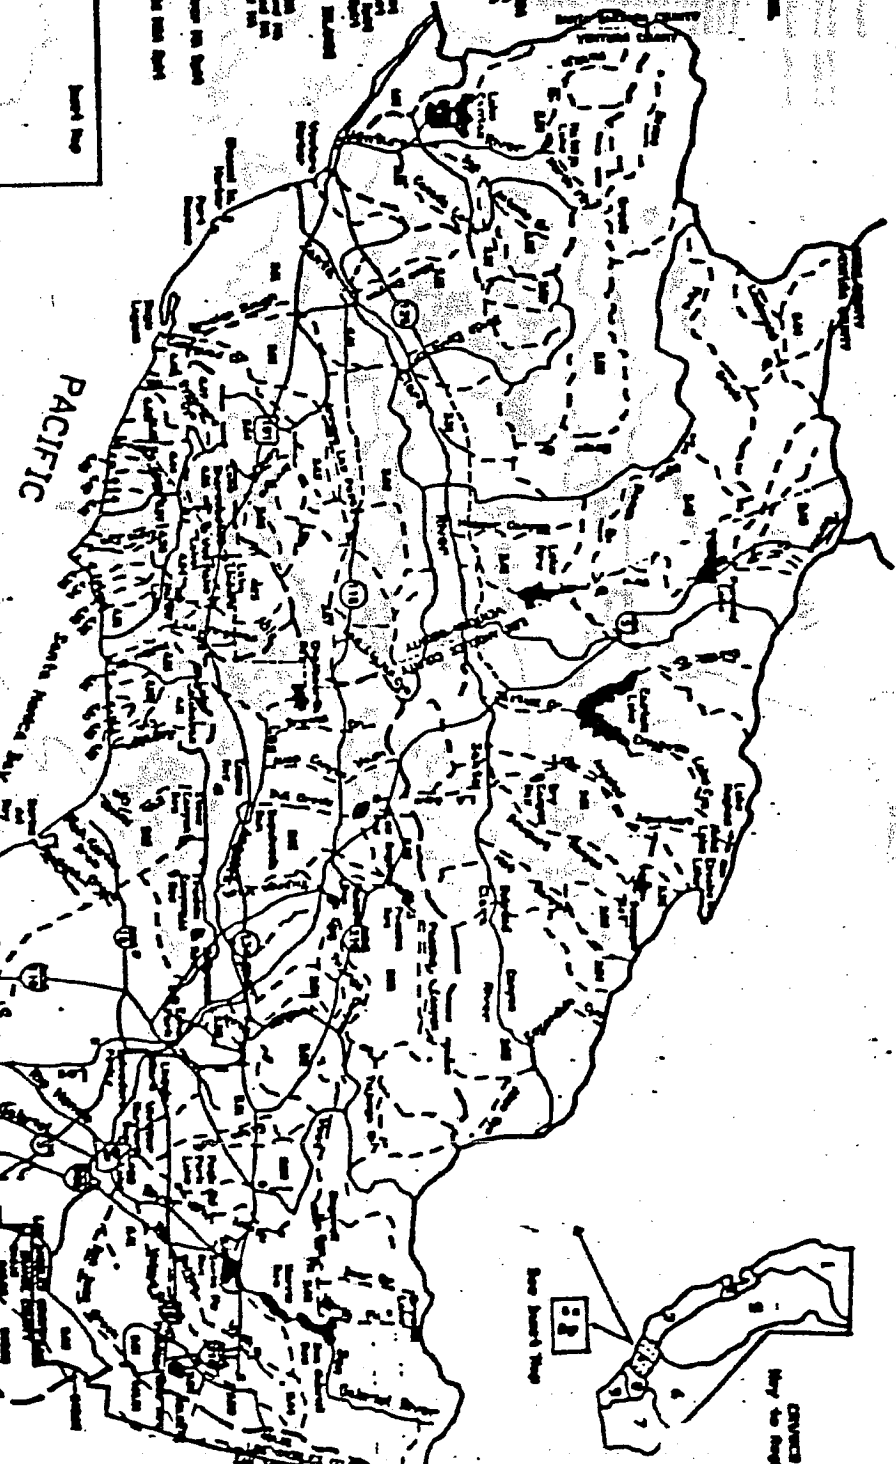


FIGURE 1
PRINCIPAL SURFACE WATER
OF THE
SANTA CLARA AND LOS ANGELES
RIVER BASINS

Attachment "B"

**State Department of Health Services
 Primary Drinking Water Standards
 Secondary Drinking Water Standards
 Priority Pollutants**

Contaminant	Primary MCL	Secondary MCL	Priority
Asbestos	0.01	0.01	1
Barium	2.0	2.0	2
Beryllium	0.001	0.001	3
Cadmium	0.01	0.01	4
Copper	1.3	1.3	5
Cyanide	0.07	0.07	6
Fluoride	4.0	4.0	7
Lead	0.01	0.01	8
Manganese	0.05	0.05	9
Mercury	0.01	0.01	10
Nitrate	10.0	10.0	11
Nitrite	1.0	1.0	12
Radon	5.0	5.0	13
Selenium	0.01	0.01	14
Silver	0.1	0.1	15
Sulfate	250.0	250.0	16
Turbidity	5.0	5.0	17
Total Dissolved Solids	500.0	500.0	18
Total Hardness	300.0	300.0	19
Total Suspended Solids	5.0	5.0	20
Total Trihalomethanes	0.1	0.1	21
Total Trihaloethenes	0.001	0.001	22
Total Trihalomethanes and Total Trihaloethenes	0.1	0.1	23
Total Volatile Organic Compounds	0.1	0.1	24
Total Organic Halides	0.1	0.1	25
Total Organic Carbon	0.1	0.1	26
Total Organic Carbon and Total Organic Halides	0.1	0.1	27
Total Organic Carbon and Total Volatile Organic Compounds	0.1	0.1	28
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides	0.1	0.1	29
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform)	0.1	0.1	30
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform and Bromoform)	0.1	0.1	31
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, and Dibromochloromethane)	0.1	0.1	32
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, and Dibromodichloromethane)	0.1	0.1	33
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, and Dibromobromomethane)	0.1	0.1	34
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, and Dibromodibromomethane)	0.1	0.1	35
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, and Dibromotribromomethane)	0.1	0.1	36
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	37
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	38
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	39
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	40
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	41
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	42
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	43
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	44
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	45
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	46
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	47
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	48
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	49
Total Organic Carbon, Total Volatile Organic Compounds, and Total Organic Halides (excluding Chloroform, Bromoform, Dibromochloromethane, Dibromodichloromethane, Dibromobromomethane, Dibromodibromomethane, Dibromotribromomethane, and Dibromotetrabromomethane)	0.1	0.1	50

Approved for printing on 10/15/01 by [illegible]

Attachment "B": Drinking Water Standards and Priority Pollutants

State DHS Primary Drinking Water Standards, Maximum Contaminant Level (MCL)		
MCL	Constituent	Constituent
Organic Compounds, MCL units of milligrams per liter (mg/l)		
0.005	1,1-Dichloroethane (1,1-DCA)	1,1-Dichloroethylene (1,1-DCE)
0.200	1,1,1-Trichloroethane (1,1,1-TCA)	1,1,2-Trichloro-1,2,2-trifluoroethane (Freon 113)
0.032	1,1,2-Trichloroethane (1,1,2-TCA)	1,1,2,2-Tetrachloroethane
0.0005	1,2-Dichloroethane (1,2-DCA)	1,2-Dichloropropane (Propylene dichloride)
*a	1,3-Dichloropropane	1,3-Dichloropropane
0.005	1,4-Dichlorobenzene (p-DCB)	2,4-D
0.05	2,4,5-TP (Silvex)	Atrazine (Aatrex)
0.018	Bentazon (Basagran)	Benzene
*a	Bromodichloromethane	Bromoform
0.018	Carbofuran (Furadan)	Carbon tetrachloride
0.0001	Chlordane	Chlorobenzene (Monochlorobenzene)
*a	Chloroform	cis-1,2-Dichloroethylene
0.004	Di(2-ethylhexyl)phthalate (DEHP)	Dibromochloromethane
0.0002	Dibromochloropropane (DBCP)	Endrin
0.680	Ethylbenzene (Phenylethane)	Ethylene dibromide (EDB)
0.7	Glyphosate	Heptachlor epoxide
0.00001	Heptachlor	Lindane (gamma-BHC)
0.1	Methoxychlor	Molinate (Ordram)
0.01	Simazine (Princep)	Tetrachloroethene (PCE)
0.07	Thiobencarb (Bolero)	Toxaphene
0.01	trans-1,2-Dichloroethylene	Trichloroethene (TCE)
0.15	Trichlorofluoromethane (Freon 11)	Vinyl chloride (VC)
1.75	Xylenes	

State DHS Primary Drinking Water Standards, Maximum Contaminant Level (MCL)	
MCL	Constituent
Inorganic/Physical Constituents, MCL units of milligrams/liter (mg/L)	
1.0	Aluminum (Al)
1.0	Barium (Ba)
0.05	Chromium, total (Cr)
2.2	Fluoride (F) temp 53.8-58.3 °F
1.8	Fluoride (F) temp 63.9-70.6 °F
1.4	Fluoride (F) temp 79.3-90.5 °F
0.002	Mercury (Hg)
0.01	Selenium (Se)
Radio Chemistry, MCL units of pico Curies per liter (pCi/L)	
15 (pCi/L)	Gross Alpha (α)
5 (pCi/L)	Gross Beta (β)
	Strontium-90 (Sr ⁹⁰)

State DHS Secondary Drinking Water Standards	
MCL (units)	Constituent
250 mg/L	Chloride (Cl)
900 μmhos	Conductivity
0.5 units	Foaming agent (MBAS)
0.05 mg/L	Manganese (Mn)
500 mg/L	Total dissolved solids (TDS)
5.0 mg/L	Zinc (Zn)

State DHS Secondary Drinking Water Standards	
MCL (units)	Constituent
15 units	Color
1.0 mg/L	Copper (Cu)
0.3 mg/L	Iron (Fe)
250 mg/L	Sulfate (SO ₄)
5 units	Turbidity

Priority Pollutants: Acid Extractables	
2,4, Trichlorophenol	2-Chlorophenol
2,4-Dichlorophenol	2-Nitrophenol
4-Nitrophenol	4,6-Dinitro-o-cresol
Pentachlorophenol	Phenol

Priority Pollutants: Base/Neutral Extractables	
Acenaphthene	Benzidine
Hexachlorobenzene	Hexachloroethane
2-Chloronaphthalene	1,2-Dichlorobenzene
1,4-Dichlorobenzene	3,3'-Dichlorobenzidine
2,6-Dinitrotoluene	1,2-Diphenylhydrazine
4-Chlorophenyl phenyl ether	4-Bromophenyl phenyl ether
Bis (2-Chloroethoxy) methane	Hexachlorobutadiene
Isophorone	Naphthalene
N-Nitrosodimethylamine	N-Nitrosodi-n-propylamine
Bis (2-Ethylhexyl) phthalate	Butyl benzyl phthalate
Di-N-Octyl phthalate	Diethyl phthalate
Benzo (A) Anthracene	Benzo (A) pyrene
Benzo (K) Fluoranthene	Chrysene
Anthracene	1,12-Benzoperylene
Phenanthrene	1,2,5,6-Dibenzanthracene
Pyrene	TCDD
	1,2,4-Trichlorobenzene
	Bis (2-Chloroethyl) ether
	1,3-Dichlorobenzene
	2,4-Dinitrotoluene
	Fluoranthene
	Bis (2-chloroisopropyl) ether
	Hexachlorocyclopentadiene
	Nitrobenzene
	M-Nitrosodiphenylamine
	Di-N-Butyl phthalate
	Dimethyl phthalate
	Benzo (B) fluoranthene
	Acenaphthylene
	Fluorene
	Indeno (1,2,3-CD) pyrene

Priority Pollutants: Pesticides	
Aldrin	Dieldrin
4,4'-DDT	4,4'-DDD
Alpha endosulfan	Endosulfan sulfate
Endrin	Heptachlor
Heptachlor epoxide	Beta BHC
Gamma BHC	Toxaphene
PCB 1016	PCB 1232
PCB 1242	PCB 1254
PCB 1260	

Priority Pollutants: Volatile Organics	
Acrolein	Benzene
Carbon tetrachloride	1,2-Dichloroethane
1,1,1-Trichloroethane	1,1,2-Trichloroethane
1,1,2,2-Tetrachloroethane	Chloroform
1,1-Dichloroethylene	1,2-Dichloropropane
1,2-Dichloropropylene	Methylene chloride
Methyl chloride	Bromoform
Bromodichloromethane	Tetrachloroethylene
Toluene	Vinyl chloride
2-Chloroethyl vinyl ether	

Attachment "B": Drinking Water Standards and Priority Pollutants

Priority Pollutants: Metals & Miscellaneous	
Antimony (Sb)	Arsenic (As)
Cadmium (Cd)	Chromium (Cr)
Lead (Pb)	Mercury (Hg)
Selenium (Se)	Silver (Ag)
Zinc (Zn)	Cyanide (CN ⁻)
	Beryllium (Be)
	Copper (Cu)
	Nickel (Ni)
	Thallium (Tl)
	Asbestos (H ₂ Mg ₃ Si ₂ O ₈)

.....Endnote

1. of a (MS note) Unregulated: monitoring required for all community and non-transient, non-community water systems